



**Off-Base Drinking Water Sample Results,
Level 2 Laboratory Report, Level 4 Laboratory Report,
Electronic Data Deliverable, Data Validation Report,
and the Sample Location Figure, SDG J25078-1**

*Naval Air Station Whidbey Island
Oak Harbor, Washington*

June 2019

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

ANALYTICAL REPORT

TestAmerica Laboratories, Inc.

TestAmerica Sacramento

880 Riverside Parkway

West Sacramento, CA 95605

Tel: (916)373-5600

TestAmerica Job ID: 320-25078-1

Client Project/Site: Whidbey Island


For:

CH2M Hill Constructors, Inc.

1100 NE Circle Blvd

Corvallis, Oregon 97330

Attn: Tiffany Hill



Authorized for release by:

1/24/2017 10:23:55 AM

Laura Turpen, Project Manager I

(916)374-4414

laura.turpen@testamericainc.com

LINKS

Review your project
results through

TotalAccess

Have a Question?



Visit us at:

www.testamericainc.com

The test results in this report meet all 2003 NELAC and 2009 TNI requirements for accredited parameters, exceptions are noted in this report. This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15

Table of Contents

Cover Page	1
Table of Contents	2
Definitions/Glossary	3
Case Narrative	4
Detection Summary	6
Client Sample Results	7
Surrogate Summary	10
QC Sample Results	11
QC Association Summary	12
Lab Chronicle	13
Certification Summary	16
Method Summary	17
Sample Summary	18
Chain of Custody	19
Receipt Checklists	20

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

Definitions/Glossary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Qualifiers

LCMS

Qualifier	Qualifier Description
U	Undetected at the Limit of Detection.
M	Manual integrated compound.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Case Narrative

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Job ID: 320-25078-1

Laboratory: TestAmerica Sacramento

Narrative

CASE NARRATIVE

Client: CH2M Hill Constructors, Inc.

Project: Whidbey Island

Report Number: 320-25078-1

With the exceptions noted as flags or footnotes, standard analytical protocols were followed in the analysis of the samples and no problems were encountered or anomalies observed. In addition all laboratory quality control samples were within established control limits, with any exceptions noted below. Each sample was analyzed to achieve the lowest possible reporting limit within the constraints of the method. In some cases, due to interference or analytes present at high concentrations, samples were diluted. For diluted samples, the reporting limits are adjusted relative to the dilution required.

TestAmerica Sacramento attests to the validity of the laboratory data generated by TestAmerica facilities reported herein. All analyses performed by TestAmerica facilities were done using established laboratory SOPs that incorporate QA/QC procedures described in the applicable methods. TestAmerica's operations groups have reviewed the data for compliance with the laboratory QA/QC plan, and data have been found to be compliant with laboratory protocols unless otherwise noted below.

TestAmerica utilizes USEPA approved methods and DOD QSM, where applicable, in all analytical work. The samples presented in this report were analyzed for the parameter(s) listed on the analytical methods summary page in accordance with the method(s) indicated. A summary of QC data for these analyses is included at the back of the report.

All parameters for which TestAmerica Sacramento has certification were evaluated to the QSM specified reporting convention or to the client specified format if different from QSM. Parameters not certified under QSM, if any, were evaluated to the detection limit (DL) and include qualified results where applicable.

The sample(s) that contain constituents flagged with U are undetected. The result associated with this flag is the limit of detection (LOD).

Calculations are performed before rounding to avoid round-off errors in calculated results.

All holding times were met and proper preservation noted for the methods performed on these samples, unless otherwise detailed in the individual sections below.

All solid sample results are reported on an "as received" basis unless otherwise indicated by the presence of a % solids value in the method header.

This laboratory report is confidential and is intended for the sole use of TestAmerica and its client.

RECEIPT

The samples were received on 01/18/2017; the samples arrived in good condition, properly preserved and on ice. The temperature of the coolers at receipt was 2.4 C.

Receipt Exceptions

The container labels for the following samples did not match the information listed on the Chain-of-Custody (COC): WI-CV-1RW45-0117 (320-25078-7) and WI-CV-1FB45-0117 (320-25078-8). The container labels list a time of 13:01 for 1RW45 and 13:00 for 1FB45, while the COC lists a time of 12:51 for 1RW45 and 12:50 for 1FB45. The sample times were logged in according to the COC.

PFOA/PFOS

Samples WI-CV-1RW53-0117 (320-25078-1), WI-CV-1FB53-0117 (320-25078-2), WI-CV-1RW54-0117 (320-25078-3), WI-CV-1FB54-0117 (320-25078-4), WI-CV-1RW55-0117 (320-25078-5), WI-CV-1FB55-0117 (320-25078-6), WI-CV-1RW56-0117 (320-25078-7), WI-CV-1FB56-0117 (320-25078-8), WI-CV-1RW57-0117 (320-25078-9), WI-CV-1FB57-0117 (320-25078-10), WI-CV-1RW58-0117 (320-25078-11) and WI-CV-1FB58-0117 (320-25078-12) were analyzed for PFOA/PFOS in accordance with 537. The samples were

Case Narrative

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Job ID: 320-25078-1 (Continued)

Laboratory: TestAmerica Sacramento (Continued)

prepared on 01/19/2017 and analyzed on 01/22/2017.

The following sample was centrifuged prior to extraction, due to excess sediment:
WI-CV-1RW55-0117 (320-25078-5)

Insufficient sample volume was available to perform a matrix spike/matrix spike duplicate (MS/MSD) associated with preparation batch 320-147025.

No analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

Detection Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW53-0117

Lab Sample ID: 320-25078-1

☐ No Detections.

Client Sample ID: WI-CV-1FB53-0117

Lab Sample ID: 320-25078-2

☐ No Detections.

Client Sample ID: WI-CV-1RW54-0117

Lab Sample ID: 320-25078-3

☐ No Detections.

Client Sample ID: WI-CV-1FB54-0117

Lab Sample ID: 320-25078-4

☐ No Detections.

Client Sample ID: WI-CV-1RW55-0117

Lab Sample ID: 320-25078-5

☐ No Detections.

Client Sample ID: WI-CV-1FB55-0117

Lab Sample ID: 320-25078-6

☐ No Detections.

Client Sample ID: WI-CV-1RW56-0117

Lab Sample ID: 320-25078-7

☐ No Detections.

Client Sample ID: WI-CV-1FB56-0117

Lab Sample ID: 320-25078-8

☐ No Detections.

Client Sample ID: WI-CV-1RW57-0117

Lab Sample ID: 320-25078-9

☐ No Detections.

Client Sample ID: WI-CV-1FB57-0117

Lab Sample ID: 320-25078-10

☐ No Detections.

Client Sample ID: WI-CV-1RW58-0117

Lab Sample ID: 320-25078-11

☐ No Detections.

Client Sample ID: WI-CV-1FB58-0117

Lab Sample ID: 320-25078-12

☐ No Detections.

This Detection Summary does not include radiochemical test results.

TestAmerica Sacramento

Client Sample Results

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW53-0117

Date Collected: 01/16/17 09:17

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-1

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.049	U M	0.061	0.016	ug/L	-	01/19/17 14:14	01/22/17 00:45	1
Perfluorooctanoic acid (PFOA)	0.024	U M	0.031	0.0096	ug/L	-	01/19/17 14:14	01/22/17 00:45	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	-	01/19/17 14:14	01/22/17 00:45	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	112		70 - 130				01/19/17 14:14	01/22/17 00:45	1
13C2 PFDA	108		70 - 130				01/19/17 14:14	01/22/17 00:45	1

Client Sample ID: WI-CV-1FB53-0117

Date Collected: 01/16/17 09:16

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-2

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.016	ug/L	-	01/19/17 14:14	01/22/17 01:15	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0095	ug/L	-	01/19/17 14:14	01/22/17 01:15	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	-	01/19/17 14:14	01/22/17 01:15	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	115		70 - 130				01/19/17 14:14	01/22/17 01:15	1
13C2 PFDA	108		70 - 130				01/19/17 14:14	01/22/17 01:15	1

Client Sample ID: WI-CV-1RW54-0117

Date Collected: 01/16/17 10:36

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-3

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.016	ug/L	-	01/19/17 14:14	01/22/17 01:44	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0095	ug/L	-	01/19/17 14:14	01/22/17 01:44	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	-	01/19/17 14:14	01/22/17 01:44	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	115		70 - 130				01/19/17 14:14	01/22/17 01:44	1
13C2 PFDA	112		70 - 130				01/19/17 14:14	01/22/17 01:44	1

Client Sample ID: WI-CV-1FB54-0117

Date Collected: 01/16/17 10:35

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-4

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.015	ug/L	-	01/19/17 14:14	01/22/17 02:14	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0094	ug/L	-	01/19/17 14:14	01/22/17 02:14	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.047	ug/L	-	01/19/17 14:14	01/22/17 02:14	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	122		70 - 130				01/19/17 14:14	01/22/17 02:14	1
13C2 PFDA	115		70 - 130				01/19/17 14:14	01/22/17 02:14	1

TestAmerica Sacramento

Client Sample Results

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW55-0117

Date Collected: 01/16/17 10:51

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-5

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.015	ug/L	—	01/19/17 14:14	01/22/17 02:44	1
Perfluorooctanoic acid (PFOA)	0.024	U M	0.030	0.0094	ug/L	—	01/19/17 14:14	01/22/17 02:44	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	—	01/19/17 14:14	01/22/17 02:44	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	124		70 - 130				01/19/17 14:14	01/22/17 02:44	1
13C2 PFDA	122		70 - 130				01/19/17 14:14	01/22/17 02:44	1

Client Sample ID: WI-CV-1FB55-0117

Date Collected: 01/16/17 10:50

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-6

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.061	0.016	ug/L	—	01/19/17 14:14	01/22/17 03:13	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0095	ug/L	—	01/19/17 14:14	01/22/17 03:13	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	—	01/19/17 14:14	01/22/17 03:13	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	122		70 - 130				01/19/17 14:14	01/22/17 03:13	1
13C2 PFDA	111		70 - 130				01/19/17 14:14	01/22/17 03:13	1

Client Sample ID: WI-CV-1RW56-0117

Date Collected: 01/16/17 12:51

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-7

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.061	0.016	ug/L	—	01/19/17 14:14	01/22/17 03:43	1
Perfluorooctanoic acid (PFOA)	0.025	U M	0.031	0.0096	ug/L	—	01/19/17 14:14	01/22/17 03:43	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.049	ug/L	—	01/19/17 14:14	01/22/17 03:43	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	115		70 - 130				01/19/17 14:14	01/22/17 03:43	1
13C2 PFDA	110		70 - 130				01/19/17 14:14	01/22/17 03:43	1

Client Sample ID: WI-CV-1FB56-0117

Date Collected: 01/16/17 12:50

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-8

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.016	ug/L	—	01/19/17 14:14	01/22/17 04:12	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0094	ug/L	—	01/19/17 14:14	01/22/17 04:12	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	—	01/19/17 14:14	01/22/17 04:12	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	114		70 - 130				01/19/17 14:14	01/22/17 04:12	1
13C2 PFDA	108		70 - 130				01/19/17 14:14	01/22/17 04:12	1

TestAmerica Sacramento

Client Sample Results

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW57-0117

Lab Sample ID: 320-25078-9

Date Collected: 01/16/17 14:26

Matrix: Water

Date Received: 01/18/17 09:25

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.016	ug/L	—	01/19/17 14:14	01/22/17 04:42	1
Perfluorooctanoic acid (PFOA)	0.024	U M	0.030	0.0094	ug/L	—	01/19/17 14:14	01/22/17 04:42	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	—	01/19/17 14:14	01/22/17 04:42	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	111		70 - 130				01/19/17 14:14	01/22/17 04:42	1
13C2 PFDA	116		70 - 130				01/19/17 14:14	01/22/17 04:42	1

Client Sample ID: WI-CV-1FB57-0117

Lab Sample ID: 320-25078-10

Date Collected: 01/16/17 14:25

Matrix: Water

Date Received: 01/18/17 09:25

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.015	ug/L	—	01/19/17 14:14	01/22/17 06:11	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0094	ug/L	—	01/19/17 14:14	01/22/17 06:11	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.047	ug/L	—	01/19/17 14:14	01/22/17 06:11	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	119		70 - 130				01/19/17 14:14	01/22/17 06:11	1
13C2 PFDA	115		70 - 130				01/19/17 14:14	01/22/17 06:11	1

Client Sample ID: WI-CV-1RW58-0117

Lab Sample ID: 320-25078-11

Date Collected: 01/16/17 14:55

Matrix: Water

Date Received: 01/18/17 09:25

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.062	0.016	ug/L	—	01/19/17 14:14	01/22/17 06:40	1
Perfluorooctanoic acid (PFOA)	0.025	U	0.031	0.0097	ug/L	—	01/19/17 14:14	01/22/17 06:40	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.049	ug/L	—	01/19/17 14:14	01/22/17 06:40	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	112		70 - 130				01/19/17 14:14	01/22/17 06:40	1
13C2 PFDA	108		70 - 130				01/19/17 14:14	01/22/17 06:40	1

Client Sample ID: WI-CV-1FB58-0117

Lab Sample ID: 320-25078-12

Date Collected: 01/16/17 14:54

Matrix: Water

Date Received: 01/18/17 09:25

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.061	0.016	ug/L	—	01/19/17 14:14	01/22/17 07:10	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0096	ug/L	—	01/19/17 14:14	01/22/17 07:10	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	—	01/19/17 14:14	01/22/17 07:10	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	122		70 - 130				01/19/17 14:14	01/22/17 07:10	1
13C2 PFDA	111		70 - 130				01/19/17 14:14	01/22/17 07:10	1

TestAmerica Sacramento

Surrogate Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Matrix: Water

Prep Type: Total/NA

Lab Sample ID	Client Sample ID	Percent Surrogate Recovery (Acceptance Limits)	
		3C2 PFHx (70-130)	3C2 PFDA (70-130)
320-25078-1	WI-CV-1RW53-0117	112	108
320-25078-2	WI-CV-1FB53-0117	115	108
320-25078-3	WI-CV-1RW54-0117	115	112
320-25078-4	WI-CV-1FB54-0117	122	115
320-25078-5	WI-CV-1RW55-0117	124	122
320-25078-6	WI-CV-1FB55-0117	122	111
320-25078-7	WI-CV-1RW56-0117	115	110
320-25078-8	WI-CV-1FB56-0117	114	108
320-25078-9	WI-CV-1RW57-0117	111	116
320-25078-10	WI-CV-1FB57-0117	119	115
320-25078-11	WI-CV-1RW58-0117	112	108
320-25078-12	WI-CV-1FB58-0117	122	111
LCS 320-147025/2-A	Lab Control Sample	127	122
LCSD 320-147025/3-A	Lab Control Sample Dup	124	125
MB 320-147025/1-A	Method Blank	111	110

Surrogate Legend

13C2 PFHxA = 13C2 PFHxA

13C2 PFDA = 13C2 PFDA

QC Sample Results

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Lab Sample ID: MB 320-147025/1-A

Matrix: Water

Analysis Batch: 147271

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 147025

Analyte	MB Result	MB Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.016	ug/L		01/19/17 14:14	01/21/17 18:20	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0094	ug/L		01/19/17 14:14	01/21/17 18:20	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L		01/19/17 14:14	01/21/17 18:20	1

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
13C2 PFHxA	111		70 - 130	01/19/17 14:14	01/21/17 18:20	1
13C2 PFDA	110		70 - 130	01/19/17 14:14	01/21/17 18:20	1

Lab Sample ID: LCS 320-147025/2-A

Matrix: Water

Analysis Batch: 147271

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 147025

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Perfluorooctanesulfonic acid (PFOS)	0.160	0.158		ug/L		99	70 - 130
Perfluorooctanoic acid (PFOA)	0.0781	0.0726		ug/L		93	70 - 130
Perfluorobutanesulfonic acid (PFBS)	0.359	0.304		ug/L		85	70 - 130

Surrogate	LCS %Recovery	LCS Qualifier	Limits
13C2 PFHxA	127		70 - 130
13C2 PFDA	122		70 - 130

Lab Sample ID: LCSD 320-147025/3-A

Matrix: Water

Analysis Batch: 147271

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Prep Batch: 147025

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	Limits	RPD	RPD Limit
Perfluorooctanesulfonic acid (PFOS)	0.160	0.160		ug/L		100	70 - 130	1	30
Perfluorooctanoic acid (PFOA)	0.0781	0.0782		ug/L		100	70 - 130	7	30
Perfluorobutanesulfonic acid (PFBS)	0.359	0.290		ug/L		81	70 - 130	5	30

Surrogate	LCSD %Recovery	LCSD Qualifier	Limits
13C2 PFHxA	124		70 - 130
13C2 PFDA	125		70 - 130

TestAmerica Sacramento

QC Association Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

LCMS

Prep Batch: 147025

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
320-25078-1	WI-CV-1RW53-0117	Total/NA	Water	537	
320-25078-2	WI-CV-1FB53-0117	Total/NA	Water	537	
320-25078-3	WI-CV-1RW54-0117	Total/NA	Water	537	
320-25078-4	WI-CV-1FB54-0117	Total/NA	Water	537	
320-25078-5	WI-CV-1RW55-0117	Total/NA	Water	537	
320-25078-6	WI-CV-1FB55-0117	Total/NA	Water	537	
320-25078-7	WI-CV-1RW56-0117	Total/NA	Water	537	
320-25078-8	WI-CV-1FB56-0117	Total/NA	Water	537	
320-25078-9	WI-CV-1RW57-0117	Total/NA	Water	537	
320-25078-10	WI-CV-1FB57-0117	Total/NA	Water	537	
320-25078-11	WI-CV-1RW58-0117	Total/NA	Water	537	
320-25078-12	WI-CV-1FB58-0117	Total/NA	Water	537	
MB 320-147025/1-A	Method Blank	Total/NA	Water	537	
LCS 320-147025/2-A	Lab Control Sample	Total/NA	Water	537	
LCSD 320-147025/3-A	Lab Control Sample Dup	Total/NA	Water	537	

Analysis Batch: 147271

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
MB 320-147025/1-A	Method Blank	Total/NA	Water	537	147025
LCS 320-147025/2-A	Lab Control Sample	Total/NA	Water	537	147025
LCSD 320-147025/3-A	Lab Control Sample Dup	Total/NA	Water	537	147025

Analysis Batch: 147339

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
320-25078-1	WI-CV-1RW53-0117	Total/NA	Water	537	147025
320-25078-2	WI-CV-1FB53-0117	Total/NA	Water	537	147025
320-25078-3	WI-CV-1RW54-0117	Total/NA	Water	537	147025
320-25078-4	WI-CV-1FB54-0117	Total/NA	Water	537	147025
320-25078-5	WI-CV-1RW55-0117	Total/NA	Water	537	147025
320-25078-6	WI-CV-1FB55-0117	Total/NA	Water	537	147025
320-25078-7	WI-CV-1RW56-0117	Total/NA	Water	537	147025
320-25078-8	WI-CV-1FB56-0117	Total/NA	Water	537	147025
320-25078-9	WI-CV-1RW57-0117	Total/NA	Water	537	147025

Analysis Batch: 147340

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
320-25078-10	WI-CV-1FB57-0117	Total/NA	Water	537	147025
320-25078-11	WI-CV-1RW58-0117	Total/NA	Water	537	147025
320-25078-12	WI-CV-1FB58-0117	Total/NA	Water	537	147025

Lab Chronicle

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW53-0117

Date Collected: 01/16/17 09:17

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-1

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			245.4 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147339	01/22/17 00:45	JRB	TAL SAC

Client Sample ID: WI-CV-1FB53-0117

Date Collected: 01/16/17 09:16

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-2

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			249.1 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147339	01/22/17 01:15	JRB	TAL SAC

Client Sample ID: WI-CV-1RW54-0117

Date Collected: 01/16/17 10:36

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			248.6 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147339	01/22/17 01:44	JRB	TAL SAC

Client Sample ID: WI-CV-1FB54-0117

Date Collected: 01/16/17 10:35

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-4

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			250.9 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147339	01/22/17 02:14	JRB	TAL SAC

Client Sample ID: WI-CV-1RW55-0117

Date Collected: 01/16/17 10:51

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			250.2 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147339	01/22/17 02:44	JRB	TAL SAC

Client Sample ID: WI-CV-1FB55-0117

Date Collected: 01/16/17 10:50

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-6

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			247.7 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147339	01/22/17 03:13	JRB	TAL SAC

TestAmerica Sacramento

Lab Chronicle

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW56-0117

Lab Sample ID: 320-25078-7

Date Collected: 01/16/17 12:51

Matrix: Water

Date Received: 01/18/17 09:25

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			244.1 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147339	01/22/17 03:43	JRB	TAL SAC

Client Sample ID: WI-CV-1FB56-0117

Lab Sample ID: 320-25078-8

Date Collected: 01/16/17 12:50

Matrix: Water

Date Received: 01/18/17 09:25

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			249.9 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147339	01/22/17 04:12	JRB	TAL SAC

Client Sample ID: WI-CV-1RW57-0117

Lab Sample ID: 320-25078-9

Date Collected: 01/16/17 14:26

Matrix: Water

Date Received: 01/18/17 09:25

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			249.3 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147339	01/22/17 04:42	JRB	TAL SAC

Client Sample ID: WI-CV-1FB57-0117

Lab Sample ID: 320-25078-10

Date Collected: 01/16/17 14:25

Matrix: Water

Date Received: 01/18/17 09:25

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			250.9 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147340	01/22/17 06:11	JRB	TAL SAC

Client Sample ID: WI-CV-1RW58-0117

Lab Sample ID: 320-25078-11

Date Collected: 01/16/17 14:55

Matrix: Water

Date Received: 01/18/17 09:25

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			243.5 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147340	01/22/17 06:40	JRB	TAL SAC

Client Sample ID: WI-CV-1FB58-0117

Lab Sample ID: 320-25078-12

Date Collected: 01/16/17 14:54

Matrix: Water

Date Received: 01/18/17 09:25

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			246.1 mL	1.0 mL	147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1			147340	01/22/17 07:10	JRB	TAL SAC

TestAmerica Sacramento

Lab Chronicle

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Laboratory References:

TAL SAC = TestAmerica Sacramento, 880 Riverside Parkway, West Sacramento, CA 95605, TEL (916)373-5600

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15

Certification Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Laboratory: TestAmerica Sacramento

Unless otherwise noted, all analytes for this laboratory were covered under each certification below.

Authority	Program	EPA Region	Certification ID	Expiration Date
A2LA	DoD ELAP		2928-01	01-31-17
Analysis Method	Prep Method	Matrix	Analyte	

Method Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Method	Method Description	Protocol	Laboratory
537	Perfluorinated Alkyl Acids (LC/MS)	EPA	TAL SAC

Protocol References:

EPA = US Environmental Protection Agency

Laboratory References:

TAL SAC = TestAmerica Sacramento, 880 Riverside Parkway, West Sacramento, CA 95605, TEL (916)373-5600

Sample Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
320-25078-1	WI-CV-1RW53-0117	Water	01/16/17 09:17	01/18/17 09:25
320-25078-2	WI-CV-1FB53-0117	Water	01/16/17 09:16	01/18/17 09:25
320-25078-3	WI-CV-1RW54-0117	Water	01/16/17 10:36	01/18/17 09:25
320-25078-4	WI-CV-1FB54-0117	Water	01/16/17 10:35	01/18/17 09:25
320-25078-5	WI-CV-1RW55-0117	Water	01/16/17 10:51	01/18/17 09:25
320-25078-6	WI-CV-1FB55-0117	Water	01/16/17 10:50	01/18/17 09:25
320-25078-7	WI-CV-1RW56-0117	Water	01/16/17 12:51	01/18/17 09:25
320-25078-8	WI-CV-1FB56-0117	Water	01/16/17 12:50	01/18/17 09:25
320-25078-9	WI-CV-1RW57-0117	Water	01/16/17 14:26	01/18/17 09:25
320-25078-10	WI-CV-1FB57-0117	Water	01/16/17 14:25	01/18/17 09:25
320-25078-11	WI-CV-1RW58-0117	Water	01/16/17 14:55	01/18/17 09:25
320-25078-12	WI-CV-1FB58-0117	Water	01/16/17 14:54	01/18/17 09:25

West Sacramento, CA 95605
phone 916.373.5600 fax

TestAmerica Laboratories, Inc.

Regulatory Program: ☐ DW ☐ NPDES ☐ RCRA ☐ Other:

Client Contact		Project Manager: Katie Tipping		Site Contact: Eric Epple		Date: 1/16/2017		COC No: 1	
Tiffany Hill		Tel/Fax: (757) 671-6258		Lab Contact: Laura Turpen		Carrier: FedEx		COCs	
Project Chemist		Analysis Turnaround Time		Filtered Sample (Y/N)		Perform MS/MSD (Y/N)		USEPA Method 537 (PFOA, PFOS, and PFS)	
1100 NE Circle Blvd Ste 300 Corvallis, OR 97330		☒ CALENDAR DAYS ☐ WORKING DAYS		Sample Type (C-Comp, G-Grab)		Matrix		# of Cont.	
(541) 768-3109		TAT if different from Below 7-Day		Sample Date		Sample Time			
(541) 908-3794		☐ 2 weeks		1/16/17		9:17		G DW 2	
Project Name: CTO-08		☐ 1 week		1/16/17		9:16		G DW 2	
Site: OLF Coupeville		☐ 2 days		1/16/17		10:36		G DW 2	
P O #: 100067106050 - 679580.09.F.L.F.S		☐ 1 day		1/16/17		10:35		G DW 2	
				1/16/17		10:51		G DW 2	
				1/16/17		10:50		G DW 2	
				1/16/17		12:51		G DW 2	
				1/16/17		12:50		G DW 2	
				1/16/17		14:26		G DW 2	
				1/16/17		14:25		G DW 2	
				1/16/17		14:55		G DW 2	
				1/16/17		14:54		G DW 2	
Sample Identification		Sample Type		Sample Date		Sample Time		Matrix	
WI-CV-1RW42-0117		G		1/16/17		9:17		DW 2	
WI-CV-1FB42-0117		G		1/16/17		9:16		DW 2	
WI-CV-1RW43-0117		G		1/16/17		10:36		DW 2	
WI-CV-1FB43-0117		G		1/16/17		10:35		DW 2	
WI-CV-1RW44-0117		G		1/16/17		10:51		DW 2	
WI-CV-1FB44-0117		G		1/16/17		10:50		DW 2	
WI-CV-1RW45-0117		G		1/16/17		12:51		DW 2	
WI-CV-1FB45-0117		G		1/16/17		12:50		DW 2	
WI-CV-1RW46-0117		G		1/16/17		14:26		DW 2	
WI-CV-1FB46-0117		G		1/16/17		14:25		DW 2	
WI-CV-1RW47-0117		G		1/16/17		14:55		DW 2	
WI-CV-1FB47-0117		G		1/16/17		14:54		DW 2	
Preservation Used: 1= Ice, 2= HCl; 3= H2SO4; 4= HNO3; 5= NaOH; 6= Other Trizma		Sample Specific Notes:		Return to Client		Disposal by Lab		Archive for	
Possible Hazard Identification:		Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)		Return to Client		Disposal by Lab		Archive for	
Are any samples from a listed EPA Hazardous Waste? Please List any EPA Waste Codes for the sample in the Comments Section if the lab is to dispose of the sample.		Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)		Return to Client		Disposal by Lab		Archive for	
Special Instructions/QC Requirements & Comments:		Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)		Return to Client		Disposal by Lab		Archive for	
Custody Seals Intact: ☐ Yes ☐ No		Custody Seal No.:		Cooler Temp. (°C):		Obs'd:		Therm ID No.:	
Relinquished by:		Company: CH2M		Received by:		Company: HWS		Date/Time: 1/17/17 9:50	
Relinquished by:		Company:		Received by:		Company:		Date/Time: 1/18/17 0925	
Relinquished by:		Company:		Received in Laboratory by:		Company:		Date/Time:	

1 labeled @ 1301
2 ↓ 1300
or 1-18-17

Client: CH2M Hill Constructors, Inc.

Job Number: 320-25078-1

Login Number: 25078

List Source: TestAmerica Sacramento

List Number: 1

Creator: Nelson, Kym D

Question	Answer	Comment
Radioactivity wasn't checked or is $\leq$ background as measured by a survey meter.	True	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	N/A	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	N/A	
There are no discrepancies between the containers received and the COC.	False	Times on containers do not match the COC. Logged in per COC.
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

ANALYTICAL REPORT

Job Number: 320-25078-1

Job Description: Whidbey Island

For:

CH2M Hill Constructors, Inc.

1100 NE Circle Blvd

Corvallis, OR 97330

Attention: Tiffany Hill



Approved for release.
Laura Turpen
Project Manager I
1/24/2017 10:24 AM

Laura Turpen, Project Manager I
880 Riverside Parkway, West Sacramento, CA, 95605
(916)374-4414
laura.turpen@testamericainc.com
01/24/2017

Table of Contents

Cover Title Page	1
Data Summaries	4
Definitions	4
Case Narrative	5
Detection Summary	6
Client Sample Results	7
Default Detection Limits	10
Surrogate Summary	11
QC Sample Results	12
QC Association	13
Chronicle	14
Certification Summary	17
Method Summary	18
Sample Summary	19
Manual Integration Summary	20
Reagent Traceability	22
COAs	31
Organic Sample Data	71
LCMS	71
Method 537 DOD	71
Method 537 DOD QC Summary	72
Method 537 DOD Sample Data	83
Standards Data	136
Method 537 DOD ICAL Data	136
Method 537 DOD CCAL Data	159
Raw QC Data	186

Table of Contents

Method 537 DOD Blank Data	186
Method 537 DOD LCS/LCSD Data	190
Method 537 DOD Run Logs	198
Method 537 DOD Prep Data	202
Shipping and Receiving Documents	216
Client Chain of Custody	217
Sample Receipt Checklist	218

Definitions/Glossary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Qualifiers

LCMS

Qualifier	Qualifier Description
U	Undetected at the Limit of Detection.
M	Manual integrated compound.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

CASE NARRATIVE

Client: CH2M Hill Constructors, Inc.

Project: Whidbey Island

Report Number: 320-25078-1

With the exceptions noted as flags or footnotes, standard analytical protocols were followed in the analysis of the samples and no problems were encountered or anomalies observed. In addition all laboratory quality control samples were within established control limits, with any exceptions noted below. Each sample was analyzed to achieve the lowest possible reporting limit within the constraints of the method. In some cases, due to interference or analytes present at high concentrations, samples were diluted. For diluted samples, the reporting limits are adjusted relative to the dilution required.

TestAmerica Sacramento attests to the validity of the laboratory data generated by TestAmerica facilities reported herein. All analyses performed by TestAmerica facilities were done using established laboratory SOPs that incorporate QA/QC procedures described in the applicable methods. TestAmerica's operations groups have reviewed the data for compliance with the laboratory QA/QC plan, and data have been found to be compliant with laboratory protocols unless otherwise noted below.

TestAmerica utilizes USEPA approved methods and DOD QSM, where applicable, in all analytical work. The samples presented in this report were analyzed for the parameter(s) listed on the analytical methods summary page in accordance with the method(s) indicated. A summary of QC data for these analyses is included at the back of the report.

All parameters for which TestAmerica Sacramento has certification were evaluated to the QSM specified reporting convention or to the client specified format if different from QSM. Parameters not certified under QSM, if any, were evaluated to the detection limit (DL) and include qualified results where applicable.

The sample(s) that contain constituents flagged with U are undetected. The result associated with this flag is the limit of detection (LOD).

Calculations are performed before rounding to avoid round-off errors in calculated results.

All holding times were met and proper preservation noted for the methods performed on these samples, unless otherwise detailed in the individual sections below.

All solid sample results are reported on an "as received" basis unless otherwise indicated by the presence of a % solids value in the method header.

This laboratory report is confidential and is intended for the sole use of TestAmerica and its client.

RECEIPT

The samples were received on 01/18/2017; the samples arrived in good condition, properly preserved and on ice. The temperature of the coolers at receipt was 2.4 C.

Receipt Exceptions

The container labels for the following samples did not match the information listed on the Chain-of-Custody (COC): WI-CV-1RW45-0117 (320-25078-7) and WI-CV-1FB45-0117 (320-25078-8). The container labels list a time of 13:01 for 1RW45 and 13:00 for 1FB45, while the COC lists a time of 12:51 for 1RW45 and 12:50 for 1FB45. The sample times were logged in according to the COC.

PFOA/PFOS

Samples WI-CV-1RW53-0117 (320-25078-1), WI-CV-1FB53-0117 (320-25078-2), WI-CV-1RW54-0117 (320-25078-3), WI-CV-1FB54-0117 (320-25078-4), WI-CV-1RW55-0117 (320-25078-5), WI-CV-1FB55-0117 (320-25078-6), WI-CV-1RW56-0117 (320-25078-7), WI-CV-1FB56-0117 (320-25078-8), WI-CV-1RW57-0117 (320-25078-9), WI-CV-1FB57-0117 (320-25078-10), WI-CV-1RW58-0117 (320-25078-11) and WI-CV-1FB58-0117 (320-25078-12) were analyzed for PFOA/PFOS in accordance with 537. The samples were prepared on 01/19/2017 and analyzed on 01/22/2017.

The following sample was centrifuged prior to extraction, due to excess sediment:
WI-CV-1RW55-0117 (320-25078-5)

Insufficient sample volume was available to perform a matrix spike/matrix spike duplicate (MS/MSD) associated with preparation batch 320-147025.

No analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

Detection Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW53-0117

Lab Sample ID: 320-25078-1

☐ No Detections.

Client Sample ID: WI-CV-1FB53-0117

Lab Sample ID: 320-25078-2

☐ No Detections.

Client Sample ID: WI-CV-1RW54-0117

Lab Sample ID: 320-25078-3

☐ No Detections.

Client Sample ID: WI-CV-1FB54-0117

Lab Sample ID: 320-25078-4

☐ No Detections.

Client Sample ID: WI-CV-1RW55-0117

Lab Sample ID: 320-25078-5

☐ No Detections.

Client Sample ID: WI-CV-1FB55-0117

Lab Sample ID: 320-25078-6

☐ No Detections.

Client Sample ID: WI-CV-1RW56-0117

Lab Sample ID: 320-25078-7

☐ No Detections.

Client Sample ID: WI-CV-1FB56-0117

Lab Sample ID: 320-25078-8

☐ No Detections.

Client Sample ID: WI-CV-1RW57-0117

Lab Sample ID: 320-25078-9

☐ No Detections.

Client Sample ID: WI-CV-1FB57-0117

Lab Sample ID: 320-25078-10

☐ No Detections.

Client Sample ID: WI-CV-1RW58-0117

Lab Sample ID: 320-25078-11

☐ No Detections.

Client Sample ID: WI-CV-1FB58-0117

Lab Sample ID: 320-25078-12

☐ No Detections.

This Detection Summary does not include radiochemical test results.

TestAmerica Sacramento

Client Sample Results

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW53-0117

Date Collected: 01/16/17 09:17

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-1

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.049	U M	0.061	0.016	ug/L	—	01/19/17 14:14	01/22/17 00:45	1
Perfluorooctanoic acid (PFOA)	0.024	U M	0.031	0.0096	ug/L	—	01/19/17 14:14	01/22/17 00:45	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	—	01/19/17 14:14	01/22/17 00:45	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	112		70 - 130				01/19/17 14:14	01/22/17 00:45	1
13C2 PFDA	108		70 - 130				01/19/17 14:14	01/22/17 00:45	1

Client Sample ID: WI-CV-1FB53-0117

Date Collected: 01/16/17 09:16

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-2

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.016	ug/L	—	01/19/17 14:14	01/22/17 01:15	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0095	ug/L	—	01/19/17 14:14	01/22/17 01:15	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	—	01/19/17 14:14	01/22/17 01:15	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	115		70 - 130				01/19/17 14:14	01/22/17 01:15	1
13C2 PFDA	108		70 - 130				01/19/17 14:14	01/22/17 01:15	1

Client Sample ID: WI-CV-1RW54-0117

Date Collected: 01/16/17 10:36

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-3

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.016	ug/L	—	01/19/17 14:14	01/22/17 01:44	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0095	ug/L	—	01/19/17 14:14	01/22/17 01:44	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	—	01/19/17 14:14	01/22/17 01:44	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	115		70 - 130				01/19/17 14:14	01/22/17 01:44	1
13C2 PFDA	112		70 - 130				01/19/17 14:14	01/22/17 01:44	1

Client Sample ID: WI-CV-1FB54-0117

Date Collected: 01/16/17 10:35

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-4

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.015	ug/L	—	01/19/17 14:14	01/22/17 02:14	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0094	ug/L	—	01/19/17 14:14	01/22/17 02:14	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.047	ug/L	—	01/19/17 14:14	01/22/17 02:14	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	122		70 - 130				01/19/17 14:14	01/22/17 02:14	1
13C2 PFDA	115		70 - 130				01/19/17 14:14	01/22/17 02:14	1

Client Sample Results

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW55-0117

Date Collected: 01/16/17 10:51

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-5

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.015	ug/L		01/19/17 14:14	01/22/17 02:44	1
Perfluorooctanoic acid (PFOA)	0.024	U M	0.030	0.0094	ug/L		01/19/17 14:14	01/22/17 02:44	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L		01/19/17 14:14	01/22/17 02:44	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	124		70 - 130				01/19/17 14:14	01/22/17 02:44	1
13C2 PFDA	122		70 - 130				01/19/17 14:14	01/22/17 02:44	1

Client Sample ID: WI-CV-1FB55-0117

Date Collected: 01/16/17 10:50

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-6

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.061	0.016	ug/L		01/19/17 14:14	01/22/17 03:13	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0095	ug/L		01/19/17 14:14	01/22/17 03:13	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L		01/19/17 14:14	01/22/17 03:13	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	122		70 - 130				01/19/17 14:14	01/22/17 03:13	1
13C2 PFDA	111		70 - 130				01/19/17 14:14	01/22/17 03:13	1

Client Sample ID: WI-CV-1RW56-0117

Date Collected: 01/16/17 12:51

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-7

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.061	0.016	ug/L		01/19/17 14:14	01/22/17 03:43	1
Perfluorooctanoic acid (PFOA)	0.025	U M	0.031	0.0096	ug/L		01/19/17 14:14	01/22/17 03:43	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.049	ug/L		01/19/17 14:14	01/22/17 03:43	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	115		70 - 130				01/19/17 14:14	01/22/17 03:43	1
13C2 PFDA	110		70 - 130				01/19/17 14:14	01/22/17 03:43	1

Client Sample ID: WI-CV-1FB56-0117

Date Collected: 01/16/17 12:50

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-8

Matrix: Water

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.016	ug/L		01/19/17 14:14	01/22/17 04:12	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0094	ug/L		01/19/17 14:14	01/22/17 04:12	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L		01/19/17 14:14	01/22/17 04:12	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	114		70 - 130				01/19/17 14:14	01/22/17 04:12	1
13C2 PFDA	108		70 - 130				01/19/17 14:14	01/22/17 04:12	1

Client Sample Results

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW57-0117

Lab Sample ID: 320-25078-9

Date Collected: 01/16/17 14:26

Matrix: Water

Date Received: 01/18/17 09:25

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.016	ug/L		01/19/17 14:14	01/22/17 04:42	1
Perfluorooctanoic acid (PFOA)	0.024	U M	0.030	0.0094	ug/L		01/19/17 14:14	01/22/17 04:42	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L		01/19/17 14:14	01/22/17 04:42	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	111		70 - 130				01/19/17 14:14	01/22/17 04:42	1
13C2 PFDA	116		70 - 130				01/19/17 14:14	01/22/17 04:42	1

Client Sample ID: WI-CV-1FB57-0117

Lab Sample ID: 320-25078-10

Date Collected: 01/16/17 14:25

Matrix: Water

Date Received: 01/18/17 09:25

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.015	ug/L		01/19/17 14:14	01/22/17 06:11	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0094	ug/L		01/19/17 14:14	01/22/17 06:11	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.047	ug/L		01/19/17 14:14	01/22/17 06:11	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	119		70 - 130				01/19/17 14:14	01/22/17 06:11	1
13C2 PFDA	115		70 - 130				01/19/17 14:14	01/22/17 06:11	1

Client Sample ID: WI-CV-1RW58-0117

Lab Sample ID: 320-25078-11

Date Collected: 01/16/17 14:55

Matrix: Water

Date Received: 01/18/17 09:25

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.062	0.016	ug/L		01/19/17 14:14	01/22/17 06:40	1
Perfluorooctanoic acid (PFOA)	0.025	U	0.031	0.0097	ug/L		01/19/17 14:14	01/22/17 06:40	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.049	ug/L		01/19/17 14:14	01/22/17 06:40	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	112		70 - 130				01/19/17 14:14	01/22/17 06:40	1
13C2 PFDA	108		70 - 130				01/19/17 14:14	01/22/17 06:40	1

Client Sample ID: WI-CV-1FB58-0117

Lab Sample ID: 320-25078-12

Date Collected: 01/16/17 14:54

Matrix: Water

Date Received: 01/18/17 09:25

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Analyte	Result	Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.061	0.016	ug/L		01/19/17 14:14	01/22/17 07:10	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0096	ug/L		01/19/17 14:14	01/22/17 07:10	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L		01/19/17 14:14	01/22/17 07:10	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	122		70 - 130				01/19/17 14:14	01/22/17 07:10	1
13C2 PFDA	111		70 - 130				01/19/17 14:14	01/22/17 07:10	1

Default Detection Limits

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Prep: 537

Analyte	LOQ	DL	Units	Method
Perfluorobutanesulfonic acid (PFBS)	0.14	0.048	ug/L	537
Perfluorooctanesulfonic acid (PFOS)	0.060	0.016	ug/L	537
Perfluorooctanoic acid (PFOA)	0.030	0.0094	ug/L	537

Surrogate Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Matrix: Water

Prep Type: Total/NA

		Percent Surrogate Recovery (Acceptance Limits)	
Lab Sample ID	Client Sample ID	3C2 PFHx (70-130)	3C2 PFD/ (70-130)
320-25078-1	WI-CV-1RW53-0117	112	108
320-25078-2	WI-CV-1FB53-0117	115	108
320-25078-3	WI-CV-1RW54-0117	115	112
320-25078-4	WI-CV-1FB54-0117	122	115
320-25078-5	WI-CV-1RW55-0117	124	122
320-25078-6	WI-CV-1FB55-0117	122	111
320-25078-7	WI-CV-1RW56-0117	115	110
320-25078-8	WI-CV-1FB56-0117	114	108
320-25078-9	WI-CV-1RW57-0117	111	116
320-25078-10	WI-CV-1FB57-0117	119	115
320-25078-11	WI-CV-1RW58-0117	112	108
320-25078-12	WI-CV-1FB58-0117	122	111
LCS 320-147025/2-A	Lab Control Sample	127	122
LCSD 320-147025/3-A	Lab Control Sample Dup	124	125
MB 320-147025/1-A	Method Blank	111	110

Surrogate Legend

13C2 PFHxA = 13C2 PFHxA

13C2 PFDA = 13C2 PFDA

QC Sample Results

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Method: 537 - Perfluorinated Alkyl Acids (LC/MS)

Lab Sample ID: MB 320-147025/1-A

Matrix: Water

Analysis Batch: 147271

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 147025

Analyte	MB Result	MB Qualifier	LOQ	DL	Unit	D	Prepared	Analyzed	Dil Fac
Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.016	ug/L	-	01/19/17 14:14	01/21/17 18:20	1
Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.0094	ug/L	-	01/19/17 14:14	01/21/17 18:20	1
Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.048	ug/L	-	01/19/17 14:14	01/21/17 18:20	1
Surrogate	MB %Recovery	MB Qualifier	Limits				Prepared	Analyzed	Dil Fac
13C2 PFHxA	111		70 - 130				01/19/17 14:14	01/21/17 18:20	1
13C2 PFDA	110		70 - 130				01/19/17 14:14	01/21/17 18:20	1

Lab Sample ID: LCS 320-147025/2-A

Matrix: Water

Analysis Batch: 147271

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 147025

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Perfluorooctanesulfonic acid (PFOS)	0.160	0.158		ug/L	-	99	70 - 130
Perfluorooctanoic acid (PFOA)	0.0781	0.0726		ug/L	-	93	70 - 130
Perfluorobutanesulfonic acid (PFBS)	0.359	0.304		ug/L	-	85	70 - 130
Surrogate	LCS %Recovery	LCS Qualifier	Limits				
13C2 PFHxA	127		70 - 130				
13C2 PFDA	122		70 - 130				

Lab Sample ID: LCSD 320-147025/3-A

Matrix: Water

Analysis Batch: 147271

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Prep Batch: 147025

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Perfluorooctanesulfonic acid (PFOS)	0.160	0.160		ug/L	-	100	70 - 130	1	30
Perfluorooctanoic acid (PFOA)	0.0781	0.0782		ug/L	-	100	70 - 130	7	30
Perfluorobutanesulfonic acid (PFBS)	0.359	0.290		ug/L	-	81	70 - 130	5	30
Surrogate	LCSD %Recovery	LCSD Qualifier	Limits						
13C2 PFHxA	124		70 - 130						
13C2 PFDA	125		70 - 130						

QC Association Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

LCMS

Prep Batch: 147025

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
320-25078-1	WI-CV-1RW53-0117	Total/NA	Water	537	
320-25078-2	WI-CV-1FB53-0117	Total/NA	Water	537	
320-25078-3	WI-CV-1RW54-0117	Total/NA	Water	537	
320-25078-4	WI-CV-1FB54-0117	Total/NA	Water	537	
320-25078-5	WI-CV-1RW55-0117	Total/NA	Water	537	
320-25078-6	WI-CV-1FB55-0117	Total/NA	Water	537	
320-25078-7	WI-CV-1RW56-0117	Total/NA	Water	537	
320-25078-8	WI-CV-1FB56-0117	Total/NA	Water	537	
320-25078-9	WI-CV-1RW57-0117	Total/NA	Water	537	
320-25078-10	WI-CV-1FB57-0117	Total/NA	Water	537	
320-25078-11	WI-CV-1RW58-0117	Total/NA	Water	537	
320-25078-12	WI-CV-1FB58-0117	Total/NA	Water	537	
MB 320-147025/1-A	Method Blank	Total/NA	Water	537	
LCS 320-147025/2-A	Lab Control Sample	Total/NA	Water	537	
LCSD 320-147025/3-A	Lab Control Sample Dup	Total/NA	Water	537	

Analysis Batch: 147271

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
MB 320-147025/1-A	Method Blank	Total/NA	Water	537	147025
LCS 320-147025/2-A	Lab Control Sample	Total/NA	Water	537	147025
LCSD 320-147025/3-A	Lab Control Sample Dup	Total/NA	Water	537	147025

Analysis Batch: 147339

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
320-25078-1	WI-CV-1RW53-0117	Total/NA	Water	537	147025
320-25078-2	WI-CV-1FB53-0117	Total/NA	Water	537	147025
320-25078-3	WI-CV-1RW54-0117	Total/NA	Water	537	147025
320-25078-4	WI-CV-1FB54-0117	Total/NA	Water	537	147025
320-25078-5	WI-CV-1RW55-0117	Total/NA	Water	537	147025
320-25078-6	WI-CV-1FB55-0117	Total/NA	Water	537	147025
320-25078-7	WI-CV-1RW56-0117	Total/NA	Water	537	147025
320-25078-8	WI-CV-1FB56-0117	Total/NA	Water	537	147025
320-25078-9	WI-CV-1RW57-0117	Total/NA	Water	537	147025

Analysis Batch: 147340

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
320-25078-10	WI-CV-1FB57-0117	Total/NA	Water	537	147025
320-25078-11	WI-CV-1RW58-0117	Total/NA	Water	537	147025
320-25078-12	WI-CV-1FB58-0117	Total/NA	Water	537	147025

Lab Chronicle

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW53-0117

Date Collected: 01/16/17 09:17

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-1

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147339	01/22/17 00:45	JRB	TAL SAC

Client Sample ID: WI-CV-1FB53-0117

Date Collected: 01/16/17 09:16

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-2

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147339	01/22/17 01:15	JRB	TAL SAC

Client Sample ID: WI-CV-1RW54-0117

Date Collected: 01/16/17 10:36

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147339	01/22/17 01:44	JRB	TAL SAC

Client Sample ID: WI-CV-1FB54-0117

Date Collected: 01/16/17 10:35

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-4

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147339	01/22/17 02:14	JRB	TAL SAC

Client Sample ID: WI-CV-1RW55-0117

Date Collected: 01/16/17 10:51

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147339	01/22/17 02:44	JRB	TAL SAC

Client Sample ID: WI-CV-1FB55-0117

Date Collected: 01/16/17 10:50

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-6

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147339	01/22/17 03:13	JRB	TAL SAC

TestAmerica Sacramento

Lab Chronicle

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Client Sample ID: WI-CV-1RW56-0117

Date Collected: 01/16/17 12:51

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-7

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147339	01/22/17 03:43	JRB	TAL SAC

Client Sample ID: WI-CV-1FB56-0117

Date Collected: 01/16/17 12:50

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-8

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147339	01/22/17 04:12	JRB	TAL SAC

Client Sample ID: WI-CV-1RW57-0117

Date Collected: 01/16/17 14:26

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-9

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147339	01/22/17 04:42	JRB	TAL SAC

Client Sample ID: WI-CV-1FB57-0117

Date Collected: 01/16/17 14:25

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-10

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147340	01/22/17 06:11	JRB	TAL SAC

Client Sample ID: WI-CV-1RW58-0117

Date Collected: 01/16/17 14:55

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-11

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147340	01/22/17 06:40	JRB	TAL SAC

Client Sample ID: WI-CV-1FB58-0117

Date Collected: 01/16/17 14:54

Date Received: 01/18/17 09:25

Lab Sample ID: 320-25078-12

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	537			147025	01/19/17 14:14	KMK	TAL SAC
Total/NA	Analysis	537		1	147340	01/22/17 07:10	JRB	TAL SAC

TestAmerica Sacramento

Lab Chronicle

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Laboratory References:

TAL SAC = TestAmerica Sacramento, 880 Riverside Parkway, West Sacramento, CA 95605, TEL (916)373-5600

Certification Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Laboratory: TestAmerica Sacramento

Unless otherwise noted, all analytes for this laboratory were covered under each certification below.

Authority	Program	EPA Region	Certification ID	Expiration Date
A2LA	DoD ELAP		2928-01	01-31-17
Analysis Method	Prep Method	Matrix	Analyte	

Method Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Method	Method Description	Protocol	Laboratory
537	Perfluorinated Alkyl Acids (LC/MS)	EPA	TAL SAC

Protocol References:

EPA = US Environmental Protection Agency

Laboratory References:

TAL SAC = TestAmerica Sacramento, 880 Riverside Parkway, West Sacramento, CA 95605, TEL (916)373-5600

Sample Summary

Client: CH2M Hill Constructors, Inc.
Project/Site: Whidbey Island

TestAmerica Job ID: 320-25078-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
320-25078-1	WI-CV-1RW53-0117	Water	01/16/17 09:17	01/18/17 09:25
320-25078-2	WI-CV-1FB53-0117	Water	01/16/17 09:16	01/18/17 09:25
320-25078-3	WI-CV-1RW54-0117	Water	01/16/17 10:36	01/18/17 09:25
320-25078-4	WI-CV-1FB54-0117	Water	01/16/17 10:35	01/18/17 09:25
320-25078-5	WI-CV-1RW55-0117	Water	01/16/17 10:51	01/18/17 09:25
320-25078-6	WI-CV-1FB55-0117	Water	01/16/17 10:50	01/18/17 09:25
320-25078-7	WI-CV-1RW56-0117	Water	01/16/17 12:51	01/18/17 09:25
320-25078-8	WI-CV-1FB56-0117	Water	01/16/17 12:50	01/18/17 09:25
320-25078-9	WI-CV-1RW57-0117	Water	01/16/17 14:26	01/18/17 09:25
320-25078-10	WI-CV-1FB57-0117	Water	01/16/17 14:25	01/18/17 09:25
320-25078-11	WI-CV-1RW58-0117	Water	01/16/17 14:55	01/18/17 09:25
320-25078-12	WI-CV-1FB58-0117	Water	01/16/17 14:54	01/18/17 09:25

LCMS MANUAL INTEGRATION SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1

SDG No.: _____

Instrument ID: A6 Analysis Batch Number: 147198Lab Sample ID: STD 320-147198/3 IC Client Sample ID: _____Date Analyzed: 01/20/17 13:11 Lab File ID: 20JAN2016A6A_005.d GC Column: Acquity ID: 2.1 (mm)

COMPOUND NAME	RETENTION TIME	MANUAL INTEGRATION		
		REASON	ANALYST	DATE
Perfluoroheptanoic acid	19.48	Split Peak	barnettj	01/20/17 14:37
Perfluorooctanoic acid (PFOA)	20.15	Split Peak	barnettj	01/20/17 14:37

Lab Sample ID: STD 320-147198/4 IC Client Sample ID: _____Date Analyzed: 01/20/17 13:41 Lab File ID: 20JAN2016A6A_006.d GC Column: Acquity ID: 2.1 (mm)

COMPOUND NAME	RETENTION TIME	MANUAL INTEGRATION		
		REASON	ANALYST	DATE
Perfluoroheptanoic acid	19.49	Split Peak	barnettj	01/20/17 14:38
Perfluorooctanoic acid (PFOA)	20.17	Split Peak	barnettj	01/20/17 14:38

Lab Sample ID: CCV 320-147198/10 CCVL Client Sample ID: _____Date Analyzed: 01/20/17 16:40 Lab File ID: 20JAN2016A6A_012.d GC Column: Acquity ID: 2.1 (mm)

COMPOUND NAME	RETENTION TIME	MANUAL INTEGRATION		
		REASON	ANALYST	DATE
Perfluoroheptanoic acid	19.47	Baseline	phomsopha t	01/21/17 15:21
Perfluorooctanoic acid (PFOA)	20.15	Baseline	phomsopha t	01/21/17 15:21

LCMS MANUAL INTEGRATION SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1

SDG No.: _____

Instrument ID: A6 Analysis Batch Number: 147339Lab Sample ID: 320-25078-1 Client Sample ID: WI-CV-1RW53-0117Date Analyzed: 01/22/17 00:45 Lab File ID: 20JAN2016A6A_077.d GC Column: Acquity ID: 2.1 (mm)

COMPOUND NAME	RETENTION TIME	MANUAL INTEGRATION		
		REASON	ANALYST	DATE
Perfluorooctanoic acid (PFOA)	20.13	Baseline	barnettj	01/23/17 13:24
Perfluorooctanesulfonic acid (PFOS)	20.77	Missed Peak	barnettj	01/23/17 13:24

Lab Sample ID: 320-25078-5 Client Sample ID: WI-CV-1RW55-0117Date Analyzed: 01/22/17 02:44 Lab File ID: 20JAN2016A6A_081.d GC Column: Acquity ID: 2.1 (mm)

COMPOUND NAME	RETENTION TIME	MANUAL INTEGRATION		
		REASON	ANALYST	DATE
Perfluorooctanoic acid (PFOA)	20.15	Split Peak	barnettj	01/23/17 13:27

Lab Sample ID: 320-25078-7 Client Sample ID: WI-CV-1RW56-0117Date Analyzed: 01/22/17 03:43 Lab File ID: 20JAN2016A6A_083.d GC Column: Acquity ID: 2.1 (mm)

COMPOUND NAME	RETENTION TIME	MANUAL INTEGRATION		
		REASON	ANALYST	DATE
Perfluorooctanoic acid (PFOA)	20.14	Split Peak	barnettj	01/23/17 13:28

Lab Sample ID: 320-25078-9 Client Sample ID: WI-CV-1RW57-0117Date Analyzed: 01/22/17 04:42 Lab File ID: 20JAN2016A6A_085.d GC Column: Acquity ID: 2.1 (mm)

COMPOUND NAME	RETENTION TIME	MANUAL INTEGRATION		
		REASON	ANALYST	DATE
Perfluorooctanoic acid (PFOA)	20.14	Split Peak	barnettj	01/23/17 13:29

REAGENT TRACEABILITY SUMMARY

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Reagent ID	Exp Date	Prep Date	Dilutant Used	Reagent Final Volume	Parent Reagent		Analyte	Concentration
					Reagent ID	Volume Added		
LC537-ICV_00019	03/01/17	12/20/16	MeOH/H2O, Lot 067374	10 mL	LC537-IS_00028	200 uL	13C2-PFOA	10 ng/mL
.LC537-IS_00028	06/19/17	12/19/16	Methanol, Lot 090285	10000 uL	LCM2PFOA_00005	100 uL	13C4 PFOS	28.68 ng/mL
..LCM2PFOA_00005	06/19/18	Wellington Laboratories, Lot M2PFOA0613			LCMPFOS_00018	300 uL	13C2-PFOA	0.5 ug/mL
..LCMPFOS_00018	08/03/21	Wellington Laboratories, Lot MPFOS0816			(Purchased Reagent)		13C4 PFOS	1.434 ug/mL
LC537-ICV_00019	03/01/17	12/20/16	MeOH/H2O, Lot 067374	10 mL	LC537-SU_00027	500 uL	13C2-PFOA	50 ug/mL
					LC537ICIM_00014	25 uL	13C2 PFDA	47.8 ug/mL
							13C2 PFHxA	10 ng/mL
							Perfluorobutanesulfonic acid (PFBS)	114.77 ng/mL
							Perfluorooctanoic acid (PFOA)	25.0232 ng/mL
							Perfluorooctanesulfonic acid (PFOS)	27.2389 ng/mL
.LC537-SU_00027	06/19/17	12/19/16	Methanol, Lot 104453	20000 uL	LCMPFDA_00008	80 uL	13C2 PFDA	0.2 ug/mL
..LCMPFDA_00008	08/19/20	Wellington Laboratories, Lot MPFDA0815			LCMPFHxA_00009	80 uL	13C2 PFHxA	0.2 ug/mL
..LCMPFHxA_00009	04/09/20	Wellington Laboratories, Lot MPFHxA0415			(Purchased Reagent)		13C2 PFDA	50 ug/mL
.LC537ICIM_00014	03/01/17	12/20/16	Methanol, Lot 090285	25 mL	LC537-PFBS2_00005	0.5 mL	13C2 PFHxA	50 ug/mL
					LC537-PFOA2_00008	0.142 mL	Perfluorobutanesulfonic acid (PFBS)	45.908 ug/mL
					LC537-PFOS2_00005	0.22 mL	Perfluorooctanoic acid (PFOA)	10.0093 ug/mL
..LC537-PFBS2_00005	03/01/17	02/29/16	Methanol, Lot 090285	10 mL	LC537_PFBS2_00001	0.023 g	Perfluorooctanesulfonic acid (PFOS)	10.8956 ug/mL
...LC537_PFBS2_00001	08/09/17	Santa Cruz Biotechnology, Lot H0112			(Purchased Reagent)		Perfluorobutanesulfonic acid (PFBS)	2295.4 ug/mL
..LC537-PFOA2_00008	07/25/17	12/20/16	Methanol, Lot 090285	10 mL	LC537_PFOA2_00001	0.0178 g	Perfluorooctanoic acid (PFOA)	0.998 g/g
...LC537_PFOA2_00001	07/25/17	Afla Aesar, Lot D24Y026			(Purchased Reagent)		Perfluorooctanoic acid (PFOA)	1762.2 ug/mL
..LC537-PFOS2_00005	03/01/17	02/29/16	Methanol, Lot 090285	10 mL	LC537_PFOS2_00001	0.0159 g	Perfluorooctanoic acid (PFOA)	0.99 g/g
...LC537_PFOS2_00001	07/26/17	Sigma, Lot BCBF5116V			(Purchased Reagent)		Perfluorooctanesulfonic acid (PFOS)	1238.13 ug/mL
LC537-IS_00030	07/17/17	01/17/17	Methanol, Lot 090285	10000 uL	LCM2PFOA_00005	100 uL	Perfluorooctanesulfonic acid (PFOS)	0.7787 g/g
.LCM2PFOA_00005	06/19/18	Wellington Laboratories, Lot M2PFOA0613			LCMPFOS_00018	300 uL	13C2-PFOA	0.5 ug/mL
..LCMPFOS_00018	08/03/21	Wellington Laboratories, Lot MPFOS0816			(Purchased Reagent)		13C4 PFOS	1.434 ug/mL
LC537-L1_00017	06/14/17	12/23/16	MeOH/H2O, Lot 090285	5 mL	LC537-IS_00028	100 uL	13C2-PFOA	50 ug/mL
					LC537-MSP_00017	25 uL	13C4 PFOS	47.8 ug/mL
							Perfluorobutanesulfonic acid (PFBS)	28.68 ng/mL
							Perfluoroheptanoic acid	8.976 ng/mL
							Perfluorohexanesulfonic acid	0.99 ng/mL
							Perfluorononanoic acid	3.02582 ng/mL
							Perfluorooctanoic acid (PFOA)	2.07415 ng/mL
							Perfluorooctanesulfonic acid (PFOS)	1.95189 ng/mL
					LC537-SU_00026	250 uL	13C2 PFDA	4.00664 ng/mL
							13C2 PFHxA	10 ng/mL
								10 ng/mL

REAGENT TRACEABILITY SUMMARY

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Reagent ID	Exp Date	Prep Date	Dilutant Used	Reagent Final Volume	Parent Reagent		Analyte	Concentration
					Reagent ID	Volume Added		
.LC537-IS_00028	06/19/17	12/19/16	Methanol, Lot 090285	10000 uL	LCM2PFOA_00005	100 uL	13C2-PFOA	0.5 ug/mL
..LCM2PFOA_00005	06/19/18	Wellington Laboratories, Lot M2PFOA0613			(Purchased Reagent)		13C2-PFOA	50 ug/mL
..LCMPFOS_00018	08/03/21	Wellington Laboratories, Lot MPFOS0816			(Purchased Reagent)		13C4 PFOS	47.8 ug/mL
.LC537-MSP_00017	06/22/17	12/22/16	Methanol, Lot 090285	10000 uL	LC537SPIM_00018	200 uL	Perfluorobutanesulfonic acid (PFBS)	1795.2 ng/mL
							Perfluoroheptanoic acid	198 ng/mL
							Perfluorohexanesulfonic acid	605.164 ng/mL
							Perfluorononanoic acid	414.831 ng/mL
							Perfluorooctanoic acid (PFOA)	390.378 ng/mL
							Perfluorooctanesulfonic acid (PFOS)	801.328 ng/mL
..LC537SPIM_00018	06/22/17	12/22/16	Methanol, Lot 104453	10000 uL	LC537-PFBS_00006	440 uL	Perfluorobutanesulfonic acid (PFBS)	89.76 ug/mL
					LC537-PFHpa_00013	100 uL	Perfluoroheptanoic acid	9.9 ug/mL
					LC537-PFHxS_00008	300 uL	Perfluorohexanesulfonic acid	30.2582 ug/mL
					LC537-PFNA_00011	200 uL	Perfluorononanoic acid	20.7415 ug/mL
					LC537-PFOA_00011	100 uL	Perfluorooctanoic acid (PFOA)	19.5189 ug/mL
					LC537-PFOS_00006	400 uL	Perfluorooctanesulfonic acid (PFOS)	40.0664 ug/mL
...LC537-PFBS_00006	07/28/17	07/28/16	Methanol, Lot 090285	5 mL	LC537_PFBS_00002	0.0102 g	Perfluorobutanesulfonic acid (PFBS)	2040 ug/mL
....LC537_PFBS_00002	04/01/18	Sigma, Lot MKBP8842V			(Purchased Reagent)		Perfluorobutanesulfonic acid (PFBS)	1 g/g
...LC537-PFHpa_00013	06/22/17	12/22/16	Methanol, Lot 090285	56.8 mL	LC537_PFHpa_00002	0.0568 g	Perfluoroheptanoic acid	990 ug/mL
....LC537_PFHpa_00002	04/01/18	Aldrich, Lot BCM2579V			(Purchased Reagent)		Perfluoroheptanoic acid	0.99 g/g
...LC537-PFHxS_00008	07/28/17	07/28/16	Methanol, Lot 090285	5.5 mL	LC537_PFHxS_00002	0.0061 g	Perfluorohexanesulfonic acid	1008.61 ug/mL
....LC537_PFHxS_00002	04/01/18	Sigma, Lot BCBL3545V			(Purchased Reagent)		Perfluorohexanesulfonic acid	0.9094 g/g
...LC537-PFNA_00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537_PFNA_00002	0.007 g	Perfluorononanoic acid	1037.08 ug/mL
....LC537_PFNA_00002	04/01/18	TCI America, Lot QN44F			(Purchased Reagent)		Perfluorononanoic acid	0.963 g/g
...LC537-PFOA_00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537_PFOA_00002	0.0127 g	Perfluorooctanoic acid (PFOA)	1951.89 ug/mL
....LC537_PFOA_00002	11/04/18	Fluka, Lot SZBD308XV			(Purchased Reagent)		Perfluorooctanoic acid (PFOA)	0.999 g/g
...LC537-PFOS_00006	07/28/17	07/28/16	Methanol, Lot 090285	6 mL	LC537_PFOS_00002	0.0066 g	Perfluorooctanesulfonic acid (PFOS)	1001.66 ug/mL
....LC537_PFOS_00002	08/09/17	Fluka, Lot SZBC222XV			(Purchased Reagent)		Perfluorooctanesulfonic acid (PFOS)	0.9106 g/g
.LC537-SU_00026	06/14/17	12/16/16	Methanol, Lot 104453	20000 uL	LC537-SU_00025	10000 uL	13C2 PFDA	0.2 ug/mL
							13C2 PFHxA	0.2 ug/mL
..LC537-SU_00025	06/14/17	12/14/16	Methanol, Lot 104453	10000 uL	LCMPFDA_00008	80 uL	13C2 PFDA	0.4 ug/mL
					LCMPFHxA_00009	80 uL	13C2 PFHxA	0.4 ug/mL
...LCMPFDA_00008	08/19/20	Wellington Laboratories, Lot MPFDA0815			(Purchased Reagent)		13C2 PFDA	50 ug/mL
...LCMPFHxA_00009	04/09/20	Wellington Laboratories, Lot MPFHxA0415			(Purchased Reagent)		13C2 PFHxA	50 ug/mL
LC537-L2_00016	06/14/17	12/23/16	MeOH/H2O, Lot 090285	5 mL	LC537-HSP_00014	34 uL	Perfluorobutanesulfonic acid (PFBS)	22.8888 ng/mL
							Perfluoroheptanoic acid	2.5245 ng/mL
							Perfluorohexanesulfonic acid	7.71585 ng/mL
							Perfluorononanoic acid	5.28909 ng/mL
							Perfluorooctanoic acid (PFOA)	4.97733 ng/mL

REAGENT TRACEABILITY SUMMARY

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Reagent ID	Exp Date	Prep Date	Dilutant Used	Reagent Final Volume	Parent Reagent		Analyte	Concentration
					Reagent ID	Volume Added		
							Perfluorooctanesulfonic acid (PFOS)	10.2169 ng/mL
					LC537-IS_00028	100 uL	13C2-PFOA	10 ng/mL
							13C4 PFOS	28.68 ng/mL
					LC537-SU_00026	250 uL	13C2 PFDA	10 ng/mL
.LC537-HSP_00014	06/22/17	12/22/16	Methanol, Lot 090285	10000 uL	LC537SPIM_00018	375 uL	13C2 PFHxA	10 ng/mL
							Perfluorobutanesulfonic acid (PFBS)	3366 ng/mL
							Perfluoroheptanoic acid	371.25 ng/mL
							Perfluorohexanesulfonic acid	1134.68 ng/mL
							Perfluorononanoic acid	777.808 ng/mL
..LC537SPIM_00018	06/22/17	12/22/16	Methanol, Lot 104453	10000 uL	LC537-PFBS_00006	440 uL	Perfluorooctanoic acid (PFOA)	731.96 ng/mL
							Perfluorooctanesulfonic acid (PFOS)	1502.49 ng/mL
							Perfluorobutanesulfonic acid (PFBS)	89.76 ug/mL
							Perfluoroheptanoic acid	9.9 ug/mL
							Perfluorohexanesulfonic acid	30.2582 ug/mL
...LC537-PFBS_00006	07/28/17	07/28/16	Methanol, Lot 090285	5 mL	LC537-PFNA_00011	200 uL	Perfluorononanoic acid	20.7415 ug/mL
							Perfluorooctanoic acid (PFOA)	19.5189 ug/mL
							Perfluorooctanesulfonic acid (PFOS)	40.0664 ug/mL
							Perfluorobutanesulfonic acid (PFBS)	2040 ug/mL
							Perfluoroheptanoic acid	990 ug/mL
....LC537-PFHxA_00002	04/01/18		Sigma, Lot MKBP8842V		(Purchased Reagent)		Perfluorobutanesulfonic acid (PFBS)	1 g/g
...LC537-PFHxA_00013	06/22/17	12/22/16	Methanol, Lot 090285	56.8 mL	LC537 PFHxA_00002	0.0568 g	Perfluoroheptanoic acid	0.99 g/g
....LC537 PFHxA_00002	04/01/18		Aldrich, Lot BCM2579V		(Purchased Reagent)		Perfluorohexanesulfonic acid	1008.61 ug/mL
...LC537-PFHxS_00008	07/28/17	07/28/16	Methanol, Lot 090285	5.5 mL	LC537 PFHxS_00002	0.0061 g	Perfluorohexanesulfonic acid	0.9094 g/g
....LC537 PFHxS_00002	04/01/18		Sigma, Lot BCBL3545V		(Purchased Reagent)		Perfluorononanoic acid	1037.08 ug/mL
...LC537-PFNA_00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFNA_00002	0.007 g	Perfluorononanoic acid	0.963 g/g
....LC537 PFNA_00002	04/01/18		TCI America, Lot QN44F		(Purchased Reagent)		Perfluorooctanoic acid (PFOA)	1951.89 ug/mL
...LC537-PFOA_00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFOA_00002	0.0127 g	Perfluorooctanoic acid (PFOA)	0.999 g/g
....LC537 PFOA_00002	11/04/18		Fluka, Lot SZBD308XV		(Purchased Reagent)		Perfluorooctanesulfonic acid (PFOS)	1001.66 ug/mL
...LC537-PFOS_00006	07/28/17	07/28/16	Methanol, Lot 090285	6 mL	LC537 PFOS_00002	0.0066 g	Perfluorooctanesulfonic acid (PFOS)	0.9106 g/g
....LC537 PFOS_00002	08/09/17		Fluka, Lot SZBC222XV		(Purchased Reagent)		13C2-PFOA	0.5 ug/mL
.LC537-IS_00028	06/19/17	12/19/16	Methanol, Lot 090285	10000 uL	LCM2PFOA_00005	100 uL	13C4 PFOS	1.434 ug/mL
..LCM2PFOA_00005	06/19/18		Wellington Laboratories, Lot M2PFOA0613		LCMPFOS_00018	300 uL	13C2-PFOA	50 ug/mL
..LCMPFOS_00018	08/03/21		Wellington Laboratories, Lot MPFOS0816		(Purchased Reagent)		13C4 PFOS	47.8 ug/mL
.LC537-SU_00026	06/14/17	12/16/16	Methanol, Lot 104453	20000 uL	LC537-SU_00025	10000 uL	13C2 PFDA	0.2 ug/mL
..LC537-SU_00025	06/14/17	12/14/16	Methanol, Lot 104453	10000 uL	LCMPFDA_00008	80 uL	13C2 PFHxA	0.2 ug/mL
...LCMPFDA_00008	08/19/20		Wellington Laboratories, Lot MPFDA0815		LCMPFHxA_00009	80 uL	13C2 PFDA	0.4 ug/mL
...LCMPFHxA_00009	04/09/20		Wellington Laboratories, Lot MPFHxA0415		(Purchased Reagent)		13C2 PFHxA	0.4 ug/mL
							13C2 PFHxA	50 ug/mL

REAGENT TRACEABILITY SUMMARY

 Lab Name: TestAmerica Sacramento

 Job No.: 320-25078-1

SDG No.: _____

Reagent ID	Exp Date	Prep Date	Dilutant Used	Reagent Final Volume	Parent Reagent		Analyte	Concentration		
					Reagent ID	Volume Added				
LC537-L3_00018	06/14/17	12/23/16	MeOH/H2O, Lot 090285	5 mL	LC537-HSP_00014	67 uL	Perfluorobutanesulfonic acid (PFBS)	45.1044 ng/mL		
							Perfluoroheptanoic acid	4.97475 ng/mL		
							Perfluorohexanesulfonic acid	15.2048 ng/mL		
							Perfluorononanoic acid	10.4226 ng/mL		
							Perfluorooctanoic acid (PFOA)	9.80826 ng/mL		
							Perfluorooctanesulfonic acid (PFOS)	20.1334 ng/mL		
					LC537-IS_00028	100 uL	13C2-PFOA	10 ng/mL		
							13C4 PFOS	28.68 ng/mL		
					LC537-SU_00026	250 uL	13C2 PFDA	10 ng/mL		
13C2 PFHxA	10 ng/mL									
.LC537-HSP_00014	06/22/17	12/22/16	Methanol, Lot 090285	10000 uL	LC537SPIM_00018	375 uL	Perfluorobutanesulfonic acid (PFBS)	3366 ng/mL		
							Perfluoroheptanoic acid	371.25 ng/mL		
							Perfluorohexanesulfonic acid	1134.68 ng/mL		
							Perfluorononanoic acid	777.808 ng/mL		
							Perfluorooctanoic acid (PFOA)	731.96 ng/mL		
							Perfluorooctanesulfonic acid (PFOS)	1502.49 ng/mL		
..LC537SPIM_00018	06/22/17	12/22/16	Methanol, Lot 104453	10000 uL	LC537-PFBS_00006	440 uL	Perfluorobutanesulfonic acid (PFBS)	89.76 ug/mL		
							LC537-PFHpA_00013	100 uL	Perfluoroheptanoic acid	9.9 ug/mL
							LC537-PFHxS_00008	300 uL	Perfluorohexanesulfonic acid	30.2582 ug/mL
							LC537-PFNA_00011	200 uL	Perfluorononanoic acid	20.7415 ug/mL
							LC537-PFOA_00011	100 uL	Perfluorooctanoic acid (PFOA)	19.5189 ug/mL
							LC537-PFOS_00006	400 uL	Perfluorooctanesulfonic acid (PFOS)	40.0664 ug/mL
...LC537-PFBS_00006	07/28/17	07/28/16	Methanol, Lot 090285	5 mL	LC537_PFBS_00002	0.0102 g	Perfluorobutanesulfonic acid (PFBS)	2040 ug/mL		
....LC537_PFBS_00002	04/01/18	Sigma, Lot MKBP8842V			(Purchased Reagent)		Perfluorobutanesulfonic acid (PFBS)	1 g/g		
...LC537-PFHpA_00013	06/22/17	12/22/16	Methanol, Lot 090285	56.8 mL	LC537 PFHpA_00002	0.0568 g	Perfluoroheptanoic acid	990 ug/mL		
....LC537 PFHpA_00002	04/01/18	Aldrich, Lot BCM2579V			(Purchased Reagent)		Perfluoroheptanoic acid	0.99 g/g		
...LC537-PFHxS_00008	07/28/17	07/28/16	Methanol, Lot 090285	5.5 mL	LC537 PFHxS_00002	0.0061 g	Perfluorohexanesulfonic acid	1008.61 ug/mL		
....LC537 PFHxS_00002	04/01/18	Sigma, Lot BCBL3545V			(Purchased Reagent)		Perfluorohexanesulfonic acid	0.9094 g/g		
...LC537-PFNA_00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFNA_00002	0.007 g	Perfluorononanoic acid	1037.08 ug/mL		
....LC537 PFNA_00002	04/01/18	TCI America, Lot QN44F			(Purchased Reagent)		Perfluorononanoic acid	0.963 g/g		
...LC537-PFOA_00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFOA_00002	0.0127 g	Perfluorooctanoic acid (PFOA)	1951.89 ug/mL		
....LC537 PFOA_00002	11/04/18	Fluka, Lot SZBD308XV			(Purchased Reagent)		Perfluorooctanoic acid (PFOA)	0.999 g/g		
...LC537-PFOS_00006	07/28/17	07/28/16	Methanol, Lot 090285	6 mL	LC537_PFOS_00002	0.0066 g	Perfluorooctanesulfonic acid (PFOS)	1001.66 ug/mL		
....LC537_PFOS_00002	08/09/17	Fluka, Lot SZBC222XV			(Purchased Reagent)		Perfluorooctanesulfonic acid (PFOS)	0.9106 g/g		
.LC537-IS_00028	06/19/17	12/19/16	Methanol, Lot 090285	10000 uL	LCM2PFOA_00005	100 uL	13C2-PFOA	0.5 ug/mL		
					LCMPFOS_00018	300 uL	13C4 PFOS	1.434 ug/mL		
..LCM2PFOA_00005	06/19/18	Wellington Laboratories, Lot M2PFOA0613			(Purchased Reagent)		13C2-PFOA	50 ug/mL		
..LCMPFOS_00018	08/03/21	Wellington Laboratories, Lot MPFOS0816			(Purchased Reagent)		13C4 PFOS	47.8 ug/mL		
.LC537-SU_00026	06/14/17	12/16/16	Methanol, Lot 104453	20000 uL	LC537-SU_00025	10000 uL	13C2 PFDA	0.2 ug/mL		

REAGENT TRACEABILITY SUMMARY

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Reagent ID	Exp Date	Prep Date	Dilutant Used	Reagent Final Volume	Parent Reagent		Analyte	Concentration			
					Reagent ID	Volume Added					
							13C2 PFHxA	0.2 ug/mL			
..LC537-SU_00025	06/14/17	12/14/16	Methanol, Lot 104453	10000 uL	LCMPFDA_00008	80 uL	13C2 PFDA	0.4 ug/mL			
					LCMPFHxA_00009	80 uL	13C2 PFHxA	0.4 ug/mL			
...LCMPFDA_00008	08/19/20	Wellington Laboratories, Lot MPFDA0815			(Purchased Reagent)		13C2 PFDA	50 ug/mL			
...LCMPFHxA_00009	04/09/20	Wellington Laboratories, Lot MPFHxA0415			(Purchased Reagent)		13C2 PFHxA	50 ug/mL			
LC537-L4_00017	06/14/17	12/23/16	MeOH/H2O, Lot 090285	5 mL	LC537-HSP_00014	135 uL	Perfluorobutanesulfonic acid (PFBS)	90.882 ng/mL			
							Perfluoroheptanoic acid	10.0238 ng/mL			
							Perfluorohexanesulfonic acid	30.6364 ng/mL			
							Perfluorononanoic acid	21.0008 ng/mL			
							Perfluorooctanoic acid (PFOA)	19.7629 ng/mL			
								Perfluorooctanesulfonic acid (PFOS)	40.5672 ng/mL		
								LC537-IS_00028	100 uL	13C2-PFOA	10 ng/mL
										13C4 PFOS	28.68 ng/mL
								LC537-SU_00026	250 uL	13C2 PFDA	10 ng/mL
					13C2 PFHxA	10 ng/mL					
.LC537-HSP_00014	06/22/17	12/22/16	Methanol, Lot 090285	10000 uL	LC537SPIM_00018	375 uL	Perfluorobutanesulfonic acid (PFBS)	3366 ng/mL			
							Perfluoroheptanoic acid	371.25 ng/mL			
							Perfluorohexanesulfonic acid	1134.68 ng/mL			
							Perfluorononanoic acid	777.808 ng/mL			
							Perfluorooctanoic acid (PFOA)	731.96 ng/mL			
							Perfluorooctanesulfonic acid (PFOS)	1502.49 ng/mL			
..LC537SPIM_00018	06/22/17	12/22/16	Methanol, Lot 104453	10000 uL	LC537-PFBS_00006	440 uL	Perfluorobutanesulfonic acid (PFBS)	89.76 ug/mL			
							LC537-PFHpA_00013	100 uL	Perfluoroheptanoic acid	9.9 ug/mL	
							LC537-PFHxS_00008	300 uL	Perfluorohexanesulfonic acid	30.2582 ug/mL	
							LC537-PFNA_00011	200 uL	Perfluorononanoic acid	20.7415 ug/mL	
							LC537-PFOA_00011	100 uL	Perfluorooctanoic acid (PFOA)	19.5189 ug/mL	
							LC537-PFOS_00006	400 uL	Perfluorooctanesulfonic acid (PFOS)	40.0664 ug/mL	
...LC537-PFBS_00006	07/28/17	07/28/16	Methanol, Lot 090285	5 mL	LC537_PFBS_00002	0.0102 g	Perfluorobutanesulfonic acid (PFBS)	2040 ug/mL			
....LC537_PFBS_00002	04/01/18	Sigma, Lot MKBP8842V			(Purchased Reagent)		Perfluorobutanesulfonic acid (PFBS)	1 g/g			
...LC537-PFHpA_00013	06/22/17	12/22/16	Methanol, Lot 090285	56.8 mL	LC537 PFHpA_00002	0.0568 g	Perfluoroheptanoic acid	990 ug/mL			
....LC537 PFHpA_00002	04/01/18	Aldrich, Lot BCM2579V			(Purchased Reagent)		Perfluoroheptanoic acid	0.99 g/g			
...LC537-PFHxS_00008	07/28/17	07/28/16	Methanol, Lot 090285	5.5 mL	LC537 PFHxS_00002	0.0061 g	Perfluorohexanesulfonic acid	1008.61 ug/mL			
....LC537 PFHxS_00002	04/01/18	Sigma, Lot BCBL3545V			(Purchased Reagent)		Perfluorohexanesulfonic acid	0.9094 g/g			
...LC537-PFNA_00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFNA_00002	0.007 g	Perfluorononanoic acid	1037.08 ug/mL			
....LC537 PFNA_00002	04/01/18	TCI America, Lot QN44F			(Purchased Reagent)		Perfluorononanoic acid	0.963 g/g			
...LC537-PFOA_00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFOA_00002	0.0127 g	Perfluorooctanoic acid (PFOA)	1951.89 ug/mL			
....LC537 PFOA_00002	11/04/18	Fluka, Lot SZBD308XV			(Purchased Reagent)		Perfluorooctanoic acid (PFOA)	0.999 g/g			
...LC537-PFOS_00006	07/28/17	07/28/16	Methanol, Lot 090285	6 mL	LC537_PFOS_00002	0.0066 g	Perfluorooctanesulfonic acid (PFOS)	1001.66 ug/mL			
....LC537_PFOS_00002	08/09/17	Fluka, Lot SZBC222XV			(Purchased Reagent)		Perfluorooctanesulfonic acid (PFOS)	0.9106 g/g			

REAGENT TRACEABILITY SUMMARY

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Reagent ID	Exp Date	Prep Date	Dilutant Used	Reagent Final Volume	Parent Reagent		Analyte	Concentration
					Reagent ID	Volume Added		
.LC537-IS_00028	06/19/17	12/19/16	Methanol, Lot 090285	10000 uL	LCM2PFOA_00005	100 uL	13C2-PFOA	0.5 ug/mL
..LCM2PFOA_00005	06/19/18	Wellington Laboratories, Lot M2PFOA0613			LCMPFOS_00018	300 uL	13C4 PFOS	1.434 ug/mL
..LCMPFOS_00018	08/03/21	Wellington Laboratories, Lot MPFOS0816			(Purchased Reagent)		13C2-PFOA	50 ug/mL
.LC537-SU_00026	06/14/17	12/16/16	Methanol, Lot 104453	20000 uL	(Purchased Reagent)		13C4 PFOS	47.8 ug/mL
..LC537-SU_00025	06/14/17	12/14/16	Methanol, Lot 104453	10000 uL	LC537-SU_00025	10000 uL	13C2 PFDA	0.2 ug/mL
...LCMPFDA_00008	08/19/20	Wellington Laboratories, Lot MPFDA0815			LCMPFDA_00008	80 uL	13C2 PFHxA	0.2 ug/mL
...LCMPFHxA_00009	04/09/20	Wellington Laboratories, Lot MPFHxA0415			LCMPFHxA_00009	80 uL	13C2 PFDA	0.4 ug/mL
					(Purchased Reagent)		13C2 PFHxA	0.4 ug/mL
					(Purchased Reagent)		13C2 PFDA	50 ug/mL
					(Purchased Reagent)		13C2 PFHxA	50 ug/mL
LC537-L5_00019	06/14/17	12/23/16	MeOH/H2O, Lot 090285	5 mL	LC537-HSP_00014	200 uL	Perfluorobutanesulfonic acid (PFBS)	134.64 ng/mL
							Perfluoroheptanoic acid	14.85 ng/mL
							Perfluorohexanesulfonic acid	45.3873 ng/mL
							Perfluorononanoic acid	31.1123 ng/mL
							Perfluorooctanoic acid (PFOA)	29.2784 ng/mL
							Perfluorooctanesulfonic acid (PFOS)	60.0996 ng/mL
					LC537-IS_00028	100 uL	13C2-PFOA	10 ng/mL
					LC537-SU_00026	250 uL	13C4 PFOS	28.68 ng/mL
							13C2 PFDA	10 ng/mL
							13C2 PFHxA	10 ng/mL
.LC537-HSP_00014	06/22/17	12/22/16	Methanol, Lot 090285	10000 uL	LC537SPIM_00018	375 uL	Perfluorobutanesulfonic acid (PFBS)	3366 ng/mL
							Perfluoroheptanoic acid	371.25 ng/mL
							Perfluorohexanesulfonic acid	1134.68 ng/mL
							Perfluorononanoic acid	777.808 ng/mL
							Perfluorooctanoic acid (PFOA)	731.96 ng/mL
							Perfluorooctanesulfonic acid (PFOS)	1502.49 ng/mL
..LC537SPIM_00018	06/22/17	12/22/16	Methanol, Lot 104453	10000 uL	LC537-PFBS_00006	440 uL	Perfluorobutanesulfonic acid (PFBS)	89.76 ug/mL
					LC537-PFHpA_00013	100 uL	Perfluoroheptanoic acid	9.9 ug/mL
					LC537-PFHxS_00008	300 uL	Perfluorohexanesulfonic acid	30.2582 ug/mL
					LC537-PFNA_00011	200 uL	Perfluorononanoic acid	20.7415 ug/mL
					LC537-PFOA_00011	100 uL	Perfluorooctanoic acid (PFOA)	19.5189 ug/mL
					LC537-PFOS_00006	400 uL	Perfluorooctanesulfonic acid (PFOS)	40.0664 ug/mL
...LC537-PFBS_00006	07/28/17	07/28/16	Methanol, Lot 090285	5 mL	LC537_PFBS_00002	0.0102 g	Perfluorobutanesulfonic acid (PFBS)	2040 ug/mL
....LC537_PFBS_00002	04/01/18	Sigma, Lot MKBP8842V			(Purchased Reagent)		Perfluorobutanesulfonic acid (PFBS)	1 g/g
...LC537-PFHpA_00013	06/22/17	12/22/16	Methanol, Lot 090285	56.8 mL	LC537 PFHpA_00002	0.0568 g	Perfluoroheptanoic acid	990 ug/mL
....LC537 PFHpA_00002	04/01/18	Aldrich, Lot BCM2579V			(Purchased Reagent)		Perfluoroheptanoic acid	0.99 g/g
...LC537-PFHxS_00008	07/28/17	07/28/16	Methanol, Lot 090285	5.5 mL	LC537 PFHxS_00002	0.0061 g	Perfluorohexanesulfonic acid	1008.61 ug/mL
....LC537 PFHxS_00002	04/01/18	Sigma, Lot BCBL3545V			(Purchased Reagent)		Perfluorohexanesulfonic acid	0.9094 g/g
...LC537-PFNA_00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFNA_00002	0.007 g	Perfluorononanoic acid	1037.08 ug/mL
....LC537 PFNA_00002	04/01/18	TCI America, Lot QN44F			(Purchased Reagent)		Perfluorononanoic acid	0.963 g/g

REAGENT TRACEABILITY SUMMARY

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Reagent ID	Exp Date	Prep Date	Dilutant Used	Reagent Final Volume	Parent Reagent		Analyte	Concentration
					Reagent ID	Volume Added		
...LC537-PFOA_00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537_PFOA_00002	0.0127 g	Perfluorooctanoic acid (PFOA)	1951.89 ug/mL
....LC537_PFOA_00002	11/04/18		Fluka, Lot SZBD308XV		(Purchased Reagent)		Perfluorooctanoic acid (PFOA)	0.999 g/g
...LC537-PFOS_00006	07/28/17	07/28/16	Methanol, Lot 090285	6 mL	LC537_PFOS_00002	0.0066 g	Perfluorooctanesulfonic acid (PFOS)	1001.66 ug/mL
....LC537_PFOS_00002	08/09/17		Fluka, Lot SZBC222XV		(Purchased Reagent)		Perfluorooctanesulfonic acid (PFOS)	0.9106 g/g
.LC537-IS_00028	06/19/17	12/19/16	Methanol, Lot 090285	10000 uL	LCM2PFOA_00005	100 uL	13C2-PFOA	0.5 ug/mL
..LCM2PFOA_00005	06/19/18		Wellington Laboratories, Lot M2PFOA0613		LCMPFOS_00018	300 uL	13C4 PFOS	1.434 ug/mL
..LCMPFOS_00018	08/03/21		Wellington Laboratories, Lot MPFOS0816		(Purchased Reagent)		13C2-PFOA	50 ug/mL
.LC537-SU_00026	06/14/17	12/16/16	Methanol, Lot 104453	20000 uL	(Purchased Reagent)		13C4 PFOS	47.8 ug/mL
..LC537-SU_00025	06/14/17	12/14/16	Methanol, Lot 104453	10000 uL	LC537-SU_00025	10000 uL	13C2 PFDA	0.2 ug/mL
...LCMPFDA_00008	08/19/20		Wellington Laboratories, Lot MPFDA0815		LCMPFDA_00008	80 uL	13C2 PFHxA	0.2 ug/mL
...LCMPFHxA_00009	04/09/20		Wellington Laboratories, Lot MPFHxA0415		LCMPFHxA_00009	80 uL	13C2 PFDA	0.4 ug/mL
					(Purchased Reagent)		13C2 PFHxA	50 ug/mL
LC537-L6_00016	06/14/17	12/23/16	MeOH/H2O, Lot 090285	5 mL	LC537-HSP_00014	265 uL	Perfluorobutanesulfonic acid (PFBS)	178.398 ng/mL
							Perfluoroheptanoic acid	19.6763 ng/mL
							Perfluorohexanesulfonic acid	60.1382 ng/mL
							Perfluorononanoic acid	41.2238 ng/mL
							Perfluorooctanoic acid (PFOA)	38.7939 ng/mL
							Perfluorooctanesulfonic acid (PFOS)	79.632 ng/mL
					LC537-IS_00028	100 uL	13C2-PFOA	10 ng/mL
							13C4 PFOS	28.68 ng/mL
					LC537-SU_00026	250 uL	13C2 PFDA	10 ng/mL
							13C2 PFHxA	10 ng/mL
.LC537-HSP_00014	06/22/17	12/22/16	Methanol, Lot 090285	10000 uL	LC537SPIM_00018	375 uL	Perfluorobutanesulfonic acid (PFBS)	3366 ng/mL
							Perfluoroheptanoic acid	371.25 ng/mL
							Perfluorohexanesulfonic acid	1134.68 ng/mL
							Perfluorononanoic acid	777.808 ng/mL
							Perfluorooctanoic acid (PFOA)	731.96 ng/mL
							Perfluorooctanesulfonic acid (PFOS)	1502.49 ng/mL
..LC537SPIM_00018	06/22/17	12/22/16	Methanol, Lot 104453	10000 uL	LC537-PFBS_00006	440 uL	Perfluorobutanesulfonic acid (PFBS)	89.76 ug/mL
					LC537-PFHxA_00013	100 uL	Perfluoroheptanoic acid	9.9 ug/mL
					LC537-PFHxS_00008	300 uL	Perfluorohexanesulfonic acid	30.2582 ug/mL
					LC537-PFNA_00011	200 uL	Perfluorononanoic acid	20.7415 ug/mL
					LC537-PFOA_00011	100 uL	Perfluorooctanoic acid (PFOA)	19.5189 ug/mL
					LC537-PFOS_00006	400 uL	Perfluorooctanesulfonic acid (PFOS)	40.0664 ug/mL
...LC537-PFBS_00006	07/28/17	07/28/16	Methanol, Lot 090285	5 mL	LC537_PFBS_00002	0.0102 g	Perfluorobutanesulfonic acid (PFBS)	2040 ug/mL
....LC537_PFBS_00002	04/01/18		Sigma, Lot MKBP8842V		(Purchased Reagent)		Perfluorobutanesulfonic acid (PFBS)	1 g/g
...LC537-PFHxA_00013	06/22/17	12/22/16	Methanol, Lot 090285	56.8 mL	LC537_PFHxA_00002	0.0568 g	Perfluoroheptanoic acid	990 ug/mL

REAGENT TRACEABILITY SUMMARY

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Reagent ID	Exp Date	Prep Date	Dilutant Used	Reagent Final Volume	Parent Reagent		Analyte	Concentration
					Reagent ID	Volume Added		
....LC537 PFHpA 00002	04/01/18		Aldrich, Lot BCBM2579V		(Purchased Reagent)		Perfluoroheptanoic acid	0.99 g/g
...LC537-PFHxS 00008	07/28/17	07/28/16	Methanol, Lot 090285	5.5 mL	LC537 PFHxS 00002	0.0061 g	Perfluorohexanesulfonic acid	1008.61 ug/mL
....LC537 PFHxS 00002	04/01/18		Sigma, Lot BCBL3545V		(Purchased Reagent)		Perfluorohexanesulfonic acid	0.9094 g/g
...LC537-PFNA 00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFNA 00002	0.007 g	Perfluorononanoic acid	1037.08 ug/mL
....LC537 PFNA 00002	04/01/18		TCI America, Lot QN44F		(Purchased Reagent)		Perfluorononanoic acid	0.963 g/g
...LC537-PFOA 00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFOA 00002	0.0127 g	Perfluorooctanoic acid (PFOA)	1951.89 ug/mL
....LC537 PFOA 00002	11/04/18		Fluka, Lot SZBD308XV		(Purchased Reagent)		Perfluorooctanoic acid (PFOA)	0.999 g/g
...LC537-PFOS 00006	07/28/17	07/28/16	Methanol, Lot 090285	6 mL	LC537 PFOS 00002	0.0066 g	Perfluorooctanesulfonic acid (PFOS)	1001.66 ug/mL
....LC537 PFOS 00002	08/09/17		Fluka, Lot SZBC222XV		(Purchased Reagent)		Perfluorooctanesulfonic acid (PFOS)	0.9106 g/g
.LC537-IS 00028	06/19/17	12/19/16	Methanol, Lot 090285	10000 uL	LCM2PFOA 00005	100 uL	13C2-PFOA	0.5 ug/mL
..LCM2PFOA 00005	06/19/18		Wellington Laboratories, Lot M2PFOA0613		LCMPFOS 00018	300 uL	13C4 PFOS	1.434 ug/mL
..LCMPFOS 00018	08/03/21		Wellington Laboratories, Lot MPFOS0816		(Purchased Reagent)		13C2 PFOA	50 ug/mL
.LC537-SU 00026	06/14/17	12/16/16	Methanol, Lot 104453	20000 uL	(Purchased Reagent)		13C4 PFOS	47.8 ug/mL
..LC537-SU 00025	06/14/17	12/14/16	Methanol, Lot 104453	10000 uL	LC537-SU 00025	10000 uL	13C2 PFDA	0.2 ug/mL
...LCMPFDA 00008	08/19/20		Wellington Laboratories, Lot MPFDA0815		LCMPFDA 00008	80 uL	13C2 PFHxA	0.2 ug/mL
...LCMPFHxA 00009	04/09/20		Wellington Laboratories, Lot MPFHxA0415		LCMPFHxA 00009	80 uL	13C2 PFDA	0.4 ug/mL
					(Purchased Reagent)		13C2 PFHxA	50 ug/mL
LC537-MSP_00017	06/22/17	12/22/16	Methanol, Lot 090285	10000 uL	LC537SPIM_00018	200 uL	Perfluorobutane Sulfonate	1795.2 ng/mL
							Perfluorobutanesulfonic acid (PFBS)	1795.2 ng/mL
							Perfluoroheptanoic acid	198 ng/mL
							Perfluorohexanesulfonic acid	605.164 ng/mL
							Perfluorononanoic acid	414.831 ng/mL
							Perfluorooctanoic acid (PFOA)	390.378 ng/mL
							Perfluorooctanesulfonic acid (PFOS)	801.328 ng/mL
.LC537SPIM_00018	06/22/17	12/22/16	Methanol, Lot 104453	10000 uL	LC537-PFBS_00006	440 uL	Perfluorobutane Sulfonate	89.76 ug/mL
							Perfluorobutanesulfonic acid (PFBS)	89.76 ug/mL
					LC537-PFHpA 00013	100 uL	Perfluoroheptanoic acid	9.9 ug/mL
					LC537-PFHxS 00008	300 uL	Perfluorohexanesulfonic acid	30.2582 ug/mL
					LC537-PFNA 00011	200 uL	Perfluorononanoic acid	20.7415 ug/mL
					LC537-PFOA 00011	100 uL	Perfluorooctanoic acid (PFOA)	19.5189 ug/mL
					LC537-PFOS 00006	400 uL	Perfluorooctanesulfonic acid (PFOS)	40.0664 ug/mL
..LC537-PFBS_00006	07/28/17	07/28/16	Methanol, Lot 090285	5 mL	LC537 PFBS 00002	0.0102 g	Perfluorobutane Sulfonate	2040 ug/mL
							Perfluorobutanesulfonic acid (PFBS)	2040 ug/mL
...LC537 PFBS 00002	04/01/18		Sigma, Lot MKBP8842V		(Purchased Reagent)		Perfluorobutane Sulfonate	1 g/g
							Perfluorobutanesulfonic acid (PFBS)	1 g/g
..LC537-PFHpA 00013	06/22/17	12/22/16	Methanol, Lot 090285	56.8 mL	LC537 PFHpA 00002	0.0568 g	Perfluoroheptanoic acid	990 ug/mL
...LC537 PFHpA 00002	04/01/18		Aldrich, Lot BCBM2579V		(Purchased Reagent)		Perfluoroheptanoic acid	0.99 g/g
..LC537-PFHxS 00008	07/28/17	07/28/16	Methanol, Lot 090285	5.5 mL	LC537 PFHxS 00002	0.0061 g	Perfluorohexanesulfonic acid	1008.61 ug/mL

REAGENT TRACEABILITY SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1

SDG No.: _____

Reagent ID	Exp Date	Prep Date	Dilutant Used	Reagent Final Volume	Parent Reagent		Analyte	Concentration
					Reagent ID	Volume Added		
...LC537 PFHxS 00002	04/01/18		Sigma, Lot BCBL3545V		(Purchased Reagent)		Perfluorohexanesulfonic acid	0.9094 g/g
..LC537-PFNA 00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFNA_00002	0.007 g	Perfluorononanoic acid	1037.08 ug/mL
...LC537 PFNA 00002	04/01/18		TCI America, Lot QN44F		(Purchased Reagent)		Perfluorononanoic acid	0.963 g/g
..LC537-PFOA 00011	11/21/17	11/21/16	Methanol, Lot 090285	6.5 mL	LC537 PFOA_00002	0.0127 g	Perfluorooctanoic acid (PFOA)	1951.89 ug/mL
...LC537 PFOA 00002	11/04/18		Fluka, Lot SZBD308XV		(Purchased Reagent)		Perfluorooctanoic acid (PFOA)	0.999 g/g
..LC537-PFOS_00006	07/28/17	07/28/16	Methanol, Lot 090285	6 mL	LC537_PFOS_00002	0.0066 g	Perfluorooctanesulfonic acid (PFOS)	1001.66 ug/mL
...LC537_PFOS_00002	08/09/17		Fluka, Lot SZBC222XV		(Purchased Reagent)		Perfluorooctanesulfonic acid (PFOS)	0.9106 g/g
LC537-SU_00028	07/03/17	01/03/17	Methanol, Lot 104453	20000 uL	LCMPFDA_00012	80 uL	13C2 PFDA	0.2 ug/mL
					LCMPFHxA_00013	80 uL	13C2 PFHxA	0.2 ug/mL
.LCMPFDA_00012	09/30/21		Wellington Laboratories, Lot MPFDA0916		(Purchased Reagent)		13C2 PFDA	50 ug/mL
.LCMPFHxA_00013	04/08/21		Wellington Laboratories, Lot MPFHxA0416		(Purchased Reagent)		13C2 PFHxA	50 ug/mL

Reagent

LC537_PFB_00002

4/1/15 SPV

SIGMA-ALDRICH®

sigma-aldrich.com

3050 Spruce Street, Saint Louis, MO 63103, USA

Website: www.sigmaaldrich.com

Email USA: techserv@sial.com

Outside USA: eurtechserv@sial.com

Certificate of Analysis

Product Name:

Nonafluorobutane-1-sulfonic acid - 97%

Product Number:

562629

Batch Number:

MKBP8842V

Brand:

ALDRICH

CAS Number:

375-73-5

MDL Number:

MFCD01320794

Formula:

C₄HF₉O₃S

Formula Weight:


300.10 g/mol

Storage Temperature:

Store at 2 - 8 °C

Quality Release Date:

11 OCT 2013

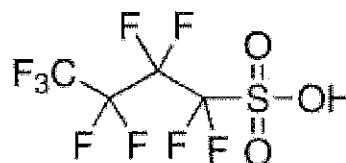

PFBS

Test	Specification	Result
Appearance (Color)	Colorless	Colorless
Appearance (Form)	Liquid	Liquid
Infrared Spectrum	Conforms to Structure	Conforms
Fluorine NMR Spectrum	Conforms to Structure	Conforms
Purity (Titration by NaOH)	96.5 - 103.5 %	101.6 %

Jamie Gleason

Jamie Gleason, Manager

Quality Control

Milwaukee, Wisconsin US

Sigma-Aldrich warrants, that at the time of the quality release or subsequent retest date this product conformed to the information contained in this publication. The current Specification sheet may be available at Sigma-Aldrich.com. For further inquiries, please contact Technical Service. Purchaser must determine the suitability of the product for its particular use. See reverse side of invoice or packing slip for additional terms and conditions of sale.

Reagent

LC537_PFB2_00001



The Power to Question

CERTIFICATE OF ANALYSIS

Catalog Number: sc-236187
Product Name: Nonafluorobutane-1-sulfonic acid
CAS Number: 375-73-5
Molecular Formula: $C_4HF_9O_3S$
Molecular Weight: 300.10
Lot Number: H0112

Test		Result
Refractive Index	1.3200 to 1.3290	1.3219
Purity (Titration)	min. 98.0%	99.8%

Test Conditions: Refractive Index: $n_{20/D}$

Reagent

LC537_PFHpA_00002


R: 4/1/15 4V

Certificate of Analysis

Product Name: PERFLUOROHEPTANOIC ACID
Product Number: 342041
Batch Number: BCBM2579V
Brand: Aldrich
CAS Number: 375-85-9
Formula: $\text{CF}_3(\text{CF}_2)_5\text{CO}_2\text{H}$
Formula Weight: 364.06
Quality Release Date: 06 DEC 2013
Recommended Retest Date: OCT 2018

PFHpA

TEST	SPECIFICATION	RESULT
APPEARANCE (COLOR)	COLORLESS OR WHITE	WHITE
APPEARANCE (FORM)	LIQUID OR SOLID	SOLID
TITRATION	98.5 - 101.5 %	99.8 %
TITRATION (METHOD)	-	BACK TITRATION
PURITY (GC AREA %)	≥ 98.5 %	99.5 %
INFRARED SPECTRUM	CONFORMS TO STRUCTURE	CONFORMS

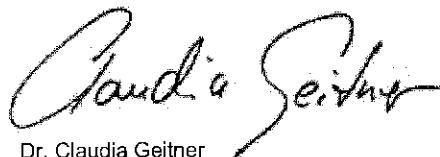

Dr. Claudia Geitner
Manager Quality Control
Buchs, Switzerland

Sigma-Aldrich warrants that at the time of the quality release or subsequent retest date this product conformed to the information contained in this publication. The current specification sheet may be available at Sigma-Aldrich.com. For further inquiries, please contact Technical Service. Purchaser must determine the suitability of the product for its particular use. See reverse side of invoice or packing slip for additional terms and conditions of sale.

Reagent

LC537_PFHxS_00002

R: 4/1/15 SW

SIGMA-ALDRICH

3050 Spruce Street, Saint Louis, MO 63103 USA
Email USA: techserv@sial.com Outside USA: eurtechserv@sial.com

Certificate of Analysis

Product Name: TRIDECAFLUOROHXANE-1-SULFONIC ACID POTASSIUM SALT
Product Number: 50929
Batch Number: BCBL3545V
Brand: Aldrich
CAS Number: 3871-99-6
Formula: $C_{13}F_{27}KO_3S$
Formula Weight: 438.20
Quality Release Date: 20 JUN 2013

PFH₁₃S-K

TEST	SPECIFICATION	RESULT
APPEARANCE (COLOR)	WHITE TO FAINT BEIGE	WHITE
APPEARANCE (FORM)	POWDER OR CRYSTALS	POWDER
TITRATION (ION EXCHANGE)	≥ 98.0 %	99.5 %
INFRARED SPECTRUM	CONFORMS TO STRUCTURE	CONFORMS

Claudia Geitner

Dr. Claudia Geitner
Manager Quality Control
Buchs, Switzerland

$$MW_{corr} = \frac{(k_{form}) - (K) + (H)}{(438.20 - 39.10 + 1.01)} = \frac{0.91307}{438.20 (k_{form})} = 0.91307 \text{ (anion form)}$$

$$Purity = 90.94 \% \text{ w/m.w correction}$$

SW 4/1/15

Sigma-Aldrich warrants that at the time of the quality release or subsequent retest date this product conformed to the information contained in this publication. The current specification sheet may be available at Sigma-Aldrich.com. For further inquiries, please contact Technical Service. Purchaser must determine the suitability of the product for its particular use. See reverse side of invoice or packing slip for additional terms and conditions of sale.

Reagent

LC537_PFNA_00002

R: 4/1/15 SKV



Certificate of Analysis

Apr 2, 2015 (JST)

TOKYO CHEMICAL INDUSTRY CO.,LTD.
4-10-1 Nihonbashi-Honcho, Chuo-ku, Tokyo 103-0023 Japan

Chemical Name: Heptadecafluorononanoic Acid		
Product Number: H0843	Lot: QN44F	
CAS: 375-95-1		

Tests	Results	Specifications
Purity(GC)	96.3 %	min. 95.0 %
Purity(Neutralization titration)	98.1 %	min. 95.0 %
Melting point	63.3 deg-C	62.0 to 67.0 deg-C

TCI Lot numbers are 4-5 characters in length.
Characters listed after the first 4-5 characters are control numbers for internal purpose only.

Customer service:

TCI AMERICA
Tel: +1-800-423-8616 / +1-503-283-1681
Fax: +1-888-520-1075 / +1-503-283-1987
E-mail: Sales-US@TCIchemicals.com

PFNA

Reagent

LC537_PFOA_00002

3/24/15

SIGMA-ALDRICH®

CERTIFICATE OF ANALYSIS

Sigma-Aldrich Laborchemikalien GmbH D-30918 Seelze
Telefon: +49 5137 8238-150

Seelze, 13.11.2013/505378/13/24029

Order-No.:

Customer-No.:

Order-Code:

Quantity:

Production Date: 04.Nov.2013

Expiry Date: 04.Nov.2018

Article/Product: 33824

Batch : SZBD308XV

Pentadecafluorooctanoic acid OEKANAL®

PFOA

Reference Material (RM)

1. General Information

Formula: C₈HF₁₅O₂

CAS-No.: [335-67-1]

Usage : PFOA

Molar mass: 414.07 g/Mole

Recomm. storage temp.: roomtemp.

The estimated uncertainty of a single measurement of the assay can be expected to be 0.5 % relative (confidence level = 95%, n= 6) whereby the assay measurements are calculated by 100% minus found impurities.

2. Batch Analysis

identity (GC-MS)

Assay (GCMS)

Date of Analysis

complying

99.4 %

13.Nov.2013

3. Advice and Remarks


- The expiry date is based on the current knowledge and holds only for proper storage conditions in the originally closed flasks/ packages.
- Whenever the container is opened for removal of aliquot portions of the substance, the person handling the substance must assure, that the integrity of the substance is maintained and proper records of all its handlings are kept. Special care has to be taken to avoid any contamination or adulteration of the substance.
- We herewith confirm that the delivery is effected according to the technical delivery conditions agreed.
- Particular properties of the products or the suitability for a particular area of application are not assured.
- We guarantee a proper quality within our General Conditions of Sales.

Sigma-Aldrich Laborchemikalien GmbH
Quality Management SA-LC

This document was produced electronically and is valid without a signature


GC/MS-Method**Analytical Department****Article:** Pentadecafluorooctanoic acid OEKANAL**Article-No.:** 33824**Batch:** SZBD308XV**Column:** XTI-5 (Restek); 30 m; fs cap.; I.D.:0.25 mm; 1 µm df**Injector:** Split mode**Injection:** approx. 1 µl of reaction mixture with MSTFA (approx. 10 mg + 200 µl MSTFA)**Inj.-temp.:** 280°C**Oven-temp.:** 40°C (for 2 min) to 320°C (6°C/min) hold for 2 min**Split:** 1:100**Flow:** 1 ml He/min (Constant flow mode)**Detector:** MSD**Mass range:** 10-600 amu (Scan mode)**Evaluation:** Purity: Total Ion Chromatogram
(MSTFA and reaction products blinded out in report)

Identity: Mass spectrum complies

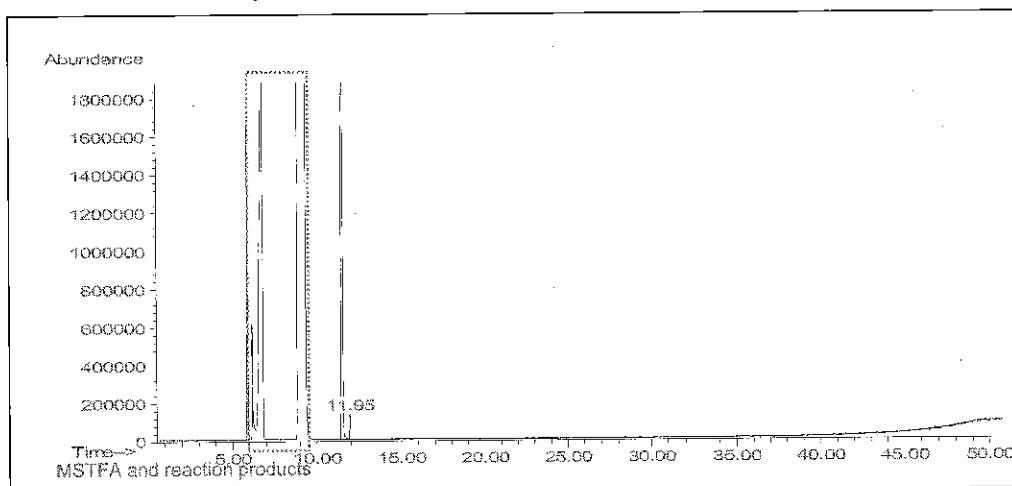Operator: Ahrens / 2013-11-13**Total Ion Chromatogram:**

Ret.time	Area	Area-%	Com
----------	------	--------	-----

11.54	565.1670	99.4	Pentadecafluorooctanoic acid (as TMS-ester)
11.95	3.6792	0.64	

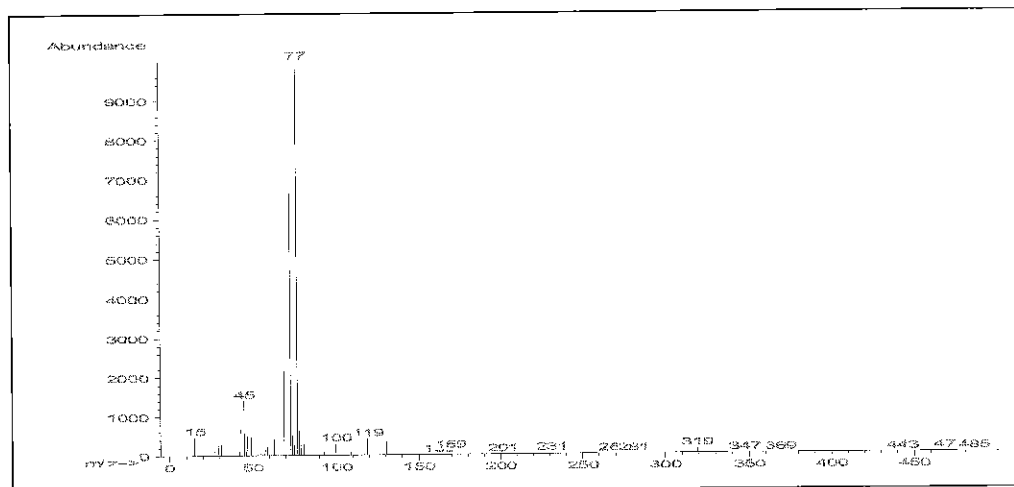Mass spectrum (rt = 11.54 min):

Reagent

LC537_PFOA2_00001

Certificate of Analysis

Alfa Aesar
A Johnson Matthey Company

Product No.: L08862
Product: Perfluorooctanoic acid, 95%
Lot No.: D24Y026

PFOA

Appearance White solid
Melting point 58 - 60°C
Assay 99 %
Identity Matches reference

This document has been electronically generated and does not require a signature.

www.alfa.com

NORTH AMERICA
Tel: +1-800-343-0660 or
+1-978-521-6300
Fax: +1-800-322-4757
Email: info@alfa.com

GERMANY
Tel: 00800 4566 4566 or
+49 721 84007 280
Fax: 00800 4577 4577 or
+49 721 84007 300
Email: Eurosales@alfa.com

UNITED KINGDOM
Tel: 0800-801812 or
+44 (0)1524-850506
Fax: +44 (0)1524-850608
Email: UKsales@alfa.com

FRANCE
Tel: 0800 03 51 47 or
+33 (0)3 6862 2690
Fax: 0800 10 20 67 or
+33 (0)3 8862 6864
Email: frventes@alfa.com

INDIA
Tel: +91 8008 812424 or
+91 8008 812525 or
+91 8008 812626
Fax: +91 8418 260060
Email: India@alfa.com

CHINA
Tel: +86 (010) 8567-8600
Fax: +86 (010) 8567-8601
Email: saleschina@alfa-asia.com

KOREA
Tel: +82-2-3140-6000
Fax: +82-2-3140-6002
Email: saleskorea@alfa-asia.com

Reagent

LC537_PFOS_00002

F: 4/1/15 SV

SIGMA-ALDRICH®

CERTIFICATE OF ANALYSIS

Sigma-Aldrich Laborchemikalien GmbH D-30918 Seelze
Telefon: +49 5137 8238-150

Seelze, 13.08.2012/419060/12/17583

Order-No.:

Customer-No.:

Order-Code:

Quantity:

Production Date: 09.Aug.2012

Expiry Date: 09.Aug.2017 - *ex date*

Article/Product: 33829

Batch : SZBC222XV

Heptadecafluorooctanesulfonic acid potassium salt OEKANAL®

PFOS-K⁺

Reference Material (RM)

1. General Information

Formula: C8F17KO3S
CAS-No.: [2795-39-3]
Usage : PFOS

Molar mass: 538.22 g/Mole
Recomm. storage temp.: roomtemp.

The estimated uncertainty of a single measurement of the assay can be expected to be 0.5 % relative (confidence level = 95%, n= 6) whereby the assay measurements are calculated by 100% minus found impurities.

2. Batch Analysis

Identity
Assay (LC-MS)
Date of Analysis

complying
98 %
10.Aug.2012

$$\text{P.W.-Correction: } \frac{538.22 - 39.10 + 1.01}{538.22} = \frac{500.13}{538.22} = 0.92923$$

Purity = 91.06%

3. Advice and Remarks

- The minimum shelf life is based on the current knowledge and holds only for proper storage conditions in the originally closed flasks/ packages.
- Whenever the container is opened for removal of aliquot portions of the substance, the person handling the substance must assure, that the integrity of the substance is maintained and proper records of all its handlings are kept. Special care has to be taken to avoid any contamination or adulteration of the substance.
- We herewith confirm that the delivery is effected according to the technical delivery conditions agreed.
- Particular properties of the products or the suitability for a particular area of application are not assured.
- We guarantee a proper quality within our General Conditions of Sales.

Sigma-Aldrich Laborchemikalien GmbH
Quality Management SA-LC

Reagent

LC537_PFOS2_00001

Certificate of Analysis

Inv 820
12LCMS 0579

Product Name: HEPTADEC AFLUORO OCTANESULFONIC ACID TETRAETHYLAMMONIUM SALT
98 %
Product Number: 365289
Product Brand: Aldrich
Molecular Formula: $C_{16}H_{20}F_{17}NO_3S$
Molecular Mass: 629.37
CAS Number: 56773-42-3

TEST	SPECIFICATION	LOT BCBF5116V RESULTS
APPEARANCE (COLOR)	OFF-WHITE TO WHITE	WHITE
APPEARANCE (FORM)	POWDER, LUMPS OR CHUNKS	POWDER WITH LUMPS
CARBON CONTENT	29.77 % - 31.29 %	30.52
INFRARED SPECTRUM	CONFORMS TO STRUCTURE	CONFORMS

QC RELEASE DATE 13/APR/11



E. Schwarz

Edeltraud Schwarzler, Manager
Quality Control
Buchs, Switzerland

$$MW \text{ correction} = \frac{500.125}{629.37} = 0.7946$$

~~79.46%~~ $\frac{500.125}{629.37} \times 100 = 79.46\%$ $\frac{500.125}{629.37} \times 100 = 79.46\%$ $\frac{500.125}{629.37} \times 100 = 79.46\%$

$$Purity + MW \text{ Correction} = 77.87\%$$

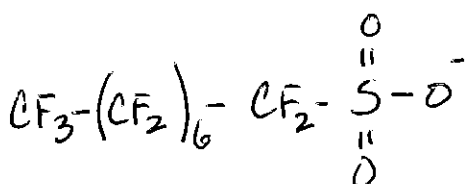

	$C_8F_{17}SO_3 + H$
C = 12.011	96.088
F = 18.998	322.966
S = 32.066	32.066
O = 15.999	47.997
H = 1.008	1.008
N = 14.007	-
	<u>500.125</u>

$C_8H_{20}N$
96.088
-
-
-
20.160
14.007
<u>130.255</u>
→

Sigma-Aldrich warrants, that its products conform to the information contained in this and other Sigma-Aldrich publications. Purchaser must determine the suitability of the product for its particular use. See reverse side of invoice for additional terms and conditions of sale. The values given on the 'Certificate of Analysis' are the results determined at the time of analysis.

Certificate of Origin

Product Name: Heptadecafluorooctanesulfonic acid tetraethylammonium salt
98 %
Product Number: 365289
Product Brand: Aldrich
Lot: BCBF5116V
Molecular Formula: $C_{16}H_{20}F_{17}NO_3S$
Molecular Mass: 629.37
CAS Number: 56773-42-3
Date of Issue: 30-MAR-11

Country of Origin China

product is of synthetic origin	yes
only synthetic materials used in the manufacturing process	yes
compounds of animal origin used	no
genetically modified organisms used	no
allergenic materials used	no
procedures in place to avoid cross contamination with residue of animal, human, GMO or allergenes in manufacturing process	yes

Sigma-Aldrich has quality systems and procedures in place for monitoring the production process, traceability and batch consistency.

Document issued by Sigma-Aldrich Corporation "Sigma-Aldrich". This document is valid without signature and has been produced digitally.

This information is to be used for the purpose of determining animal or other biological origin only and not to be confused with "Country of Origin" for import/export purposes. Data provided on this document are property of Sigma-Aldrich.

This information is considered accurate and reliable as of the date appearing on the document and is presented in good faith.

Sigma-Aldrich shall not be held liable for any damage resulting from handling or from processing the above product(s). This document does not make any warranty, express or implied, of fitness for any particular use of the product(s). Purchaser must determine the suitability of the product(s) for its use under the applicable law and regulations.

For further questions please contact your local Sigma-Aldrich representative.

We are committed to the success of our Customers, Employees and Shareholders through leadership in Life Science, High Technology and Service.

Reagent

LCM2PFOA_00005



WELLINGTON LABORATORIES

CERTIFICATE OF ANALYSIS DOCUMENTATION

PRODUCT CODE:


M2PFOA

LOT NUMBER:

M2PFOA0613

COMPOUND:Perfluoro-n-[1,2-¹³C₂]octanoic acid**STRUCTURE:****CAS #:**

Not available

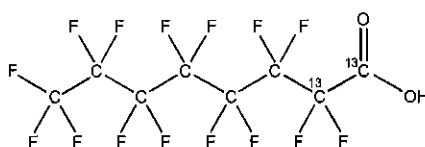**MOLECULAR FORMULA:**¹³C₂¹²C₆H₁₅O₂**MOLECULAR WEIGHT:**

416.05

CONCENTRATION:

50 ± 2.5 µg/ml

SOLVENT(S):

Methanol

Water (<1%)

CHEMICAL PURITY:

>98%

ISOTOPIC PURITY:≥99%¹³C**LAST TESTED:** (mm/dd/yyyy)

06/19/2013

(1,2-¹³C₂)**EXPIRY DATE:** (mm/dd/yyyy)

06/19/2018

RECOMMENDED STORAGE:

Store ampoule in a cool, dark place

DOCUMENTATION/ DATA ATTACHED:

Figure 1: LC/MS Data (TIC and Mass Spectrum)

Figure 2: LC/MS/MS Data (Selected MRM Transitions)

ADDITIONAL INFORMATION:

- See page 2 for further details.
- Contains 4 mole eq. of NaOH to prevent conversion of the carboxylic acid to the methyl ester.

FOR LABORATORY USE ONLY: NOT FOR HUMAN OR DRUG USE

Certified By:

B.G. Chittim

Date: 07/16/2013

(mm/dd/yyyy)

Wellington Laboratories Inc., 345 Southgate Dr. Guelph ON N1G 3M5 CANADA
519-822-2436 • Fax: 519-822-2849 • info@well-labs.com

INTENDED USE:

The products prepared by Wellington Laboratories Inc. are for laboratory use only. They are designed to be used as reference standards for the identification and/or quantification of specific chemical compound(s).

HAZARDS:

This product should only be used by qualified personnel familiar with its potential hazards and trained in the handling of hazardous chemicals. Due care should be exercised to prevent unnecessary human contact or ingestion. All procedures should be carried out in a well-functioning fume hood and suitable gloves, eye protection and clothing should be worn at all times. Waste should be disposed of according to national and regional regulations. Material Safety Data Sheets (MSDSs) are available upon request.

SYNTHESIS / CHARACTERIZATION:

Where possible, all of our products are synthesized using single-product, unambiguous routes. They are then characterized, and their structures and purities confirmed, using a combination of the most relevant techniques, such as NMR, GC/MS, LC/MS/MS, x-ray crystallography and melting point. Isotopic purities of mass-labelled compounds are also confirmed using HRGC/HRMS and/or LC/MS/MS.

HOMOGENEITY:

Prior to solution preparation, crystalline material is tested for homogeneity using a variety of techniques (as stated above) and its solubility in a given diluent is taken into consideration. Duplicate solutions of a new product are prepared from the same crystalline lot and, after the addition of an appropriate internal standard, they are compared by GC/MS and/or LC/MS/MS. The relative response factors of the analyte of interest in each solution are required to be <5% RSD. New solution lots of existing products are compared to older lots in the same manner, which further confirms the homogeneity of the crystalline material as well as the stability and homogeneity of the solutions in the storage containers.

UNCERTAINTY:

The maximum combined relative standard uncertainty of our reference standard solutions is calculated using the following equation:

The combined relative standard uncertainty, $u_c(y)$, of a value y and the uncertainty of the independent parameters

$x_1, x_2, \dots, x_n$ on which it depends is:

$$u_c(y(x_1, x_2, \dots, x_n)) = \sqrt{\sum_{i=1}^n u(y, x_i)^2}$$

where x is expressed as a relative standard uncertainty of the individual parameter.

The individual uncertainties taken into account include those associated with weights (calibration of the balance) and volumes (calibration of the volumetric glassware). An expanded maximum combined percent relative uncertainty of $\pm 5\%$ (calculated with a coverage factor of 2 and a level of confidence of 95%) is stated on the Certificate of Analysis for all our products.

TRACEABILITY:

All reference standard solutions are traceable to specific crystalline lots. The microbalances used for solution preparation are regularly tested by an external, ISO/IEC 17025:2005 accredited calibration company. In addition, their calibration is verified prior to each weighing using NIST and/or NRC traceable external weights. All volumetric glassware used is of Class A tolerance and has been tested according to the appropriate ASTM procedures, which are ultimately traceable to NIST. For certain products, traceability to international interlaboratory studies has also been established.

EXPIRY DATE / PERIOD OF VALIDITY:

Ongoing stability studies of this product have demonstrated stability in its composition and concentration for the period of time specified by the expiry date in the unopened ampoule. Monitoring for any degradation or change in concentration of the listed analyte(s) is performed on a routine basis.

LIMITED WARRANTY:

At the time of shipment, all products are warranted to be free of defects in material and workmanship and to conform to the stated technical and purity specifications.



QUALITY MANAGEMENT:

This product was produced using a Quality Management System registered to ISO 9001:2008 by SAI Global, ISO/IEC 17025:2005 by the Canadian Association for Laboratory Accreditation Inc. (CALA; A 1226), and ISO GUIDE 34:2009 by ACLASS (certificate number AR-1523).



For additional information or assistance concerning this or any other products from Wellington Laboratories Inc., please visit our website at www.well-labs.com or contact us directly at info@well-labs.com

Figure 1: M2PFOA; LC/MS Data (TIC and Mass Spectrum)

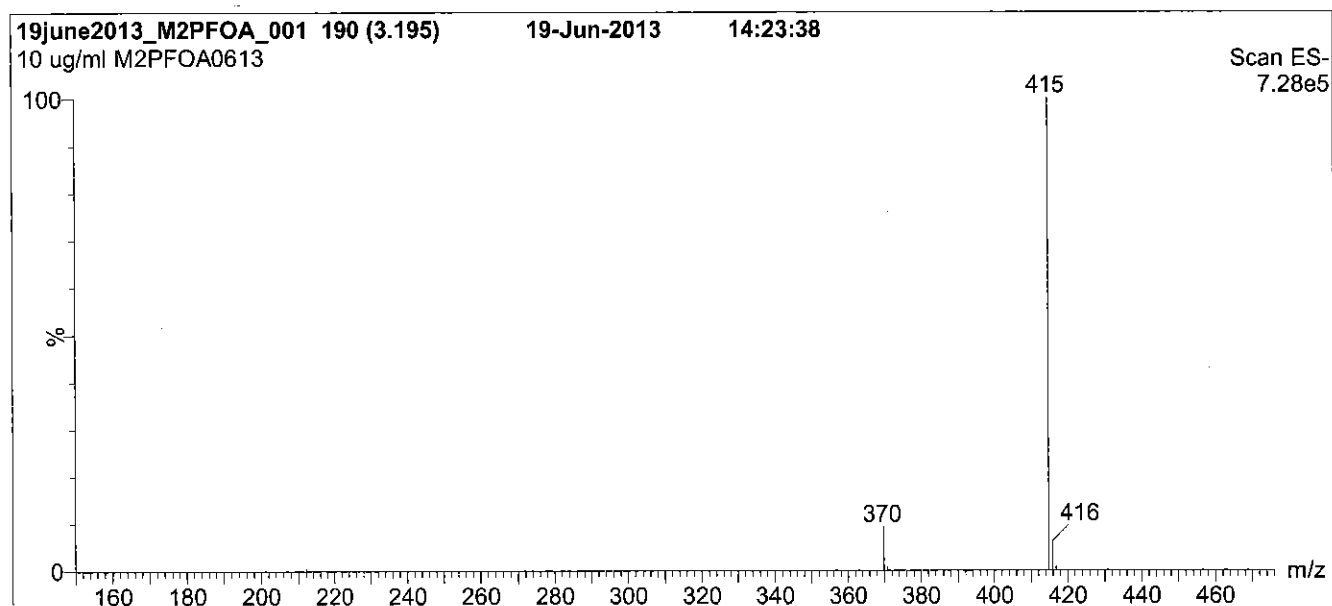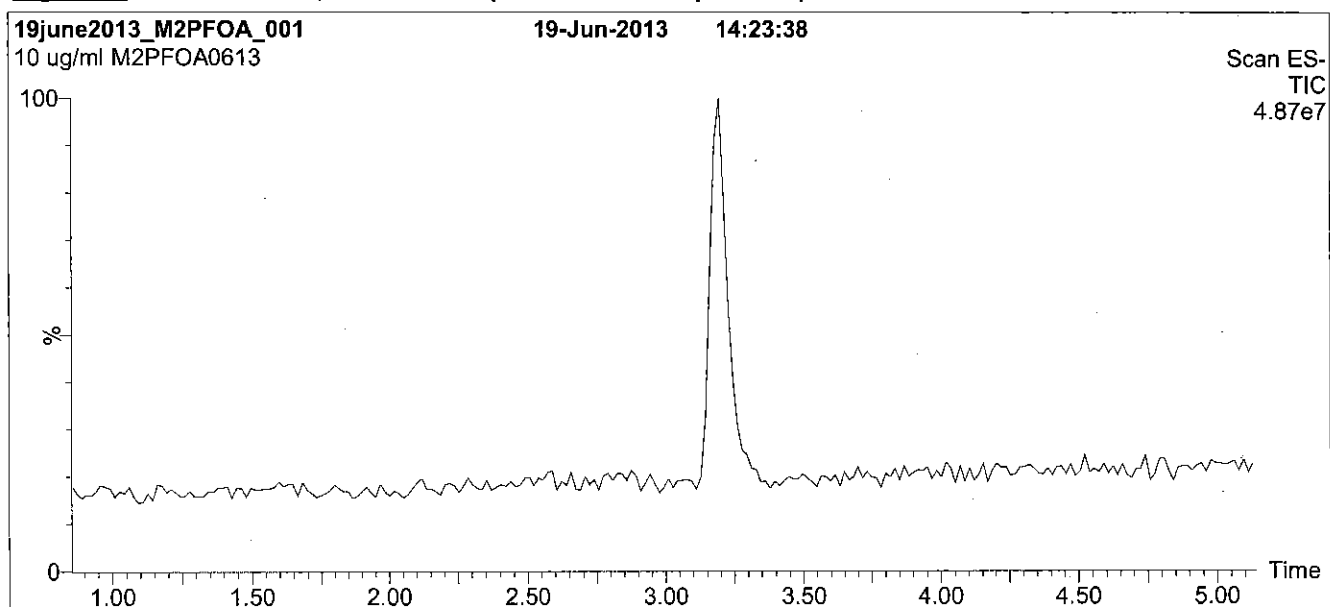

Conditions for Figure 1:

LC: Waters Acquity Ultra Performance LC
MS: Micromass Quattro micro API MS

Chromatographic Conditions

Column: Acquity UPLC BEH Shield RP₁₈
1.7 μ m, 2.1 x 100 mm

Mobile phase: Gradient
Start: 50% (80:20 MeOH:ACN) / 50% H₂O
(both with 10 mM NH₄OAc buffer)
Ramp to 90% organic over 7 min and hold for 1.5 min
before returning to initial conditions in 0.5 min.
Time: 10 min


Flow: 300 μ l/min

MS Parameters

Experiment: Full Scan (150 - 850 amu)

Source: Electrospray (negative)
Capillary Voltage (kV) = 2.00
Cone Voltage (V) = 15.00
Cone Gas Flow (l/hr) = 100
Desolvation Gas Flow (l/hr) = 750

Figure 2: M2PFOA; LC/MS/MS Data (Selected MRM Transitions)

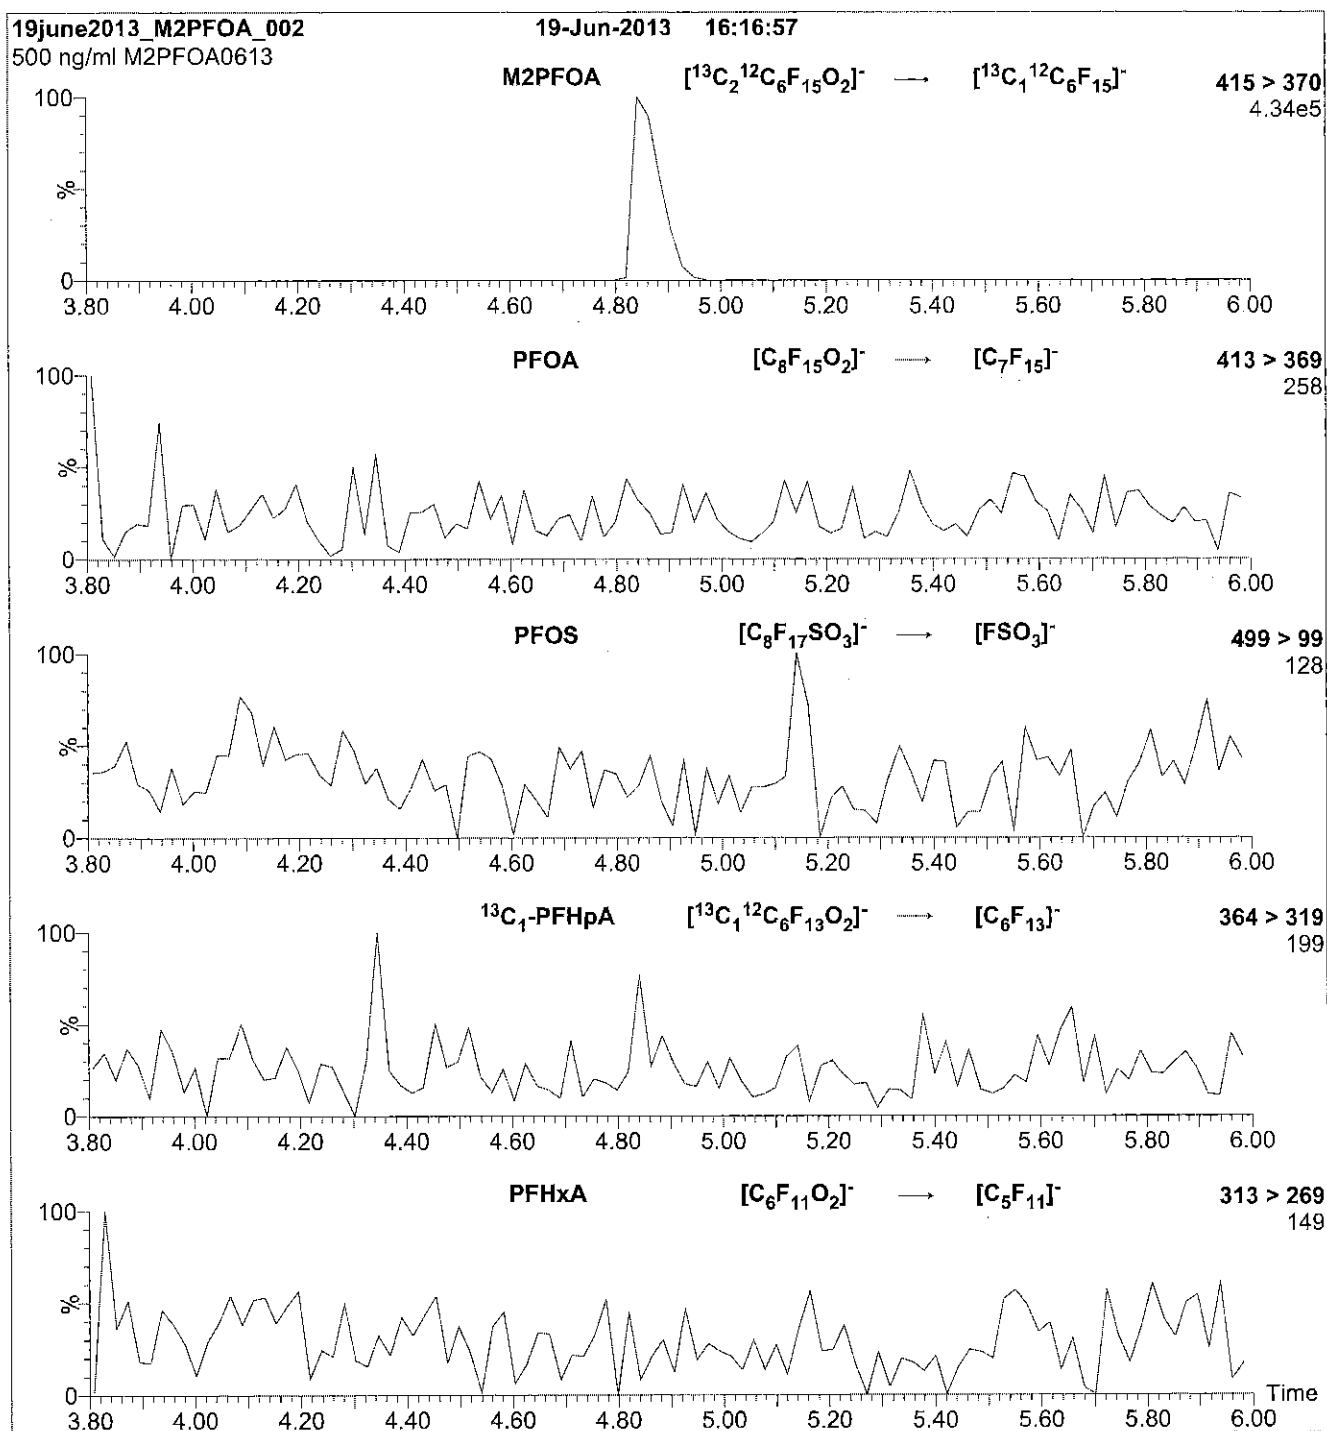

Conditions for Figure 2:

Injection: Direct loop injection
10 μl (500 ng/ml M2PFOA)

Mobile phase: Isocratic 80% (80:20 MeOH:ACN) / 20% H_2O
(both with 10 mM NH_4OAc buffer)

Flow: 300 $\mu\text{l}/\text{min}$

MS Parameters

Collision Gas (mbar) = 3.66e-3
Collision Energy (eV) = 11

Reagent

LCMPFDA_00008



605243

ID: LCMPPFDA_00008

Exp: 08/19/20 Pptd: CBW

13C2-Perfluorodecanoic acid

Rec. 3/29/16 JRB ✓



WELLINGTON LABORATORIES

CERTIFICATE OF ANALYSIS DOCUMENTATION

PRODUCT CODE:


MPFDA

LOT NUMBER:

MPFDA0815

COMPOUND:Perfluoro-n-[1,2-¹³C₂]decanoic acid**STRUCTURE:****CAS #:**

Not available

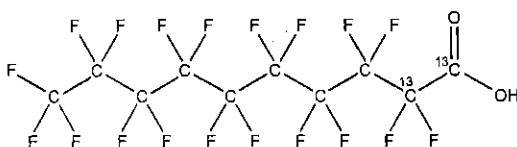**MOLECULAR FORMULA:**¹³C₂¹²C₈H₁₉O₂**CONCENTRATION:**

50 ± 2.5 µg/ml

MOLECULAR WEIGHT:

516.07

SOLVENT(S):

Methanol

Water (<1%)

CHEMICAL PURITY:

>98%

ISOTOPIC PURITY:≥99% ¹³C(1,2-¹³C₂)**LAST TESTED:** (mm/dd/yyyy)

08/19/2015

EXPIRY DATE: (mm/dd/yyyy)

08/19/2020

RECOMMENDED STORAGE:

Store ampoule in a cool, dark place

DOCUMENTATION/ DATA ATTACHED:

Figure 1: LC/MS Data (TIC and Mass Spectrum)

Figure 2: LC/MS/MS Data (Selected MRM Transitions)

ADDITIONAL INFORMATION:

- See page 2 for further details.
- Contains 4 mole eq. of NaOH to prevent conversion of the carboxylic acid to the methyl ester.
- Contains < 0.1% of ¹³C₁-PFNA.

FOR LABORATORY USE ONLY: NOT FOR HUMAN OR DRUG USE

Certified By:

B.G. Chittim

Date: 08/21/2015

(mm/dd/yyyy)

Wellington Laboratories Inc., 345 Southgate Dr. Guelph ON N1G 3M5 CANADA
519-822-2436 • Fax: 519-822-2849 • info@well-labs.com

INTENDED USE:

The products prepared by Wellington Laboratories Inc. are for laboratory use only. This certified reference material (CRM) was designed to be used as a standard for the identification and/or quantification of the specific chemical compound it contains.

HAZARDS:

This product should only be used by qualified personnel familiar with its potential hazards and trained in the handling of hazardous chemicals. Due care should be exercised to prevent unnecessary human contact or ingestion. All procedures should be carried out in a well-functioning fume hood and suitable gloves, eye protection, and clothing should be worn at all times. Waste should be disposed of according to national and regional regulations. Safety Data Sheets (SDSs) are available upon request.

SYNTHESIS / CHARACTERIZATION:

Where possible, all of our products are synthesized using single-product unambiguous routes. They are then characterized, and their structures and purities confirmed, using a combination of the most relevant techniques, such as NMR, GC/MS, LC/MS/MS, SFC/UV/MS/MS, x-ray crystallography, and melting point. Isotopic purities of mass-labelled compounds are also confirmed using HRGC/HRMS and/or LC/MS/MS.

HOMOGENEITY:

Prior to solution preparation, crystalline material is tested for homogeneity using a variety of techniques (as stated above) and its solubility in a given diluent is taken into consideration. Duplicate solutions of a new product are prepared from the same crystalline lot and, after the addition of an appropriate internal standard, they are compared by GC/MS, LC/MS/MS and/or SFC/UV/MS/MS. The relative response factors of the analyte of interest in each solution are required to be <5% RSD. New solution lots of existing products are compared to older lots in the same manner, which further confirms the homogeneity of the crystalline material as well as the stability and homogeneity of the solutions in the storage containers.

UNCERTAINTY:

The maximum combined relative standard uncertainty of our reference standard solutions is calculated using the following equation:

The combined relative standard uncertainty, $u_c(y)$, of a value y and the uncertainty of the independent parameters $x_1, x_2, \dots, x_n$ on which it depends is:

$$u_c(y(x_1, x_2, \dots, x_n)) = \sqrt{\sum_{i=1}^n u(y, x_i)^2}$$

where x is expressed as a relative standard uncertainty of the individual parameter.

The individual uncertainties taken into account include those associated with weights (calibration of the balance) and volumes (calibration of the volumetric glassware). An expanded maximum combined percent relative uncertainty of $\pm 5\%$ (calculated with a coverage factor of 2 and a level of confidence of 95%) is stated on the Certificate of Analysis for all of our products.

TRACEABILITY:

All reference standard solutions are traceable to specific crystalline lots. The microbalances used for solution preparation are regularly tested by an external ISO/IEC 17025 accredited calibration company. In addition, their calibration is verified prior to each weighing using NIST and/or NRC traceable external weights. All volumetric glassware used is of Class A tolerance and has been tested according to the appropriate ASTM procedures, which are ultimately traceable to NIST. For certain products, traceability to international interlaboratory studies has also been established.

EXPIRY DATE / PERIOD OF VALIDITY:

Ongoing stability studies of this product have demonstrated stability in its composition and concentration, until the specified expiry date, in the unopened ampoule. Monitoring for any degradation or change in concentration of the listed analyte(s) is performed on a routine basis.

LIMITED WARRANTY:

At the time of shipment, all products are warranted to be free of defects in material and workmanship and to conform to the stated technical and purity specifications.



QUALITY MANAGEMENT:

This product was produced using a Quality Management System registered to the latest versions of ISO 9001 by SAI Global, ISO/IEC 17025 by the Canadian Association for Laboratory Accreditation Inc. (CALA; A 1226), and ISO GUIDE 34 by ANSI-ASQ National Accreditation Board (ANAB; AR-1523).



For additional information or assistance concerning this or any other products from Wellington Laboratories Inc., please visit our website at www.well-labs.com or contact us directly at info@well-labs.com

Figure 1: MPFDA; LC/MS Data (TIC and Mass Spectrum)

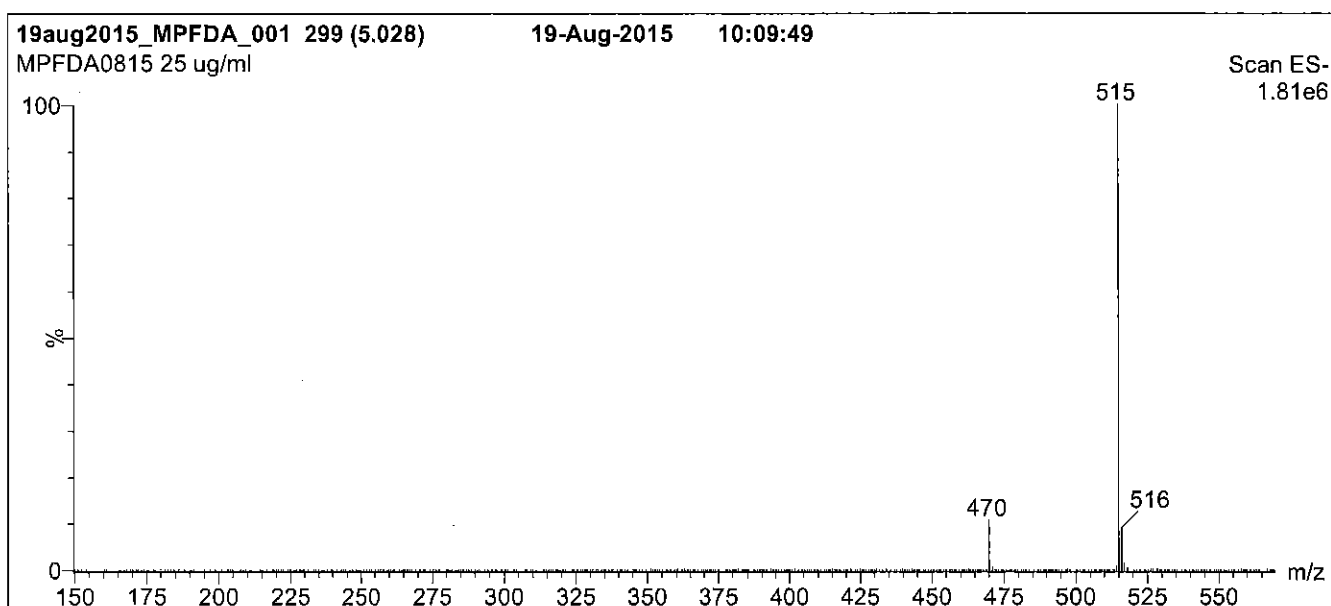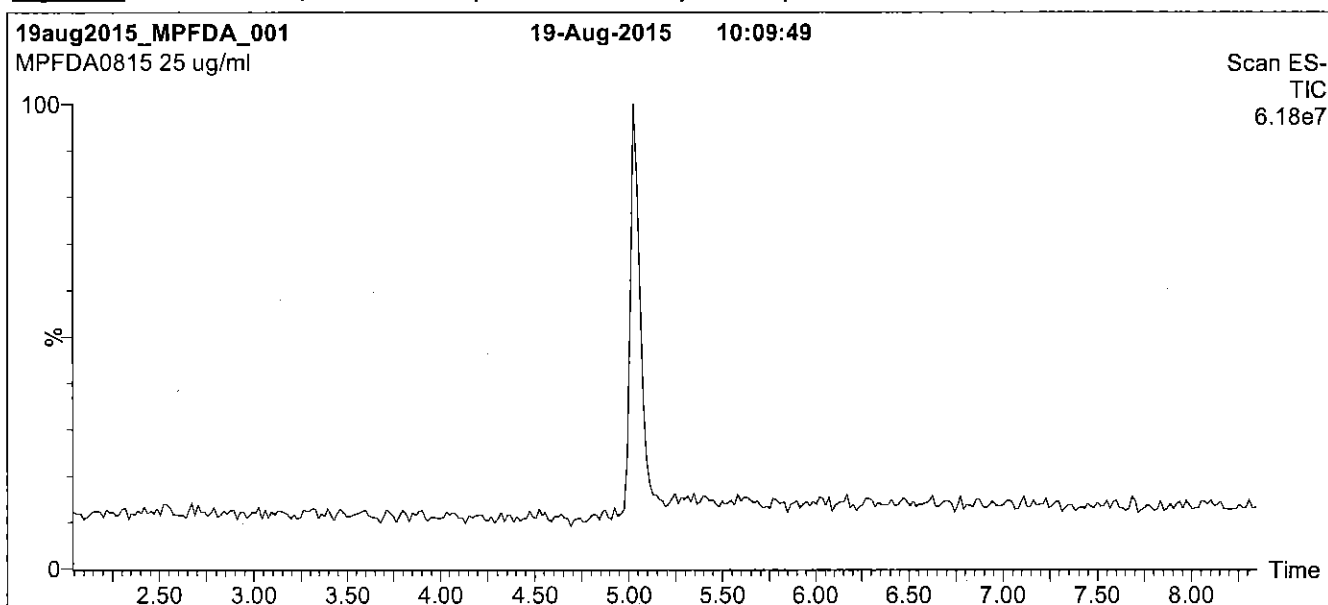

Conditions for Figure 1:

LC: Waters Acquity Ultra Performance LC
MS: Micromass Quattro *micro* API MS

Chromatographic Conditions

Column: Acquity UPLC BEH Shield RP₁₈
1.7 μ m, 2.1 x 100 mm

Mobile phase: Gradient
Start: 50% (80:20 MeOH:ACN) / 50% H₂O
(both with 10 mM NH₄OAc buffer)
Ramp to 90% organic over 7 min and hold for 2 min
before returning to initial conditions in 0.5 min.
Time: 10 min


Flow: 300 μ l/min

MS Parameters

Experiment: Full Scan (150 - 850 amu)

Source: Electrospray (negative)
Capillary Voltage (kV) = 2.00
Cone Voltage (V) = 15.00
Cone Gas Flow (l/hr) = 50
Desolvation Gas Flow (l/hr) = 750

Figure 2: MPFDA; LC/MS/MS Data (Selected MRM Transitions)

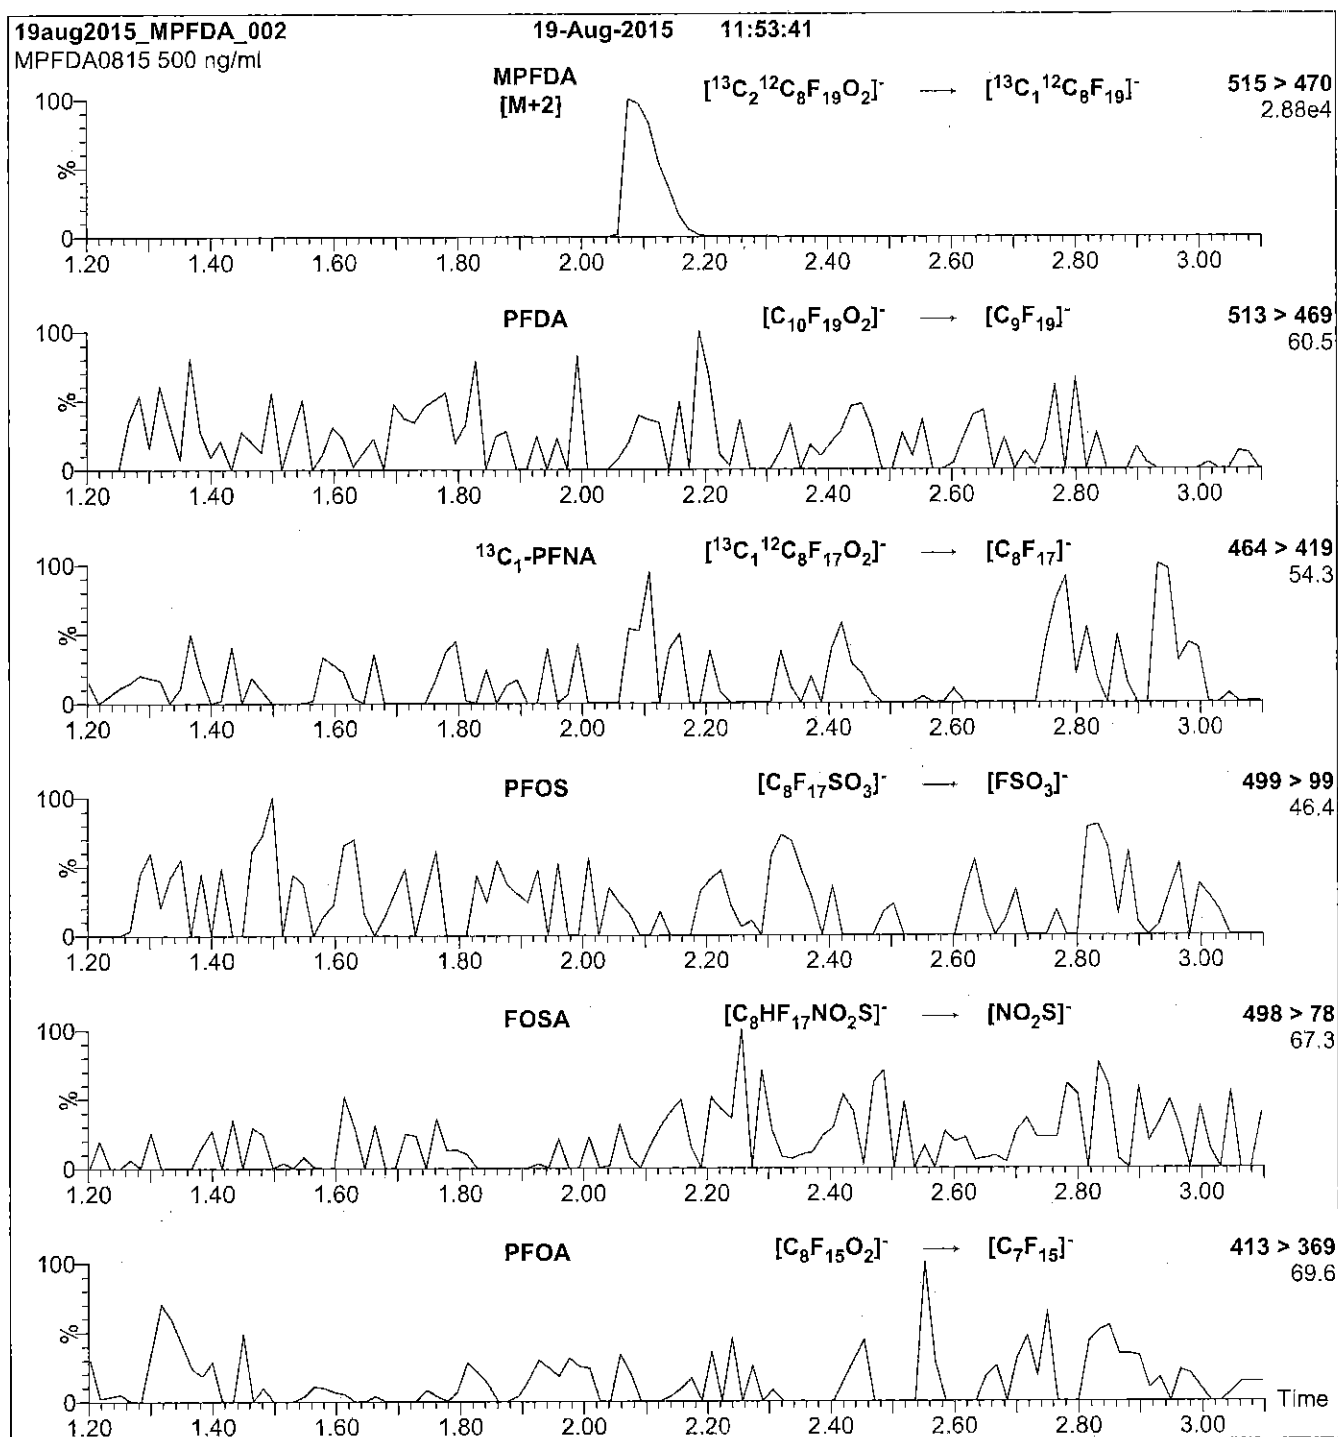

Conditions for Figure 2:

Injection: Direct loop injection
10 μ l (500 ng/ml MPFDA)

Mobile phase: Isocratic 80% (80:20 MeOH:ACN) / 20% H_2O
(both with 10 mM NH_4OAc buffer)

Flow: 300 μ l/min

MS Parameters

Collision Gas (mbar) = 3.35e-3
Collision Energy (eV) = 13

Reagent

LCMPFHxA_00009



605244

ID: LCMPFHxA_00009

Exp: 04/09/20 Prod: CBW

13C2-Perfluorohexanoic ac

Rec. 3/29/16 JRB ✓



WELLINGTON LABORATORIES

CERTIFICATE OF ANALYSIS DOCUMENTATION

PRODUCT CODE:


MPFHxA

LOT NUMBER:

MPFHxA0415

COMPOUND:Perfluoro-n-[1,2-¹³C₂]hexanoic acid**STRUCTURE:****CAS #:**

Not available

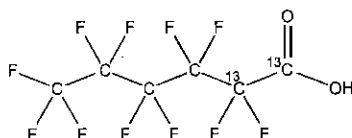**MOLECULAR FORMULA:**¹³C₂¹²C₄HF₁₁O₂**MOLECULAR WEIGHT:**

316.04

CONCENTRATION:

50 ± 2.5 µg/ml

SOLVENT(S):

Methanol

Water (<1%)

CHEMICAL PURITY:

>98%

ISOTOPIC PURITY:≥99%¹³C(1,2-¹³C₂)**LAST TESTED:** (mm/dd/yyyy)

04/09/2015

EXPIRY DATE: (mm/dd/yyyy)

04/09/2020

RECOMMENDED STORAGE:

Store ampoule in a cool, dark place

DOCUMENTATION/ DATA ATTACHED:

Figure 1: LC/MS Data (TIC and Mass Spectrum)

Figure 2: LC/MS/MS Data (Selected MRM Transitions)

ADDITIONAL INFORMATION:

- See page 2 for further details.
- Contains 4 mole eq. of NaOH to prevent conversion of the carboxylic acid to the methyl ester.
- Contains < 0.1% of perfluoro-n-hexanoic acid and ~ 0.3% of perfluoro-n-octanoic acid.

FOR LABORATORY USE ONLY: NOT FOR HUMAN OR DRUG USE

Certified By:

B.G. Chittim

Date: 04/14/2015

(mm/dd/yyyy)

Wellington Laboratories Inc., 345 Southgate Dr. Guelph ON N1G 3M5 CANADA
519-822-2436 • Fax: 519-822-2849 • info@well-labs.com

INTENDED USE:

The products prepared by Wellington Laboratories Inc. are for laboratory use only. This certified reference material (CRM) was designed to be used as a standard for the identification and/or quantification of the specific chemical compound it contains.

HAZARDS:

This product should only be used by qualified personnel familiar with its potential hazards and trained in the handling of hazardous chemicals. Due care should be exercised to prevent unnecessary human contact or ingestion. All procedures should be carried out in a well-functioning fume hood and suitable gloves, eye protection, and clothing should be worn at all times. Waste should be disposed of according to national and regional regulations. Safety Data Sheets (SDSs) are available upon request.

SYNTHESIS / CHARACTERIZATION:

Where possible, all of our products are synthesized using single-product unambiguous routes. They are then characterized, and their structures and purities confirmed, using a combination of the most relevant techniques, such as NMR, GC/MS, LC/MS/MS, SFC/UV/MS/MS, x-ray crystallography, and melting point. Isotopic purities of mass-labelled compounds are also confirmed using HRGC/HRMS and/or LC/MS/MS.

HOMOGENEITY:

Prior to solution preparation, crystalline material is tested for homogeneity using a variety of techniques (as stated above) and its solubility in a given diluent is taken into consideration. Duplicate solutions of a new product are prepared from the same crystalline lot and, after the addition of an appropriate internal standard, they are compared by GC/MS, LC/MS/MS and/or SFC/UV/MS/MS. The relative response factors of the analyte of interest in each solution are required to be <5% RSD. New solution lots of existing products are compared to older lots in the same manner, which further confirms the homogeneity of the crystalline material as well as the stability and homogeneity of the solutions in the storage containers.

UNCERTAINTY:

The maximum combined relative standard uncertainty of our reference standard solutions is calculated using the following equation:

The combined relative standard uncertainty, $u_c(y)$, of a value y and the uncertainty of the independent parameters $x_1, x_2, \dots, x_n$ on which it depends is:

$$u_c(v(x_1, x_2, \dots, x_n)) = \sqrt{\sum_{i=1}^n u(y, x_i)^2}$$

where x is expressed as a relative standard uncertainty of the individual parameter.

The individual uncertainties taken into account include those associated with weights (calibration of the balance) and volumes (calibration of the volumetric glassware). An expanded maximum combined percent relative uncertainty of $\pm 5\%$ (calculated with a coverage factor of 2 and a level of confidence of 95%) is stated on the Certificate of Analysis for all of our products.

TRACEABILITY:

All reference standard solutions are traceable to specific crystalline lots. The microbalances used for solution preparation are regularly tested by an external ISO/IEC 17025 accredited calibration company. In addition, their calibration is verified prior to each weighing using NIST and/or NRC traceable external weights. All volumetric glassware used is of Class A tolerance and has been tested according to the appropriate ASTM procedures, which are ultimately traceable to NIST. For certain products, traceability to international interlaboratory studies has also been established.

EXPIRY DATE / PERIOD OF VALIDITY:


Ongoing stability studies of this product have demonstrated stability in its composition and concentration, until the specified expiry date, in the unopened ampoule. Monitoring for any degradation or change in concentration of the listed analyte(s) is performed on a routine basis.

LIMITED WARRANTY:

At the time of shipment, all products are warranted to be free of defects in material and workmanship and to conform to the stated technical and purity specifications.



QUALITY MANAGEMENT:

This product was produced using a Quality Management System registered to the latest versions of ISO 9001 by SAI Global, ISO/IEC 17025 by the Canadian Association for Laboratory Accreditation Inc. (CALA; A 1226), and ISO GUIDE 34 by ANSI-ASQ National Accreditation Board (ANAB; AR-1523).



For additional information or assistance concerning this or any other products from Wellington Laboratories Inc., please visit our website at www.well-labs.com or contact us directly at info@well-labs.com

Figure 1: MPFHxA; LC/MS Data (TIC and Mass Spectrum)

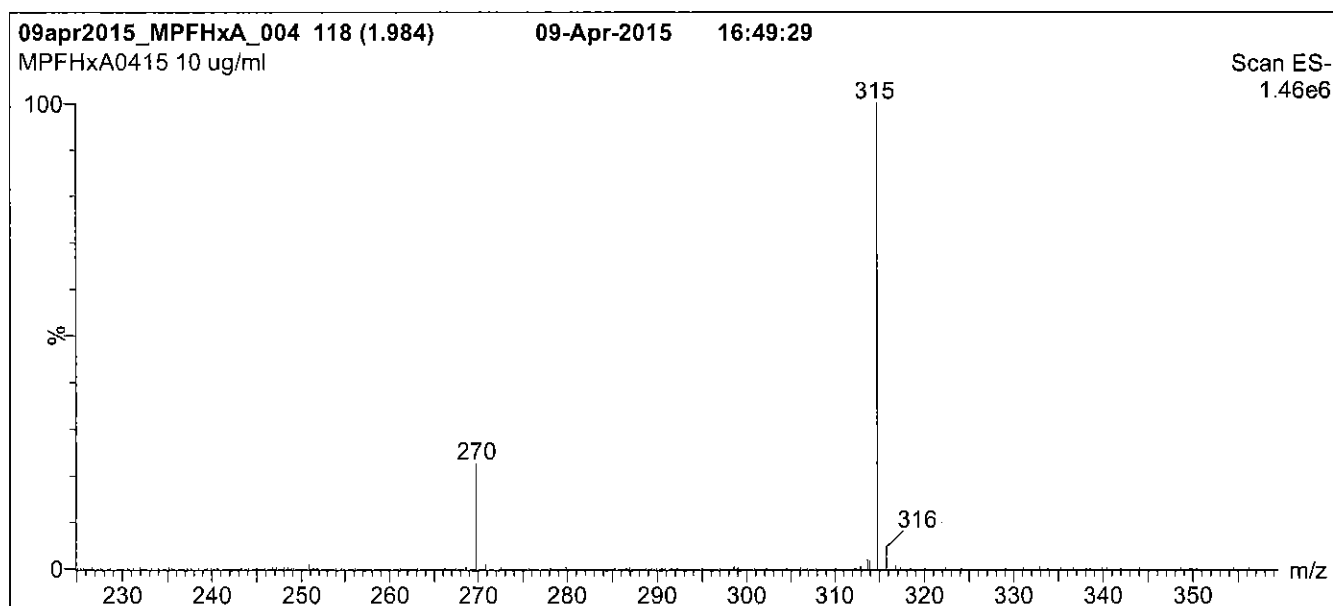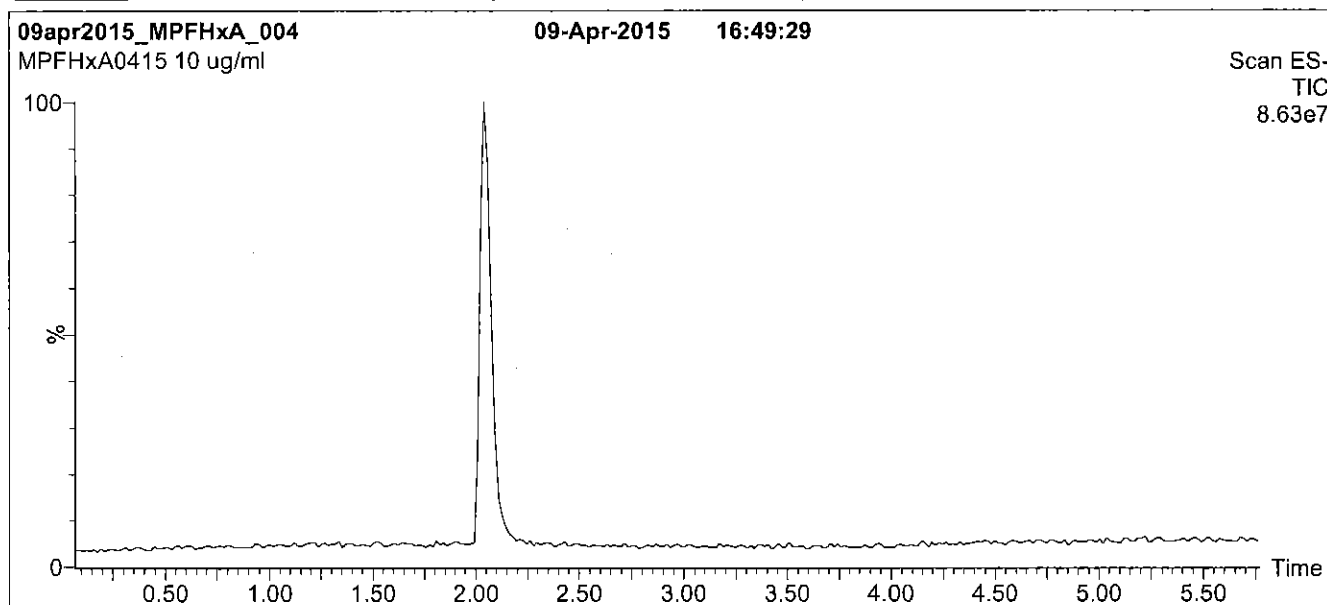

Conditions for Figure 1:

LC: Waters Acquity Ultra Performance LC
MS: Micromass Quattro micro API MS

Chromatographic Conditions

Column: Acquity UPLC BEH Shield RP₁₈
1.7 μ m, 2.1 x 100 mm

Mobile phase: Gradient
Start: 50% (80:20 MeOH:ACN) / 50% H₂O
(both with 10 mM NH₄OAc buffer)
Ramp to 90% organic over 7 min and hold for 2 min
before returning to initial conditions over 0.5 min.
Time: 10 min


Flow: 300 μ l/min

MS Parameters

Experiment: Full Scan (225 - 850 amu)

Source: Electrospray (negative)
Capillary Voltage (kV) = 2.00
Cone Voltage (V) = 15.00
Cone Gas Flow (l/hr) = 100
Desolvation Gas Flow (l/hr) = 750

Figure 2: MPFHxA; LC/MS/MS Data (Selected MRM Transitions)

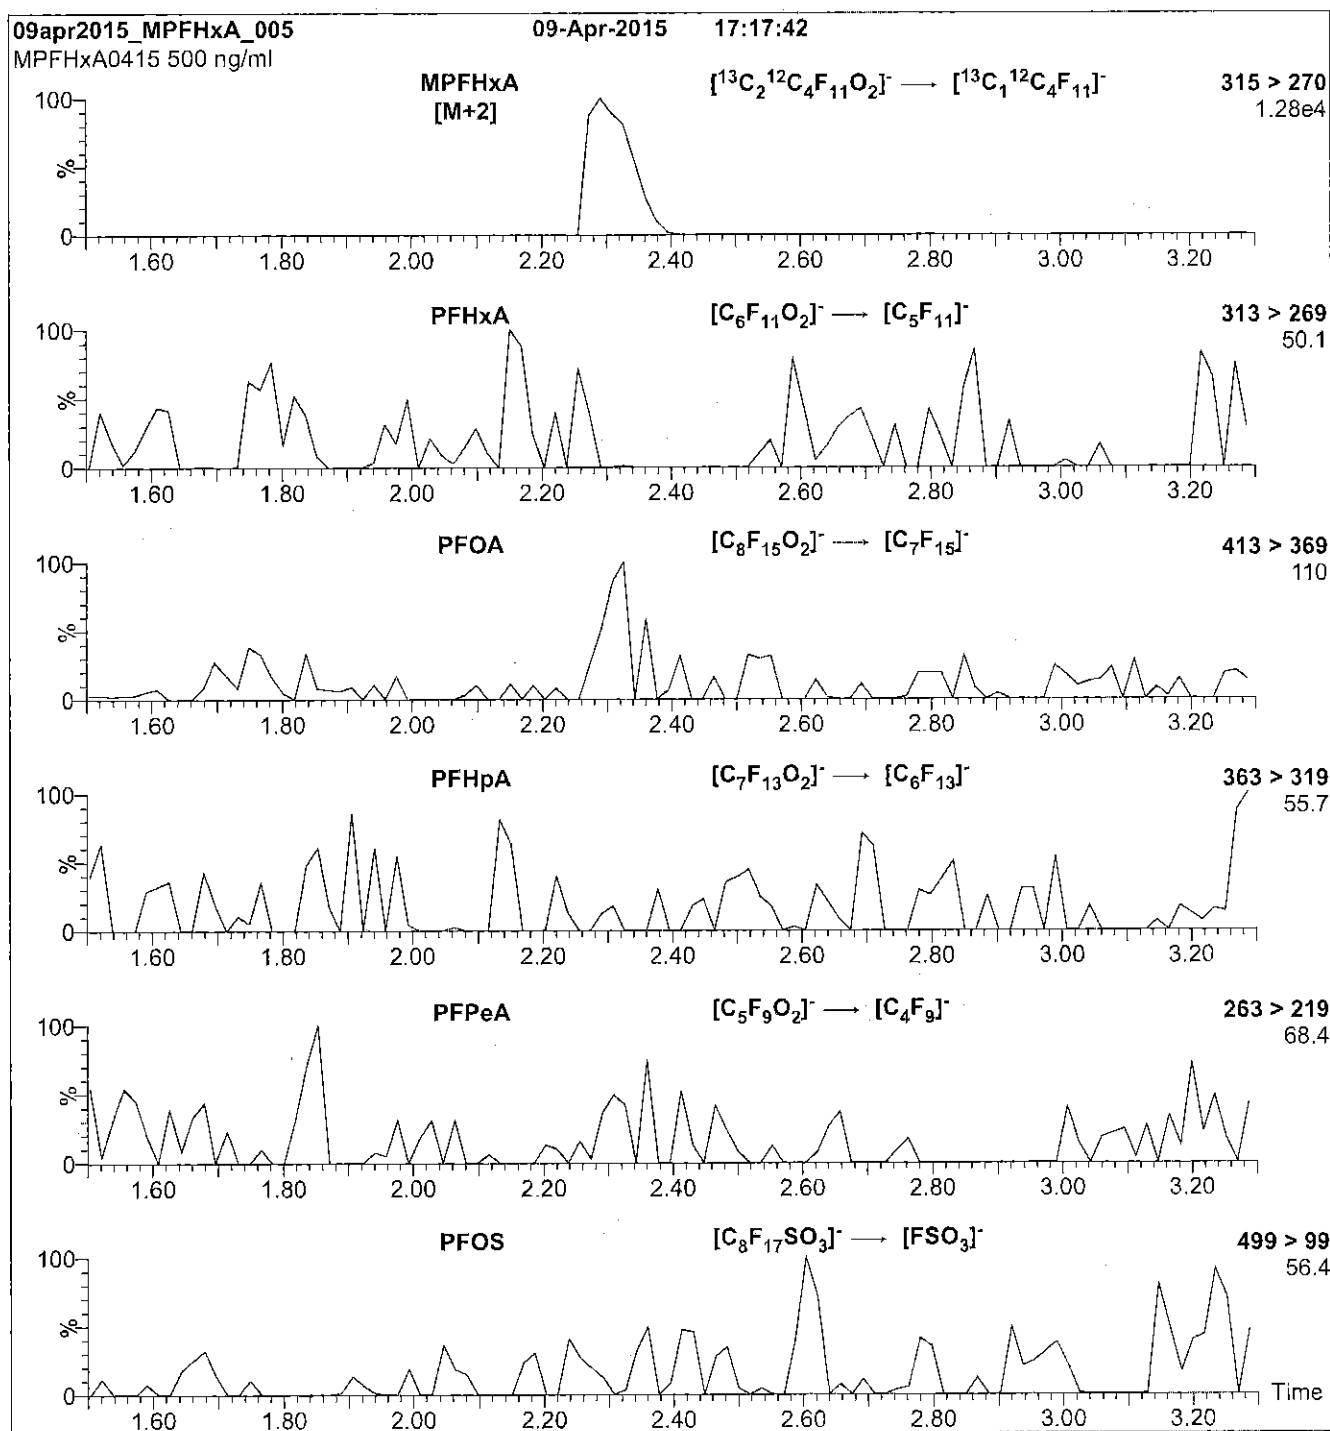

Conditions for Figure 2:

Injection: Direct loop injection
10 μ l (500 ng/ml MPFHxA)

Mobile phase: Isocratic 80% (80:20 MeOH:ACN) / 20% H₂O
(both with 10 mM NH₄OAc buffer)

Flow: 300 μ l/min

MS Parameters

Collision Gas (mbar) = 3.20e-3
Collision Energy (eV) = 10

Reagent

LCMPFOS_00018

R: SBC 9/22/16



738686

ID: LCMFOS_00018

Exp: 08/03/21 Prod: SBC

13C4-Perfluorooctanesulfo



WELLINGTON LABORATORIES

CERTIFICATE OF ANALYSIS DOCUMENTATION

PRODUCT CODE:

MPFOS

LOT NUMBER:

MPFOS0816


COMPOUND:

Sodium perfluoro-1-[1,2,3,4-¹³C]₄octanesulfonate

STRUCTURE:

CAS #:

Not available

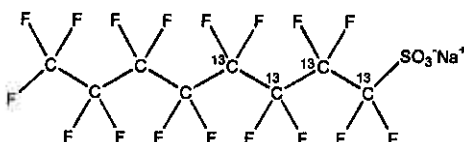

MOLECULAR FORMULA:

¹³C₄¹²C₄F₁₇SO₃Na

CONCENTRATION:

50.0 ± 2.5 µg/ml (Na salt)

47.8 ± 2.4 µg/ml (MPFOS anion)

CHEMICAL PURITY:

>98%

LAST TESTED: (mm/dd/yyyy)

08/03/2016

EXPIRY DATE: (mm/dd/yyyy)

08/03/2021

RECOMMENDED STORAGE:

Store ampoule in a cool, dark place

MOLECULAR WEIGHT:

526.08

SOLVENT(S):

Methanol

ISOTOPIC PURITY:

≥99% ¹³C
(1,2,3,4-¹³C₄)

DOCUMENTATION/ DATA ATTACHED:

Figure 1: LC/MS Data (TIC and Mass Spectrum)

Figure 2: LC/MS/MS Data (Selected MRM Transitions)

ADDITIONAL INFORMATION:

- See page 2 for further details.
- Contains ~ 0.8% Sodium perfluoro-1-[1,2,3-¹³C]₃heptanesulfonate.

FOR LABORATORY USE ONLY: NOT FOR HUMAN OR DRUG USE

Certified By:

B.G. Chittim

Date: 08/05/2016

(mm/dd/yyyy)

Wellington Laboratories Inc., 345 Southgate Dr. Guelph ON N1G 3M5 CANADA
519-822-2436 • Fax: 519-822-2849 • info@well-labs.com

INTENDED USE:

The products prepared by Wellington Laboratories Inc. are for laboratory use only. This certified reference material (CRM) was designed to be used as a standard for the identification and/or quantification of the specific chemical compound it contains.

HAZARDS:

This product should only be used by qualified personnel familiar with its potential hazards and trained in the handling of hazardous chemicals. Due care should be exercised to prevent unnecessary human contact or ingestion. All procedures should be carried out in a well-functioning fume hood and suitable gloves, eye protection, and clothing should be worn at all times. Waste should be disposed of according to national and regional regulations. Safety Data Sheets (SDSs) are available upon request.

SYNTHESIS / CHARACTERIZATION:

Where possible, all of our products are synthesized using single-product unambiguous routes. They are then characterized, and their structures and purities confirmed, using a combination of the most relevant techniques, such as NMR, GC/MS, LC/MS/MS, SFC/UV/MS/MS, x-ray crystallography, and melting point. Isotopic purities of mass-labelled compounds are also confirmed using HRGC/HRMS and/or LC/MS/MS.

HOMOGENEITY:

Prior to solution preparation, crystalline material is tested for homogeneity using a variety of techniques (as stated above) and its solubility in a given diluent is taken into consideration. Duplicate solutions of a new product are prepared from the same crystalline lot and, after the addition of an appropriate internal standard, they are compared by GC/MS, LC/MS/MS and/or SFC/UV/MS/MS. The relative response factors of the analyte of interest in each solution are required to be <5% RSD. New solution lots of existing products are compared to older lots in the same manner, which further confirms the homogeneity of the crystalline material as well as the stability and homogeneity of the solutions in the storage containers.

UNCERTAINTY:

The maximum combined relative standard uncertainty of our reference standard solutions is calculated using the following equation:

The combined relative standard uncertainty, $u_c(y)$, of a value y and the uncertainty of the independent parameters $x_1, x_2, \dots, x_n$ on which it depends is:

$$u_c(y(x_1, x_2, \dots, x_n)) = \sqrt{\sum_{i=1}^n u(y, x_i)^2}$$

where x is expressed as a relative standard uncertainty of the individual parameter.

The individual uncertainties taken into account include those associated with weights (calibration of the balance) and volumes (calibration of the volumetric glassware). An expanded maximum combined percent relative uncertainty of $\pm 5\%$ (calculated with a coverage factor of 2 and a level of confidence of 95%) is stated on the Certificate of Analysis for all of our products.

TRACEABILITY:

All reference standard solutions are traceable to specific crystalline lots. The microbalances used for solution preparation are regularly tested by an external ISO/IEC 17025 accredited calibration company. In addition, their calibration is verified prior to each weighing using NIST and/or NRC traceable external weights. All volumetric glassware used is of Class A tolerance and has been tested according to the appropriate ASTM procedures, which are ultimately traceable to NIST. For certain products, traceability to international interlaboratory studies has also been established.

EXPIRY DATE / PERIOD OF VALIDITY:


Ongoing stability studies of this product have demonstrated stability in its composition and concentration, until the specified expiry date, in the unopened ampoule. Monitoring for any degradation or change in concentration of the listed analyte(s) is performed on a routine basis.

LIMITED WARRANTY:

At the time of shipment, all products are warranted to be free of defects in material and workmanship and to conform to the stated technical and purity specifications.



QUALITY MANAGEMENT:

This product was produced using a Quality Management System registered to the latest versions of ISO 9001 by SAI Global, ISO/IEC 17025 by the Canadian Association for Laboratory Accreditation Inc. (CALA; A 1226), and ISO GUIDE 34 by ANSI-ASQ National Accreditation Board (ANAB; AR-1523).



For additional information or assistance concerning this or any other products from Wellington Laboratories Inc., please visit our website at www.well-labs.com or contact us directly at info@well-labs.com

Figure 1: MPFOS; LC/MS Data (TIC and Mass Spectrum)

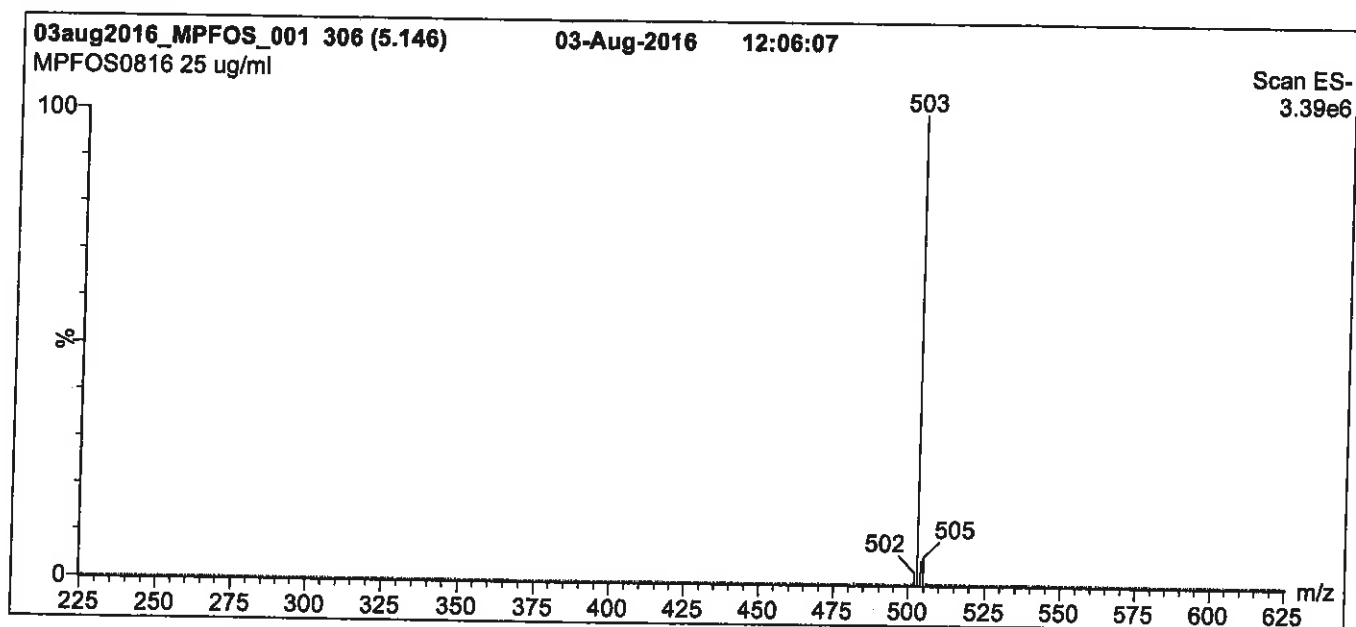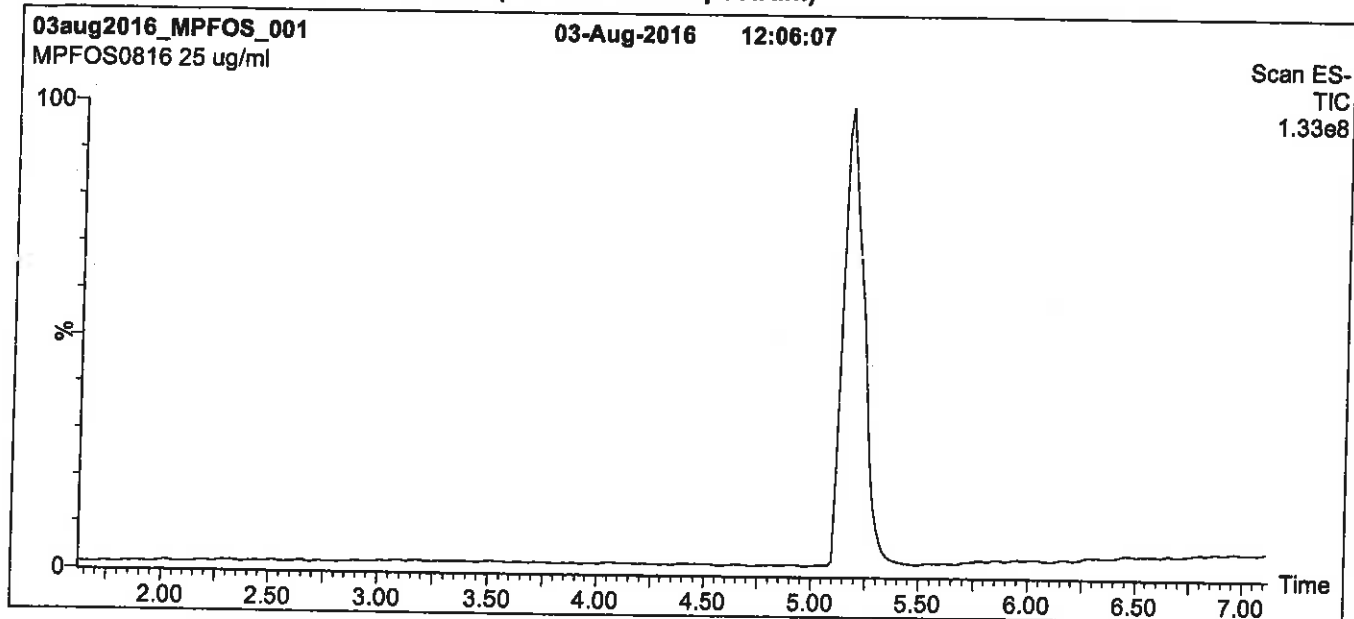

Conditions for Figure 1:

LC: Waters Acquity Ultra Performance LC
MS: Micromass Quattro micro API MS

Chromatographic Conditions

Column: Acquity UPLC BEH Shield RP₁₈
1.7 μ m, 2.1 x 100 mm

Mobile phase: Gradient

Start: 45% (80:20 MeOH:ACN) / 55% H₂O
(both with 10 mM NH₄OAc buffer)

Ramp to 90% organic over 7 min and hold for 1.5 min
before returning to initial conditions in 0.5 min.

Time: 10 min

MS Parameters

Experiment: Full Scan (225 - 850 amu)

Source: Electrospray (negative)

Capillary Voltage (kV) = 3.00


Cone Voltage (V) = 60.00

Cone Gas Flow (l/hr) = 50

Desolvation Gas Flow (l/hr) = 750

Flow: 300 μ l/min

Figure 2: MPFOS; LC/MS/MS Data (Selected MRM Transitions)

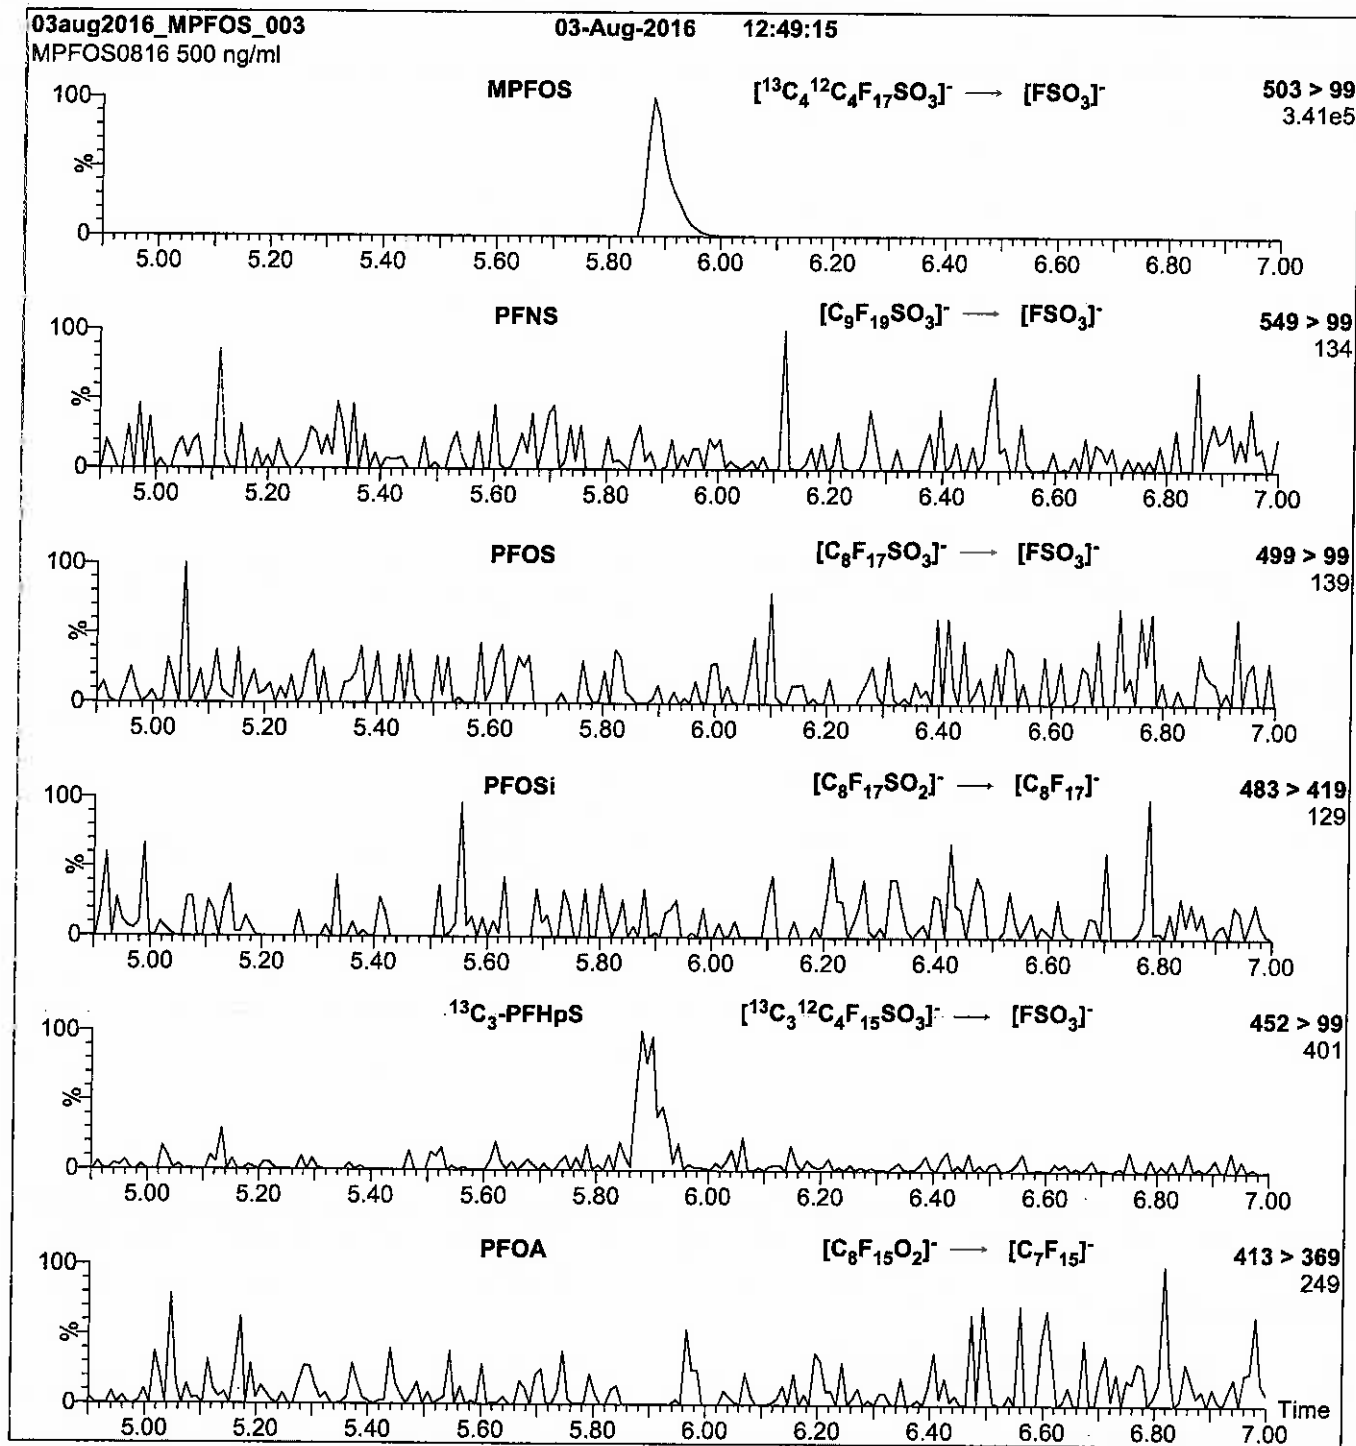

Conditions for Figure 2:

Injection: Direct loop injection
10 μl (500 ng/ml MPFOS)

Mobile phase: Isocratic 80% (80:20 MeOH:ACN) / 20% H_2O
(both with 10 mM NH_4OAc buffer)

Flow: 300 $\mu\text{l}/\text{min}$

MS Parameters

Collision Gas (mbar) = 3.46e-3
Collision Energy (eV) = 40

Method 537 DOD

Perfluorinated Alkyl Acids (LC/MS)
by Method 537 DOD

FORM II
LCMS SURROGATE RECOVERY

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Matrix: Water

Level: Low

GC Column (1): Acquity ID: 2.1 (mm)

Client Sample ID	Lab Sample ID	PFHxA #	PFDA #
WI-CV-1RW53-0117	320-25078-1	112	108
WI-CV-1FB53-0117	320-25078-2	115	108
WI-CV-1RW54-0117	320-25078-3	115	112
WI-CV-1FB54-0117	320-25078-4	122	115
WI-CV-1RW55-0117	320-25078-5	124	122
WI-CV-1FB55-0117	320-25078-6	122	111
WI-CV-1RW56-0117	320-25078-7	115	110
WI-CV-1FB56-0117	320-25078-8	114	108
WI-CV-1RW57-0117	320-25078-9	111	116
WI-CV-1FB57-0117	320-25078-10	119	115
WI-CV-1RW58-0117	320-25078-11	112	108
WI-CV-1FB58-0117	320-25078-12	122	111
	MB 320-147025/1-A	111	110
	LCS 320-147025/2-A	127	122
	LCSD 320-147025/3-A	124	125

PFHxA = 13C2 PFHxA
PFDA = 13C2 PFDA

QC LIMITS
70-130
70-130

Column to be used to flag recovery values

FORM III
LCMS LAB CONTROL SAMPLE RECOVERY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
SDG No.: _____
Matrix: Water Level: Low Lab File ID: 20JAN2016A6A_065.d
Lab ID: LCS 320-147025/2-A Client ID: _____

COMPOUND	SPIKE ADDED (ug/L)	LCS CONCENTRATION (ug/L)	LCS % REC	QC LIMITS REC	#
Perfluorooctanesulfonic acid (PFOS)	0.160	0.158	99	70-130	
Perfluorooctanoic acid (PFOA)	0.0781	0.0726	93	70-130	
Perfluorobutanesulfonic acid (PFBS)	0.359	0.304	85	70-130	

Column to be used to flag recovery and RPD values

FORM III
LCMS LAB CONTROL SAMPLE DUPLICATE RECOVERY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Matrix: Water Level: Low Lab File ID: 20JAN2016A6A_066.d
 Lab ID: LCSD 320-147025/3-A Client ID: _____

COMPOUND	SPIKE ADDED (ug/L)	LCSD CONCENTRATION (ug/L)	LCSD % REC	% RPD	QC LIMITS		#
					RPD	REC	
Perfluorooctanesulfonic acid (PFOS)	0.160	0.160	100	1	30	70-130	
Perfluorooctanoic acid (PFOA)	0.0781	0.0782	100	7	30	70-130	
Perfluorobutanesulfonic acid (PFBS)	0.359	0.290	81	5	30	70-130	

Column to be used to flag recovery and RPD values

FORM IV
LCMS METHOD BLANK SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Lab File ID: 20JAN2016A6A_064.d Lab Sample ID: MB 320-147025/1-A
 Matrix: Water Date Extracted: 01/19/2017 14:14
 Instrument ID: A6 Date Analyzed: 01/21/2017 18:20
 Level: (Low/Med) Low

THIS METHOD BLANK APPLIES TO THE FOLLOWING SAMPLES:

CLIENT SAMPLE ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED
	LCS 320-147025/2-A	20JAN2016A6 A 065.d	01/21/2017 18:50
	LCSD 320-147025/3-A	20JAN2016A6 A 066.d	01/21/2017 19:19
WI-CV-1RW53-0117	320-25078-1	20JAN2016A6 A 077.d	01/22/2017 00:45
WI-CV-1FB53-0117	320-25078-2	20JAN2016A6 A 078.d	01/22/2017 01:15
WI-CV-1RW54-0117	320-25078-3	20JAN2016A6 A 079.d	01/22/2017 01:44
WI-CV-1FB54-0117	320-25078-4	20JAN2016A6 A 080.d	01/22/2017 02:14
WI-CV-1RW55-0117	320-25078-5	20JAN2016A6 A 081.d	01/22/2017 02:44
WI-CV-1FB55-0117	320-25078-6	20JAN2016A6 A 082.d	01/22/2017 03:13
WI-CV-1RW56-0117	320-25078-7	20JAN2016A6 A 083.d	01/22/2017 03:43
WI-CV-1FB56-0117	320-25078-8	20JAN2016A6 A 084.d	01/22/2017 04:12
WI-CV-1RW57-0117	320-25078-9	20JAN2016A6 A 085.d	01/22/2017 04:42
WI-CV-1FB57-0117	320-25078-10	20JAN2016A6 A 088.d	01/22/2017 06:11
WI-CV-1RW58-0117	320-25078-11	20JAN2016A6 A 089.d	01/22/2017 06:40
WI-CV-1FB58-0117	320-25078-12	20JAN2016A6 A 090.d	01/22/2017 07:10

FORM VIII
LCMS INTERNAL STANDARD AREA AND RETENTION TIME SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Instrument ID: A6 Calibration Start Date: 01/20/2017 13:11
 GC Column: Acquity ID: 2.1 (mm) Calibration End Date: 01/20/2017 15:40
 Calibration ID: 27741

		13PFOA		PFOS			
		AREA #	RT #	AREA #	RT #	AREA #	RT #
INITIAL CALIBRATION MEAN AREA AND MEAN RT		569029	20.16	1159247	20.79		
UPPER LIMIT		853544	20.66	1738871	21.29		
LOWER LIMIT		284515	19.66	579624	20.29		
LAB SAMPLE ID	CLIENT SAMPLE ID						
CCV 320-147198/10 CCVL		565892	20.15	1158929	20.80		
ICV 320-147198/12		545066	20.15	1069204	20.79		
CCV 320-147271/60 CCVIS		728835	20.15	1446705	20.79		
MB 320-147025/1-A		758107	20.14	1450316	20.79		
LCS 320-147025/2-A		682158	20.14	1227030	20.77		
LCSD 320-147025/3-A		671066	20.14	1216067	20.77		
CCV 320-147271/116 CCVIS		800746	20.13	1348380	20.77		
CCV 320-147339/116 CCVIS		800746	20.13	1348380	20.77		
320-25078-1	WI-CV-1RW53-0117	715272	20.13	1331514	20.77		
320-25078-2	WI-CV-1FB53-0117	783161	20.14	1413384	20.80		
320-25078-3	WI-CV-1RW54-0117	734826	20.14	1396879	20.79		
320-25078-4	WI-CV-1FB54-0117	748889	20.14	1356692	20.77		
320-25078-5	WI-CV-1RW55-0117	703008	20.13	1382688	20.77		
320-25078-6	WI-CV-1FB55-0117	733656	20.13	1423433	20.76		
320-25078-7	WI-CV-1RW56-0117	715691	20.13	1416190	20.76		
320-25078-8	WI-CV-1FB56-0117	799586	20.13	1378889	20.76		
320-25078-9	WI-CV-1RW57-0117	719644	20.14	1391753	20.77		
CCV 320-147339/129 CCVIS		762579	20.13	1398329	20.77		
CCV 320-147340/129 CCVIS		762579	20.13	1398329	20.77		
320-25078-10	WI-CV-1FB57-0117	732006	20.13	1385629	20.76		
320-25078-11	WI-CV-1RW58-0117	740164	20.13	1393613	20.76		
320-25078-12	WI-CV-1FB58-0117	728702	20.13	1371116	20.77		
CCV 320-147340/133 CCVIS		775762	20.13	1298870	20.76		

13PFOA = 13C2-PFOA

PFOS = 13C4 PFOS

Area Limit = 50%-150% of internal standard area

RT Limit = $\pm$ 0.5 minutes of internal standard RT

Column used to flag values outside QC limits

FORM VIII
LCMS INTERNAL STANDARD AREA AND RETENTION TIME SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Sample No.: CCV 320-147271/60 Date Analyzed: 01/21/2017 17:21
 Instrument ID: A6 GC Column: Acquity ID: 2.1 (mm)
 Lab File ID (Standard): 20JAN2016A6A_062.d Heated Purge: (Y/N) N
 Calibration ID: 27741

	13PFOA		PFOS			
	AREA #	RT #	AREA #	RT #	AREA #	RT #
12/24 HOUR STD	728835	20.15	1446705	20.79		
UPPER LIMIT	1020369	20.65	2025387	21.29		
LOWER LIMIT	510185	19.65	1012694	20.29		
LAB SAMPLE ID	CLIENT SAMPLE ID					
MB 320-147025/1-A		758107	20.14	1450316	20.79	
LCS 320-147025/2-A		682158	20.14	1227030	20.77	
LCSD 320-147025/3-A		671066	20.14	1216067	20.77	

13PFOA = 13C2-PFOA
 PFOS = 13C4 PFOS

Area Limit = 70%-140% of internal standard area
 RT Limit = $\pm$ 0.5 minutes of internal standard RT

Column used to flag values outside QC limits

FORM VIII
LCMS INTERNAL STANDARD AREA AND RETENTION TIME SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Sample No.: CCV 320-147271/116 Date Analyzed: 01/21/2017 23:16
 Instrument ID: A6 GC Column: Acquity ID: 2.1 (mm)
 Lab File ID (Standard): 20JAN2016A6A_074.d Heated Purge: (Y/N) N
 Calibration ID: 27741

	13PFOA		PFOS			
	AREA #	RT #	AREA #	RT #	AREA #	RT #
12/24 HOUR STD	800746	20.13	1348380	20.77		
UPPER LIMIT	1121044	20.63	1887732	21.27		
LOWER LIMIT	560522	19.63	943866	20.27		
LAB SAMPLE ID	CLIENT SAMPLE ID					
MB 320-147025/1-A		758107	20.14	1450316	20.79	
LCS 320-147025/2-A		682158	20.14	1227030	20.77	
LCSD 320-147025/3-A		671066	20.14	1216067	20.77	

13PFOA = 13C2-PFOA
 PFOS = 13C4 PFOS

Area Limit = 70%-140% of internal standard area
 RT Limit = $\pm$ 0.5 minutes of internal standard RT

Column used to flag values outside QC limits

FORM VIII
LCMS INTERNAL STANDARD AREA AND RETENTION TIME SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Sample No.: CCV 320-147339/116 Date Analyzed: 01/21/2017 23:16
 Instrument ID: A6 GC Column: Acquity ID: 2.1 (mm)
 Lab File ID (Standard): 20JAN2016A6A_074.d Heated Purge: (Y/N) N
 Calibration ID: 27741

		13PFOA		PFOS			
		AREA #	RT #	AREA #	RT #	AREA #	RT #
12/24 HOUR STD		800746	20.13	1348380	20.77		
UPPER LIMIT		1121044	20.63	1887732	21.27		
LOWER LIMIT		560522	19.63	943866	20.27		
LAB SAMPLE ID	CLIENT SAMPLE ID						
320-25078-1	WI-CV-1RW53-0117	715272	20.13	1331514	20.77		
320-25078-2	WI-CV-1FB53-0117	783161	20.14	1413384	20.80		
320-25078-3	WI-CV-1RW54-0117	734826	20.14	1396879	20.79		
320-25078-4	WI-CV-1FB54-0117	748889	20.14	1356692	20.77		
320-25078-5	WI-CV-1RW55-0117	703008	20.13	1382688	20.77		
320-25078-6	WI-CV-1FB55-0117	733656	20.13	1423433	20.76		
320-25078-7	WI-CV-1RW56-0117	715691	20.13	1416190	20.76		
320-25078-8	WI-CV-1FB56-0117	799586	20.13	1378889	20.76		
320-25078-9	WI-CV-1RW57-0117	719644	20.14	1391753	20.77		

13PFOA = 13C2-PFOA

PFOS = 13C4 PFOS

Area Limit = 70%-140% of internal standard area

RT Limit = $\pm$ 0.5 minutes of internal standard RT

Column used to flag values outside QC limits

FORM VIII
LCMS INTERNAL STANDARD AREA AND RETENTION TIME SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Sample No.: CCV 320-147339/129 Date Analyzed: 01/22/2017 05:12
 Instrument ID: A6 GC Column: Acquity ID: 2.1 (mm)
 Lab File ID (Standard): 20JAN2016A6A_086.d Heated Purge: (Y/N) N
 Calibration ID: 27741

	13PFOA		PFOS			
	AREA #	RT #	AREA #	RT #	AREA #	RT #
12/24 HOUR STD	762579	20.13	1398329	20.77		
UPPER LIMIT	1067611	20.63	1957661	21.27		
LOWER LIMIT	533805	19.63	978830	20.27		
LAB SAMPLE ID	CLIENT SAMPLE ID					
320-25078-1	WI-CV-1RW53-0117	715272	20.13	1331514	20.77	
320-25078-2	WI-CV-1FB53-0117	783161	20.14	1413384	20.80	
320-25078-3	WI-CV-1RW54-0117	734826	20.14	1396879	20.79	
320-25078-4	WI-CV-1FB54-0117	748889	20.14	1356692	20.77	
320-25078-5	WI-CV-1RW55-0117	703008	20.13	1382688	20.77	
320-25078-6	WI-CV-1FB55-0117	733656	20.13	1423433	20.76	
320-25078-7	WI-CV-1RW56-0117	715691	20.13	1416190	20.76	
320-25078-8	WI-CV-1FB56-0117	799586	20.13	1378889	20.76	
320-25078-9	WI-CV-1RW57-0117	719644	20.14	1391753	20.77	

13PFOA = 13C2-PFOA

PFOS = 13C4 PFOS

Area Limit = 70%-140% of internal standard area

RT Limit = $\pm$ 0.5 minutes of internal standard RT

Column used to flag values outside QC limits

FORM VIII
LCMS INTERNAL STANDARD AREA AND RETENTION TIME SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Sample No.: CCV 320-147340/129 Date Analyzed: 01/22/2017 05:12
 Instrument ID: A6 GC Column: Acquity ID: 2.1 (mm)
 Lab File ID (Standard): 20JAN2016A6A_086.d Heated Purge: (Y/N) N
 Calibration ID: 27741

	13PFOA		PFOS			
	AREA #	RT #	AREA #	RT #	AREA #	RT #
12/24 HOUR STD	762579	20.13	1398329	20.77		
UPPER LIMIT	1067611	20.63	1957661	21.27		
LOWER LIMIT	533805	19.63	978830	20.27		
LAB SAMPLE ID	CLIENT SAMPLE ID					
320-25078-10	WI-CV-1FB57-0117		732006	20.13	1385629	20.76
320-25078-11	WI-CV-1RW58-0117		740164	20.13	1393613	20.76
320-25078-12	WI-CV-1FB58-0117		728702	20.13	1371116	20.77

13PFOA = 13C2-PFOA
 PFOS = 13C4 PFOS

Area Limit = 70%-140% of internal standard area
 RT Limit = $\pm$ 0.5 minutes of internal standard RT

Column used to flag values outside QC limits

FORM VIII
LCMS INTERNAL STANDARD AREA AND RETENTION TIME SUMMARY

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Sample No.: CCV 320-147340/133 Date Analyzed: 01/22/2017 07:40
 Instrument ID: A6 GC Column: Acquity ID: 2.1 (mm)
 Lab File ID (Standard): 20JAN2016A6A_091.d Heated Purge: (Y/N) N
 Calibration ID: 27741

	13PFOA		PFOS			
	AREA #	RT #	AREA #	RT #	AREA #	RT #
12/24 HOUR STD	775762	20.13	1298870	20.76		
UPPER LIMIT	1086067	20.63	1818418	21.26		
LOWER LIMIT	543033	19.63	909209	20.26		
LAB SAMPLE ID	CLIENT SAMPLE ID					
320-25078-10	WI-CV-1FB57-0117		732006	20.13	1385629	20.76
320-25078-11	WI-CV-1RW58-0117		740164	20.13	1393613	20.76
320-25078-12	WI-CV-1FB58-0117		728702	20.13	1371116	20.77

13PFOA = 13C2-PFOA
 PFOS = 13C4 PFOS

Area Limit = 70%-140% of internal standard area
 RT Limit = $\pm$ 0.5 minutes of internal standard RT

Column used to flag values outside QC limits

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1RW53-0117 Lab Sample ID: 320-25078-1
 Matrix: Water Lab File ID: 20JAN2016A6A_077.d
 Analysis Method: 537 Date Collected: 01/16/2017 09:17
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 245.4 (mL) Date Analyzed: 01/22/2017 00:45
 Con. Extract Vol.: 1.0 (mL) Dilution Factor: 1
 Injection Volume: 10 (uL) GC Column: Acquity ID: 2.1 (mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.049	U M	0.061	0.049	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U M	0.031	0.024	0.0096
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	112		70-130
STL00996	13C2 PFDA	108		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_077.d
 Lims ID: 320-25078-A-1-A
 Client ID: WI-CV-1RW53-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 00:45:33 ALS Bottle#: 14 Worklist Smp#: 119
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-1-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:24:48

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.649 18.677 -0.028 1.000 880147 11.2 29281

4 Perfluoroheptanoic acid

M

363.0 > 319.0 19.474 19.476 -0.002 1.000 175 0.002291 0.2 M

* 5 13C2-PFOA

415.0 > 370.0 20.130 20.161 -0.031 715272 10.0 19632

6 Perfluorooctanoic acid

M

413.0 > 369.0 20.130 20.161 -0.031 1.000 4382 0.0562 1.7 M

7 Perfluorooctane sulfonic acid

M

499.0 > 80.0 20.774 20.766 0.008 1.000 674 0.0128 20.3 M

* 8 13C4 PFOS

503.0 > 80.0 20.774 20.793 -0.019 1331514 28.7 36237

\$ 10 13C2 PFDA

515.0 > 470.0 21.595 21.597 -0.002 1.000 744668 10.8 25185

QC Flag Legend

Review Flags

M - Manually Integrated

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_077.d

Injection Date: 22-Jan-2017 00:45:33

Instrument ID: A6

Lims ID: 320-25078-A-1-A

Lab Sample ID: 320-25078-1

Client ID: WI-CV-1RW53-0117

Operator ID: CBW

ALS Bottle#: 14

Worklist Smp#: 119

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)



4 Perfluoroheptanoic acid (M)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (M)

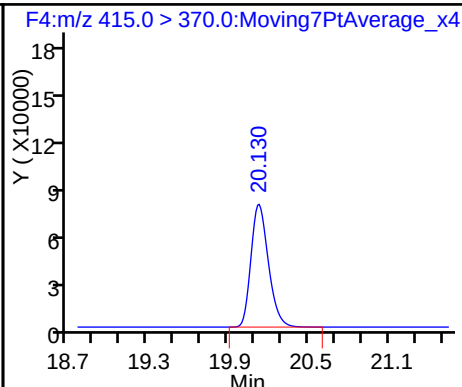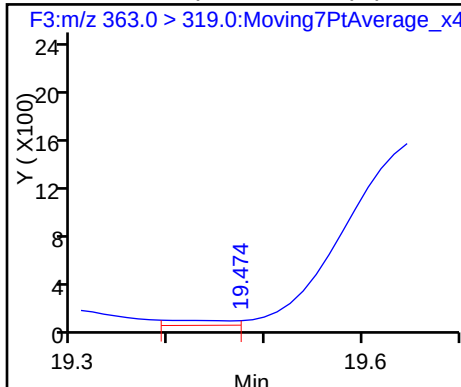


7 Perfluorooctane sulfonic acid (M)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)



\$ 10 13C2 PFDA

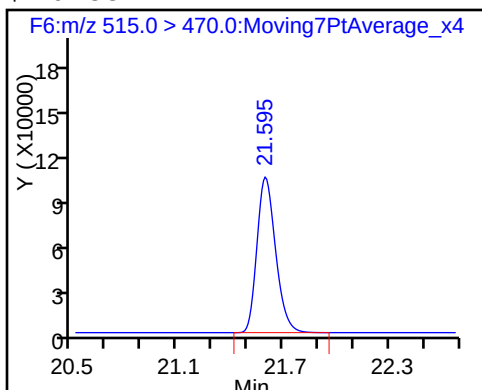

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_077.d
Lims ID: 320-25078-A-1-A
Client ID: WI-CV-1RW53-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 00:45:33 ALS Bottle#: 14 Worklist Smp#: 119
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-1-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:24:48

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	11.2	112.17
\$ 10 13C2 PFDA	10.0	10.8	108.09

TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_077.d
Injection Date: 22-Jan-2017 00:45:33 Instrument ID: A6
Lims ID: 320-25078-A-1-A Lab Sample ID: 320-25078-1
Client ID: WI-CV-1RW53-0117
Operator ID: CBW ALS Bottle#: 14 Worklist Smp#: 119
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F5:MRM

7 Perfluorooctane sulfonic acid, CAS: 1763-23-1


Signal: 1

Not Detected
Expected RT: 20.77

Processing Integration Results

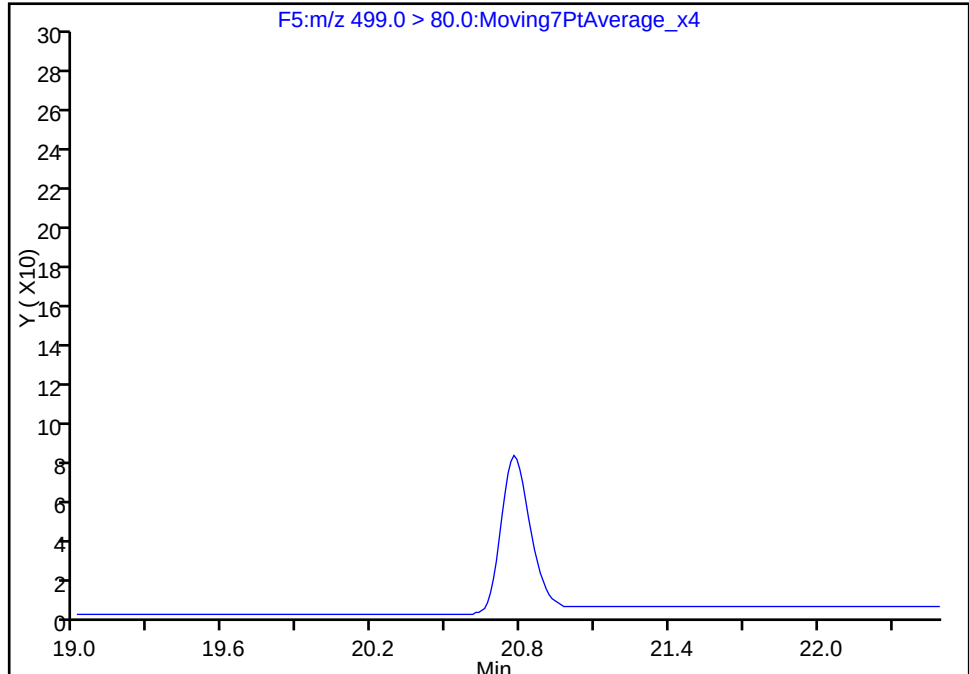

Manual Integration Results

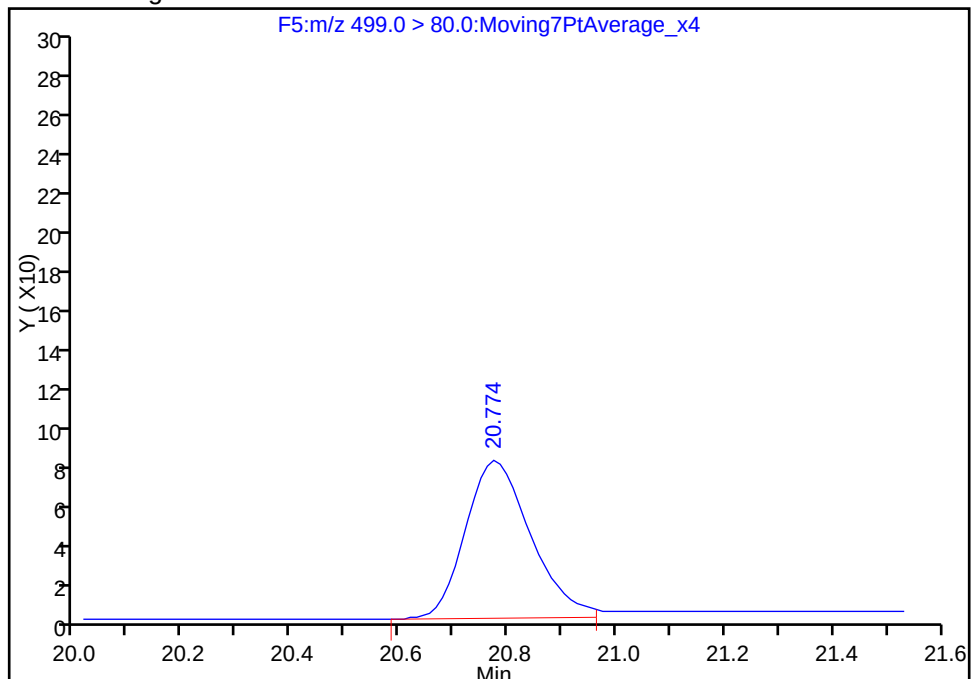

RT: 20.77
Area: 674
Amount: 0.012797
Amount Units: ng/ml

Reviewer: barnettj, 23-Jan-2017 13:24:48
Audit Action: Manually Integrated

Audit Reason: Missed Peak

TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_077.d
Injection Date: 22-Jan-2017 00:45:33 Instrument ID: A6
Lims ID: 320-25078-A-1-A Lab Sample ID: 320-25078-1
Client ID: WI-CV-1RW53-0117
Operator ID: CBW ALS Bottle#: 14 Worklist Smp#: 119
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F4:MRM

6 Perfluorooctanoic acid, CAS: 335-67-1

Signal: 1


RT: 20.13
Area: 3475
Amount: 0.044541
Amount Units: ng/ml

Processing Integration Results

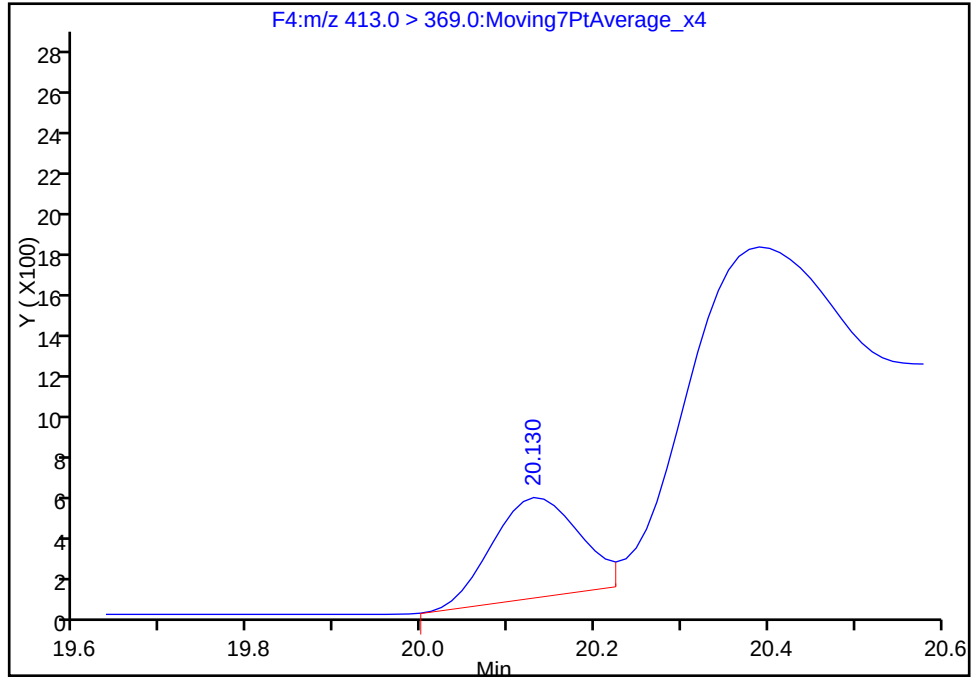

RT: 20.13
Area: 4382
Amount: 0.056167
Amount Units: ng/ml

Manual Integration Results

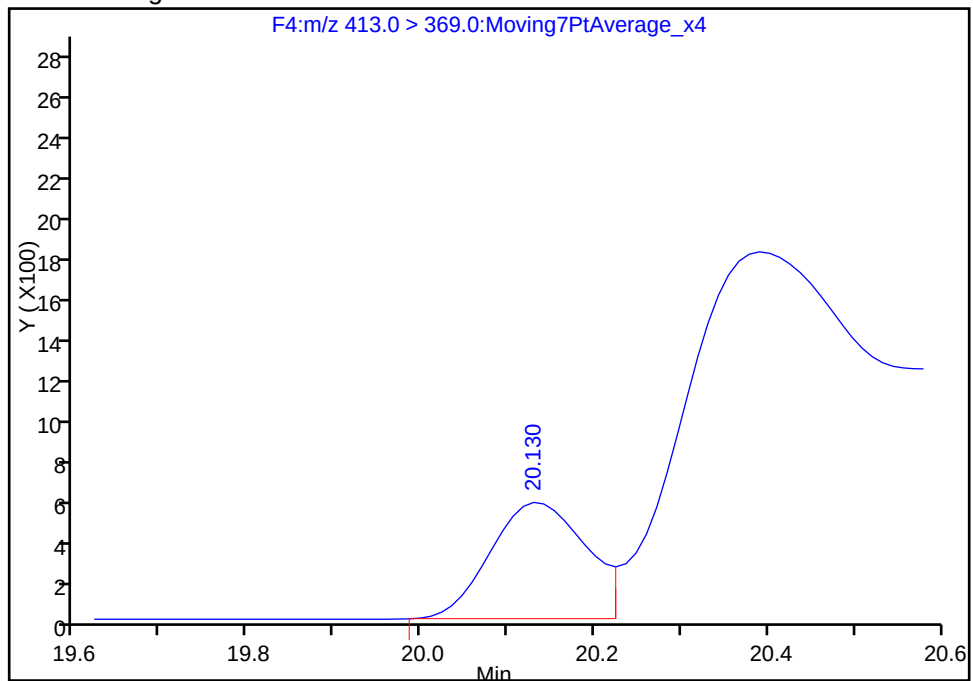

Reviewer: barnettj, 23-Jan-2017 13:24:48
Audit Action: Manually Integrated

Audit Reason: Baseline

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1FB53-0117 Lab Sample ID: 320-25078-2
 Matrix: Water Lab File ID: 20JAN2016A6A_078.d
 Analysis Method: 537 Date Collected: 01/16/2017 09:16
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 249.1 (mL) Date Analyzed: 01/22/2017 01:15
 Con. Extract Vol.: 1.0 (mL) Dilution Factor: 1
 Injection Volume: 10 (uL) GC Column: Acquity ID: 2.1 (mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0095
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	115		70-130
STL00996	13C2 PFDA	108		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_078.d
 Lims ID: 320-25078-A-2-A
 Client ID: WI-CV-1FB53-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 01:15:10 ALS Bottle#: 15 Worklist Smp#: 120
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-2-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:25:40

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.649 18.677 -0.028 1.000 986176 11.5 32692

* 5 13C2-PFOA

415.0 > 370.0 20.141 20.161 -0.020 783161 10.0 21617

* 8 13C4 PFOS

503.0 > 80.0 20.797 20.793 0.004 1413384 28.7 38512

\$ 10 13C2 PFDA

515.0 > 470.0 21.604 21.597 0.007 1.000 818118 10.8 27670

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_078.d

Injection Date: 22-Jan-2017 01:15:10

Instrument ID: A6

Lims ID: 320-25078-A-2-A

Lab Sample ID: 320-25078-2

Client ID: WI-CV-1FB53-0117

Operator ID: CBW

ALS Bottle#: 15

Worklist Smp#: 120

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)



4 Perfluoroheptanoic acid (ND)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (ND)




7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)



\$ 10 13C2 PFDA



TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_078.d
Lims ID: 320-25078-A-2-A
Client ID: WI-CV-1FB53-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 01:15:10 ALS Bottle#: 15 Worklist Smp#: 120
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-2-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:25:40

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	11.5	114.79
\$ 10 13C2 PFDA	10.0	10.8	108.46

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1RW54-0117 Lab Sample ID: 320-25078-3
 Matrix: Water Lab File ID: 20JAN2016A6A_079.d
 Analysis Method: 537 Date Collected: 01/16/2017 10:36
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 248.6(mL) Date Analyzed: 01/22/2017 01:44
 Con. Extract Vol.: 1.0(mL) Dilution Factor: 1
 Injection Volume: 10(uL) GC Column: Acquity ID: 2.1(mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0095
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	115		70-130
STL00996	13C2 PFDA	112		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_079.d
 Lims ID: 320-25078-A-3-A
 Client ID: WI-CV-1RW54-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 01:44:49 ALS Bottle#: 16 Worklist Smp#: 121
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-3-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:26:13

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.649 18.677 -0.028 1.000 930664 11.5 31180

* 5 13C2-PFOA

415.0 > 370.0 20.141 20.161 -0.020 734826 10.0 20351

* 8 13C4 PFOS

503.0 > 80.0 20.785 20.793 -0.008 1396879 28.7 37948

\$ 10 13C2 PFDA

515.0 > 470.0 21.595 21.597 -0.002 1.000 794682 11.2 27039

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_079.d

Injection Date: 22-Jan-2017 01:44:49

Instrument ID: A6

Lims ID: 320-25078-A-3-A

Lab Sample ID: 320-25078-3

Client ID: WI-CV-1RW54-0117

Operator ID: CBW

ALS Bottle#: 16

Worklist Smp#: 121

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537_A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)

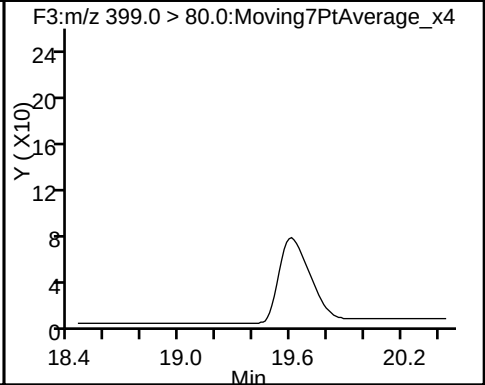

4 Perfluoroheptanoic acid (ND)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (ND)

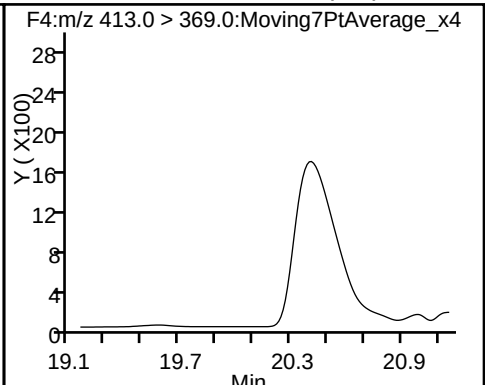


7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)



\$ 10 13C2 PFDA

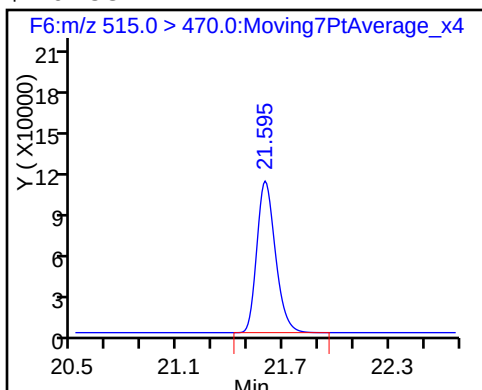

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_079.d
Lims ID: 320-25078-A-3-A
Client ID: WI-CV-1RW54-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 01:44:49 ALS Bottle#: 16 Worklist Smp#: 121
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-3-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:26:13

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	11.5	115.45
\$ 10 13C2 PFDA	10.0	11.2	112.28

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1FB54-0117 Lab Sample ID: 320-25078-4
 Matrix: Water Lab File ID: 20JAN2016A6A_080.d
 Analysis Method: 537 Date Collected: 01/16/2017 10:35
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 250.9(mL) Date Analyzed: 01/22/2017 02:14
 Con. Extract Vol.: 1.0(mL) Dilution Factor: 1
 Injection Volume: 10(uL) GC Column: Acquity ID: 2.1(mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.015
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.047

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	122		70-130
STL00996	13C2 PFDA	115		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_080.d
 Lims ID: 320-25078-A-4-A
 Client ID: WI-CV-1FB54-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 02:14:26 ALS Bottle#: 17 Worklist Smp#: 122
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-4-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:26:35

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.658 18.677 -0.019 1.000 999109 12.2 33260

* 5 13C2-PFOA

415.0 > 370.0 20.141 20.161 -0.020 748889 10.0 20547

* 8 13C4 PFOS

503.0 > 80.0 20.773 20.793 -0.020 1356692 28.7 36861

\$ 10 13C2 PFDA

515.0 > 470.0 21.595 21.597 -0.002 1.000 832363 11.5 28344

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_080.d

Injection Date: 22-Jan-2017 02:14:26

Instrument ID: A6

Lims ID: 320-25078-A-4-A

Lab Sample ID: 320-25078-4

Client ID: WI-CV-1FB54-0117

Operator ID: CBW

ALS Bottle#: 17

Worklist Smp#: 122

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)

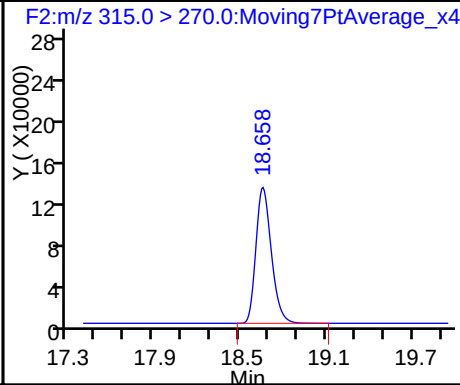

4 Perfluoroheptanoic acid (ND)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (ND)

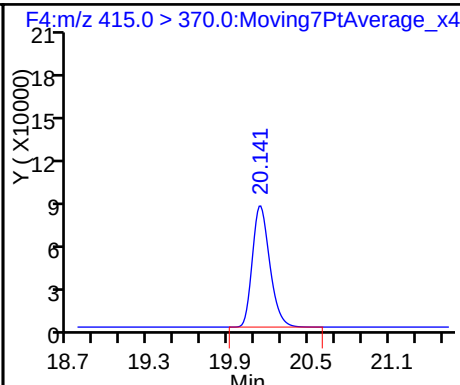


7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)

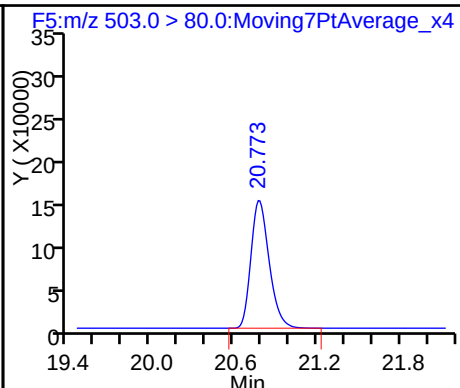

\$ 10 13C2 PFDA

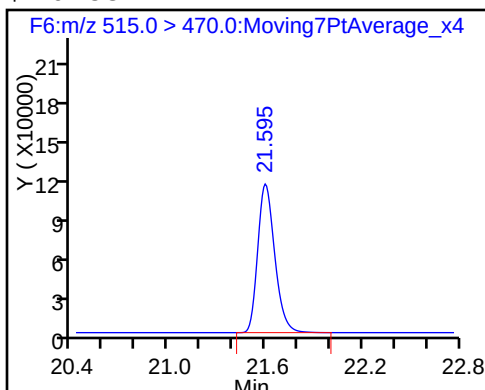

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_080.d
Lims ID: 320-25078-A-4-A
Client ID: WI-CV-1FB54-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 02:14:26 ALS Bottle#: 17 Worklist Smp#: 122
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-4-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:26:35

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	12.2	121.61
\$ 10 13C2 PFDA	10.0	11.5	115.40

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1RW55-0117 Lab Sample ID: 320-25078-5
 Matrix: Water Lab File ID: 20JAN2016A6A_081.d
 Analysis Method: 537 Date Collected: 01/16/2017 10:51
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 250.2 (mL) Date Analyzed: 01/22/2017 02:44
 Con. Extract Vol.: 1.0 (mL) Dilution Factor: 1
 Injection Volume: 10 (uL) GC Column: Acquity ID: 2.1 (mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.015
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U M	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	124		70-130
STL00996	13C2 PFDA	122		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_081.d
 Lims ID: 320-25078-A-5-A
 Client ID: WI-CV-1RW55-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 02:44:02 ALS Bottle#: 18 Worklist Smp#: 123
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-5-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:27:05

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.649 18.677 -0.028 1.000 955512 12.4 31812

* 5 13C2-PFOA

415.0 > 370.0 20.130 20.161 -0.031 703008 10.0 19510

6 Perfluorooctanoic acid

413.0 > 369.0 20.153 20.161 -0.008 1.000 944 0.0123 0.8 M

* 8 13C4 PFOS

503.0 > 80.0 20.774 20.793 -0.019 1382688 28.7 37745

\$ 10 13C2 PFDA

515.0 > 470.0 21.587 21.597 -0.010 1.000 825015 12.2 28025

QC Flag Legend

Review Flags

M - Manually Integrated

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_081.d

Injection Date: 22-Jan-2017 02:44:02

Instrument ID: A6

Lims ID: 320-25078-A-5-A

Lab Sample ID: 320-25078-5

Client ID: WI-CV-1RW55-0117

Operator ID: CBW

ALS Bottle#: 18

Worklist Smp#: 123

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)



4 Perfluoroheptanoic acid (ND)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (M)




7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)



\$ 10 13C2 PFDA

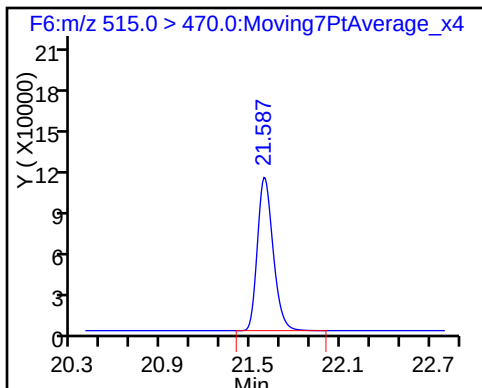

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_081.d
Lims ID: 320-25078-A-5-A
Client ID: WI-CV-1RW55-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 02:44:02 ALS Bottle#: 18 Worklist Smp#: 123
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-5-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:27:05

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	12.4	123.90
\$ 10 13C2 PFDA	10.0	12.2	121.84

TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_081.d
Injection Date: 22-Jan-2017 02:44:02 Instrument ID: A6
Lims ID: 320-25078-A-5-A Lab Sample ID: 320-25078-5
Client ID: WI-CV-1RW55-0117
Operator ID: CBW ALS Bottle#: 18 Worklist Smp#: 123
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F4:MRM

6 Perfluorooctanoic acid, CAS: 335-67-1

Signal: 1


RT: 20.40
Area: 16967
Amount: 0.221270
Amount Units: ng/ml

Processing Integration Results

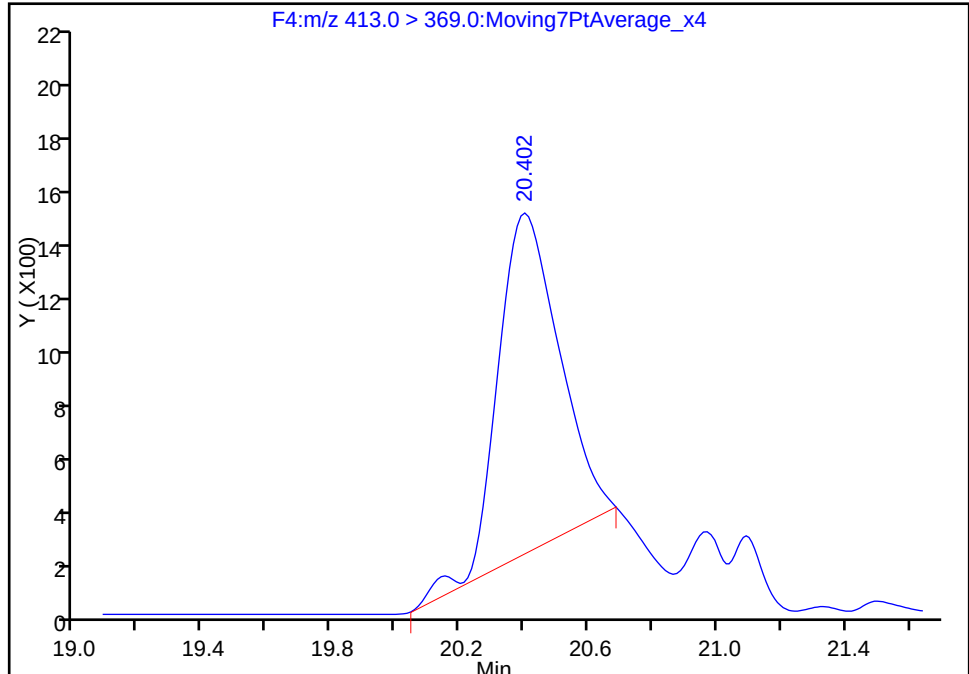

RT: 20.15
Area: 944
Amount: 0.012311
Amount Units: ng/ml

Manual Integration Results

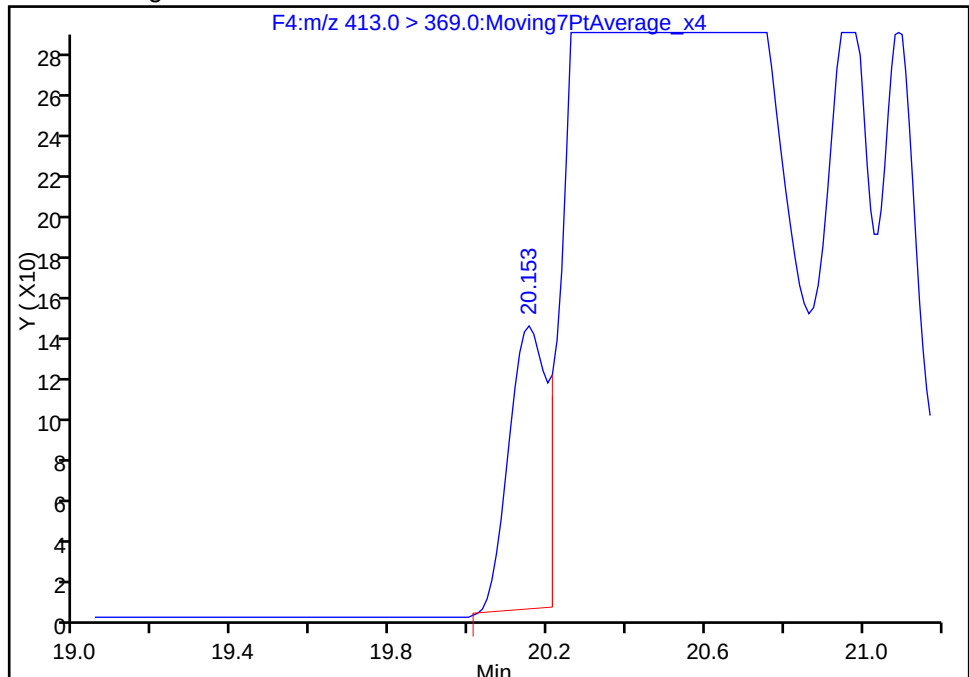

Reviewer: barnettj, 23-Jan-2017 13:27:05
Audit Action: Manually Integrated

Audit Reason: Split Peak
Page 105 of 218

01/24/2017

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1FB55-0117 Lab Sample ID: 320-25078-6
 Matrix: Water Lab File ID: 20JAN2016A6A_082.d
 Analysis Method: 537 Date Collected: 01/16/2017 10:50
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 247.7(mL) Date Analyzed: 01/22/2017 03:13
 Con. Extract Vol.: 1.0(mL) Dilution Factor: 1
 Injection Volume: 10(uL) GC Column: Acquity ID: 2.1(mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.061	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0095
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	122		70-130
STL00996	13C2 PFDA	111		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_082.d
 Lims ID: 320-25078-A-6-A
 Client ID: WI-CV-1FB55-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 03:13:38 ALS Bottle#: 19 Worklist Smp#: 124
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-6-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:27:23

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.649 18.677 -0.028 1.000 980836 12.2 32660

* 5 13C2-PFOA

415.0 > 370.0 20.130 20.161 -0.031 733656 10.0 20264

* 8 13C4 PFOS

503.0 > 80.0 20.762 20.793 -0.031 1423433 28.7 38984

\$ 10 13C2 PFDA

515.0 > 470.0 21.578 21.597 -0.019 1.000 786477 11.1 26770

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_082.d

Injection Date: 22-Jan-2017 03:13:38

Instrument ID: A6

Lims ID: 320-25078-A-6-A

Lab Sample ID: 320-25078-6

Client ID: WI-CV-1FB55-0117

Operator ID: CBW

ALS Bottle#: 19

Worklist Smp#: 124

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)



4 Perfluoroheptanoic acid (ND)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (ND)




7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)



\$ 10 13C2 PFDA

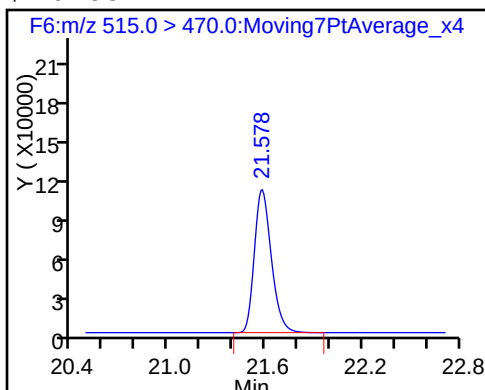

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_082.d
Lims ID: 320-25078-A-6-A
Client ID: WI-CV-1FB55-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 03:13:38 ALS Bottle#: 19 Worklist Smp#: 124
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-6-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:27:23

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	12.2	121.87
\$ 10 13C2 PFDA	10.0	11.1	111.30

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1RW56-0117 Lab Sample ID: 320-25078-7
 Matrix: Water Lab File ID: 20JAN2016A6A_083.d
 Analysis Method: 537 Date Collected: 01/16/2017 12:51
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 244.1 (mL) Date Analyzed: 01/22/2017 03:43
 Con. Extract Vol.: 1.0 (mL) Dilution Factor: 1
 Injection Volume: 10 (uL) GC Column: Acquity ID: 2.1 (mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.061	0.049	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.025	U M	0.031	0.025	0.0096
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.049

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	115		70-130
STL00996	13C2 PFDA	110		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_083.d
 Lims ID: 320-25078-A-7-A
 Client ID: WI-CV-1RW56-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 03:43:13 ALS Bottle#: 20 Worklist Smp#: 125
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-7-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:28:13

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.659 18.677 -0.018 1.000 904575 11.5 30264

4 Perfluoroheptanoic acid

M

363.0 > 319.0 19.498 19.476 0.022 1.000 588 0.007693 1.8 M

* 5 13C2-PFOA

415.0 > 370.0 20.130 20.161 -0.031 715691 10.0 19726

6 Perfluorooctanoic acid

M

413.0 > 369.0 20.141 20.161 -0.020 1.000 293 0.003753 0.2 M

* 8 13C4 PFOS

503.0 > 80.0 20.762 20.793 -0.031 1416190 28.7 31014

\$ 10 13C2 PFDA

515.0 > 470.0 21.578 21.597 -0.019 1.000 760749 11.0 25759

QC Flag Legend

Review Flags

M - Manually Integrated

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_083.d

Injection Date: 22-Jan-2017 03:43:13

Instrument ID: A6

Lims ID: 320-25078-A-7-A

Lab Sample ID: 320-25078-7

Client ID: WI-CV-1RW56-0117

Operator ID: CBW

ALS Bottle#: 20

Worklist Smp#: 125

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)



4 Perfluoroheptanoic acid (M)




* 5 13C2-PFOA

6 Perfluorooctanoic acid (M)




7 Perfluorooctane sulfonic acid (ND) * 8 13C4 PFOS

9 Perfluorononanoic acid (ND)



\$ 10 13C2 PFDA

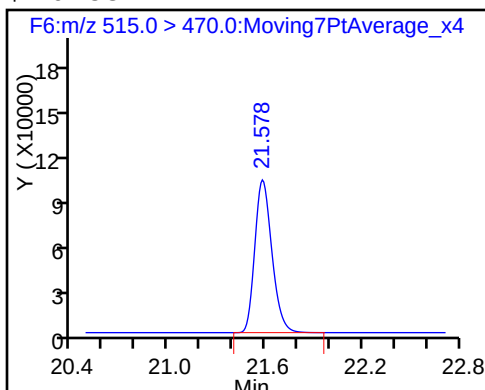

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_083.d
Lims ID: 320-25078-A-7-A
Client ID: WI-CV-1RW56-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 03:43:13 ALS Bottle#: 20 Worklist Smp#: 125
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-7-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:28:13

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	11.5	115.21
\$ 10 13C2 PFDA	10.0	11.0	110.36

TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_083.d
Injection Date: 22-Jan-2017 03:43:13 Instrument ID: A6
Lims ID: 320-25078-A-7-A Lab Sample ID: 320-25078-7
Client ID: WI-CV-1RW56-0117
Operator ID: CBW ALS Bottle#: 20 Worklist Smp#: 125
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F4:MRM

6 Perfluorooctanoic acid, CAS: 335-67-1

Signal: 1


RT: 20.40
Area: 15217
Amount: 0.194931
Amount Units: ng/ml

Processing Integration Results

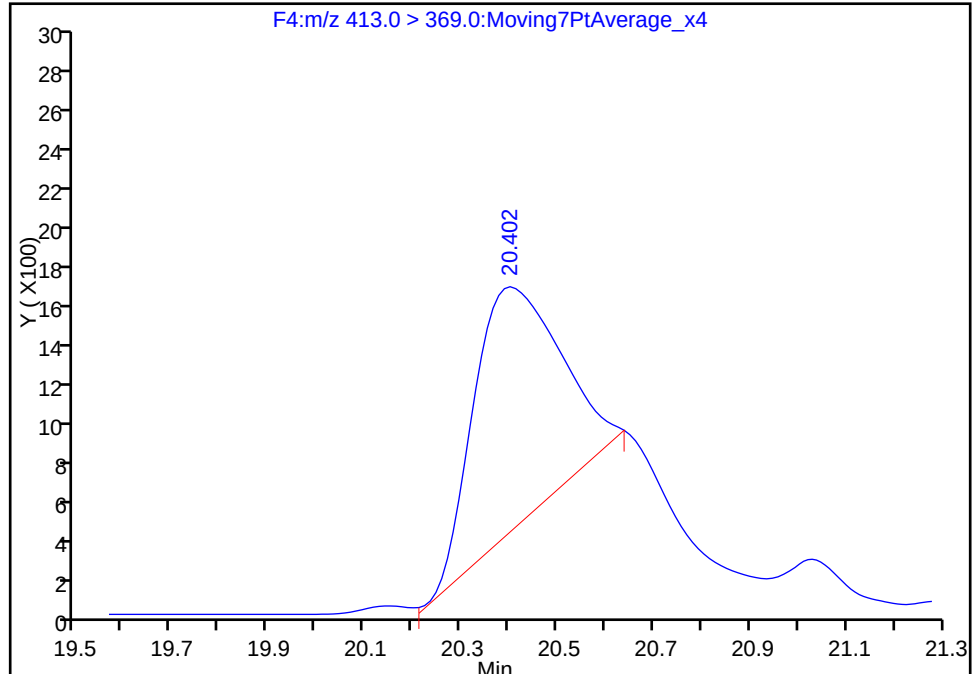

RT: 20.14
Area: 293
Amount: 0.003753
Amount Units: ng/ml

Manual Integration Results

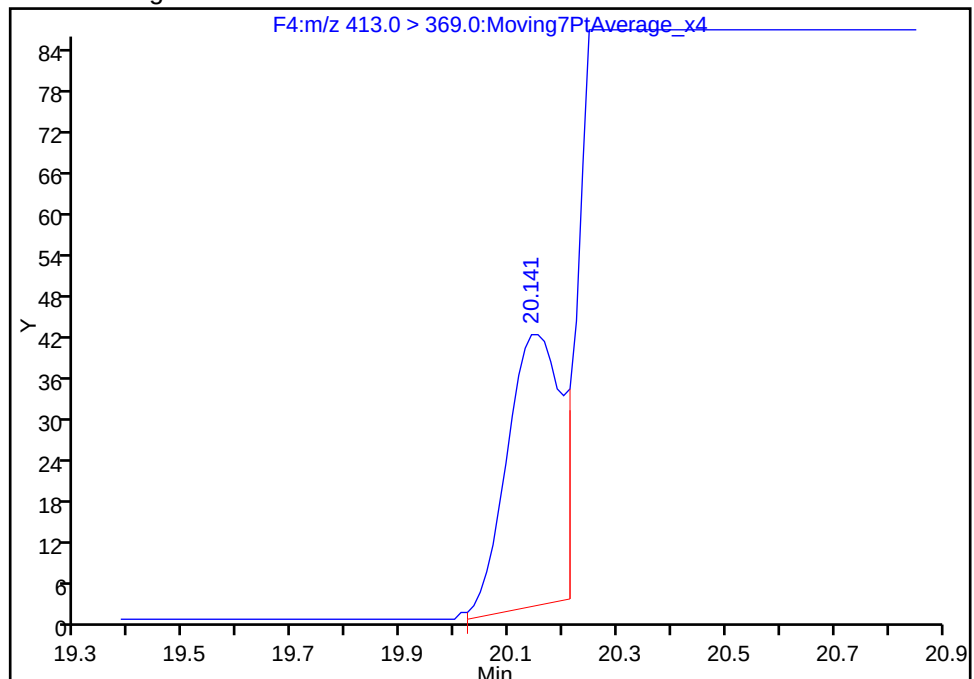

Reviewer: barnettj, 23-Jan-2017 13:28:13

Audit Action: Manually Integrated

Audit Reason: Split Peak

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1FB56-0117 Lab Sample ID: 320-25078-8
 Matrix: Water Lab File ID: 20JAN2016A6A_084.d
 Analysis Method: 537 Date Collected: 01/16/2017 12:50
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 249.9(mL) Date Analyzed: 01/22/2017 04:12
 Con. Extract Vol.: 1.0(mL) Dilution Factor: 1
 Injection Volume: 10(uL) GC Column: Acquity ID: 2.1(mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	114		70-130
STL00996	13C2 PFDA	108		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_084.d
 Lims ID: 320-25078-A-8-A
 Client ID: WI-CV-1FB56-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 04:12:50 ALS Bottle#: 21 Worklist Smp#: 126
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-8-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:28:32

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.658 18.677 -0.019 1.000 997091 11.4 33188

* 5 13C2-PFOA

415.0 > 370.0 20.130 20.161 -0.031 799586 10.0 22107

* 8 13C4 PFOS

503.0 > 80.0 20.762 20.793 -0.031 1378889 28.7 37423

\$ 10 13C2 PFDA

515.0 > 470.0 21.578 21.597 -0.019 1.000 829515 10.8 27897

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_084.d

Injection Date: 22-Jan-2017 04:12:50

Instrument ID: A6

Lims ID: 320-25078-A-8-A

Lab Sample ID: 320-25078-8

Client ID: WI-CV-1FB56-0117

Operator ID: CBW

ALS Bottle#: 21

Worklist Smp#: 126

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)

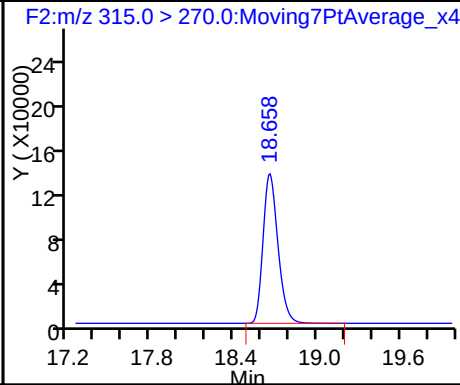

4 Perfluoroheptanoic acid (ND)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (ND)

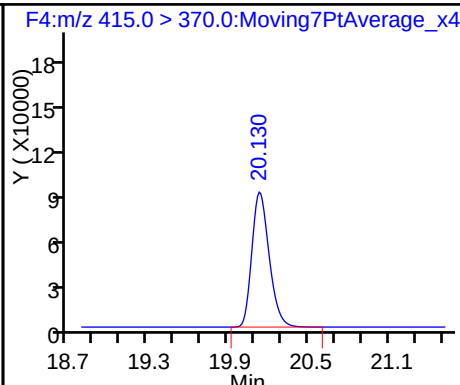


7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)

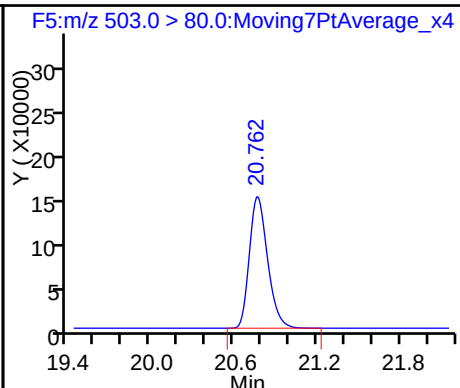

\$ 10 13C2 PFDA

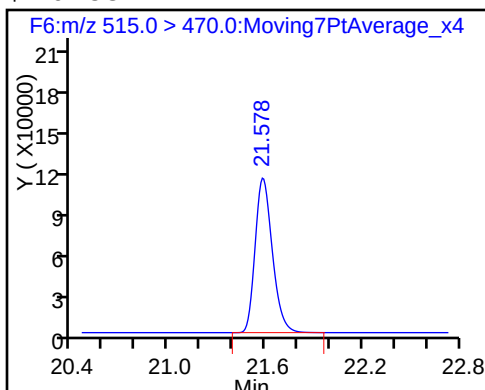

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_084.d
Lims ID: 320-25078-A-8-A
Client ID: WI-CV-1FB56-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 04:12:50 ALS Bottle#: 21 Worklist Smp#: 126
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-8-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:28:32

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	11.4	113.67
\$ 10 13C2 PFDA	10.0	10.8	107.71

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1RW57-0117 Lab Sample ID: 320-25078-9
 Matrix: Water Lab File ID: 20JAN2016A6A_085.d
 Analysis Method: 537 Date Collected: 01/16/2017 14:26
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 249.3 (mL) Date Analyzed: 01/22/2017 04:42
 Con. Extract Vol.: 1.0 (mL) Dilution Factor: 1
 Injection Volume: 10 (uL) GC Column: Acquity ID: 2.1 (mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U M	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	111		70-130
STL00996	13C2 PFDA	116		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_085.d
 Lims ID: 320-25078-A-9-A
 Client ID: WI-CV-1RW57-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 04:42:28 ALS Bottle#: 22 Worklist Smp#: 127
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-9-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:29:06

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.658 18.677 -0.019 1.000 874030 11.1 29139

* 5 13C2-PFOA

415.0 > 370.0 20.141 20.161 -0.020 719644 10.0 19889

6 Perfluorooctanoic acid

413.0 > 369.0 20.141 20.161 -0.020 1.000 382 0.004867 0.2 M

* 8 13C4 PFOS

503.0 > 80.0 20.774 20.793 -0.019 1391753 28.7 38442

\$ 10 13C2 PFDA

515.0 > 470.0 21.578 21.597 -0.019 1.000 804947 11.6 27292

QC Flag Legend

Review Flags

M - Manually Integrated

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_085.d

Injection Date: 22-Jan-2017 04:42:28

Instrument ID: A6

Lims ID: 320-25078-A-9-A

Lab Sample ID: 320-25078-9

Client ID: WI-CV-1RW57-0117

Operator ID: CBW

ALS Bottle#: 22

Worklist Smp#: 127

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)

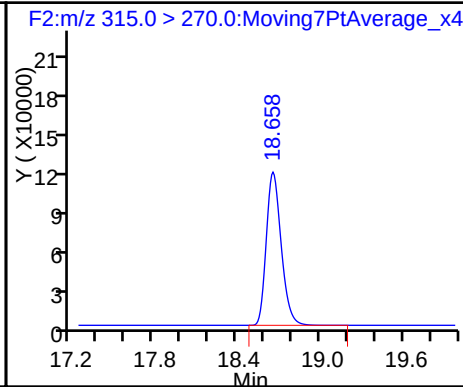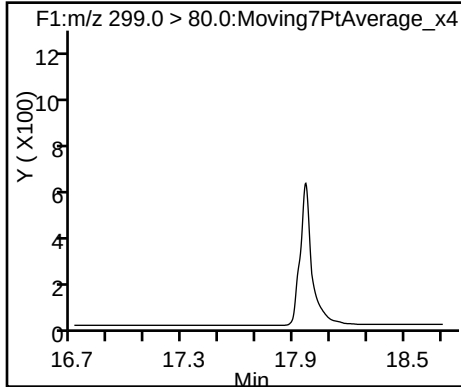

4 Perfluoroheptanoic acid (ND)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (M)

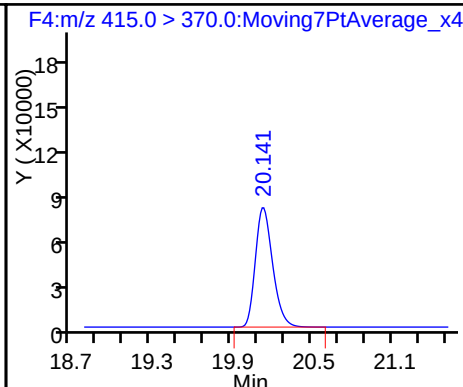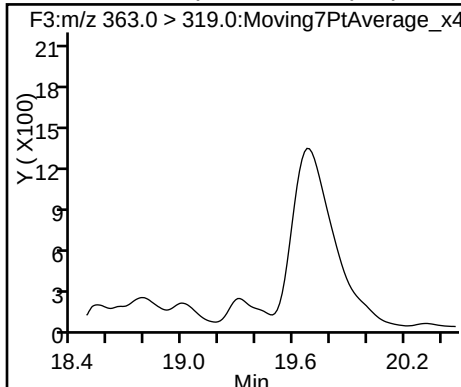


7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)



\$ 10 13C2 PFDA

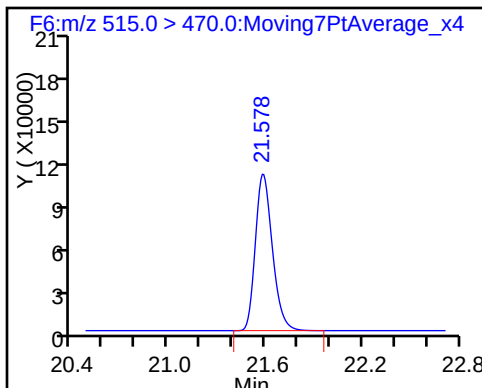

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_085.d
Lims ID: 320-25078-A-9-A
Client ID: WI-CV-1RW57-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 04:42:28 ALS Bottle#: 22 Worklist Smp#: 127
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-9-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:29:06 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:29:06

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	11.1	110.71
\$ 10 13C2 PFDA	10.0	11.6	116.13

TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_085.d
Injection Date: 22-Jan-2017 04:42:28 Instrument ID: A6
Lims ID: 320-25078-A-9-A Lab Sample ID: 320-25078-9
Client ID: WI-CV-1RW57-0117
Operator ID: CBW ALS Bottle#: 22 Worklist Smp#: 127
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F4:MRM

6 Perfluorooctanoic acid, CAS: 335-67-1

Signal: 1


RT: 20.39
Area: 25188
Amount: 0.320888
Amount Units: ng/ml

Processing Integration Results

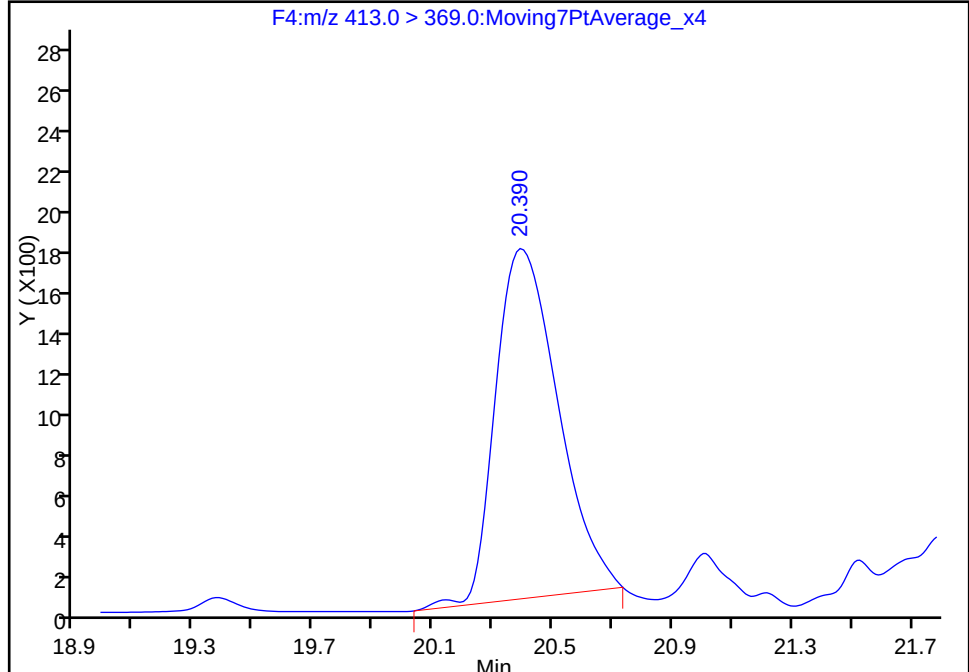

RT: 20.14
Area: 382
Amount: 0.004867
Amount Units: ng/ml

Manual Integration Results

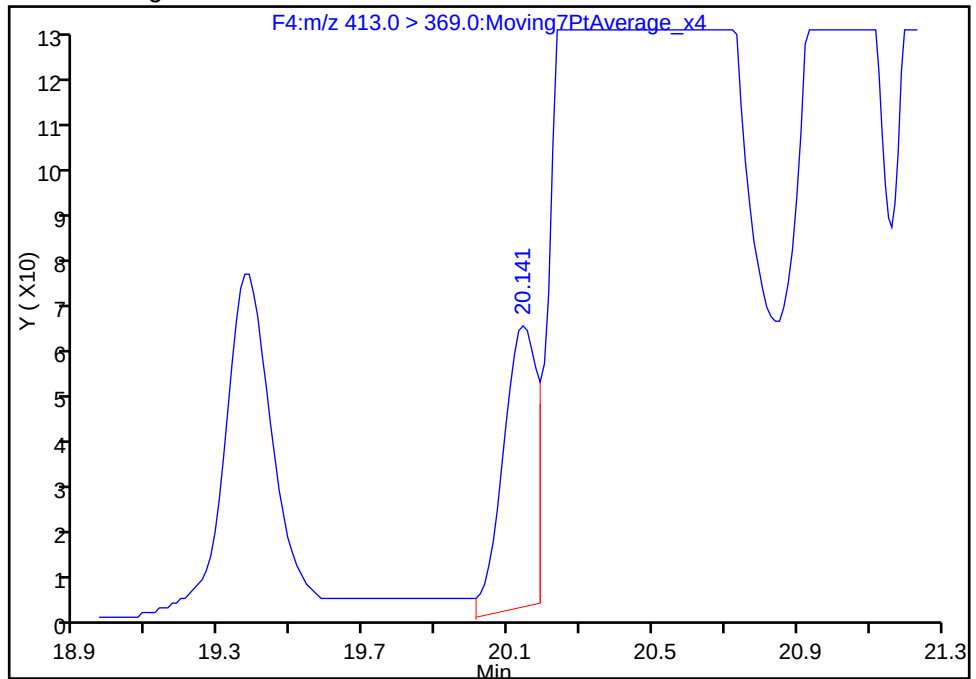

Reviewer: barnettj, 23-Jan-2017 13:29:06
Audit Action: Manually Integrated

Audit Reason: Split Peak
Page 123 of 218

01/24/2017

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1FB57-0117 Lab Sample ID: 320-25078-10
 Matrix: Water Lab File ID: 20JAN2016A6A_088.d
 Analysis Method: 537 Date Collected: 01/16/2017 14:25
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 250.9(mL) Date Analyzed: 01/22/2017 06:11
 Con. Extract Vol.: 1.0(mL) Dilution Factor: 1
 Injection Volume: 10(uL) GC Column: Acquity ID: 2.1(mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147340 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.015
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.047

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	119		70-130
STL00996	13C2 PFDA	115		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_088.d
 Lims ID: 320-25078-A-10-A
 Client ID: WI-CV-1FB57-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 06:11:17 ALS Bottle#: 23 Worklist Smp#: 130
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-10-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:32:10 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:31:05

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.658 18.677 -0.019 1.000 957567 11.9 31707

* 5 13C2-PFOA

415.0 > 370.0 20.129 20.161 -0.032 732006 10.0 20140

* 8 13C4 PFOS

503.0 > 80.0 20.762 20.793 -0.031 1385629 28.7 37959

9 Perfluorononanoic acid

463.0 > 419.0 20.868 20.866 0.002 1.000 1071 0.0126 12.2 M

\$ 10 13C2 PFDA

515.0 > 470.0 21.578 21.597 -0.019 1.000 810504 11.5 27078

QC Flag Legend

Review Flags

M - Manually Integrated

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_088.d

Injection Date: 22-Jan-2017 06:11:17

Instrument ID: A6

Lims ID: 320-25078-A-10-A

Lab Sample ID: 320-25078-10

Client ID: WI-CV-1FB57-0117

Operator ID: CBW

ALS Bottle#: 23

Worklist Smp#: 130

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)



4 Perfluoroheptanoic acid (ND)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (ND)




7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (M)



\$ 10 13C2 PFDA



TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_088.d
Lims ID: 320-25078-A-10-A
Client ID: WI-CV-1FB57-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 06:11:17 ALS Bottle#: 23 Worklist Smp#: 130
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-10-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:32:10 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:31:05

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	11.9	119.25
\$ 10 13C2 PFDA	10.0	11.5	114.96

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1RW58-0117 Lab Sample ID: 320-25078-11
 Matrix: Water Lab File ID: 20JAN2016A6A_089.d
 Analysis Method: 537 Date Collected: 01/16/2017 14:55
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 243.5 (mL) Date Analyzed: 01/22/2017 06:40
 Con. Extract Vol.: 1.0 (mL) Dilution Factor: 1
 Injection Volume: 10 (uL) GC Column: Acquity ID: 2.1 (mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147340 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.062	0.049	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.025	U	0.031	0.025	0.0097
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.049

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	112		70-130
STL00996	13C2 PFDA	108		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_089.d
 Lims ID: 320-25078-A-11-A
 Client ID: WI-CV-1RW58-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 06:40:53 ALS Bottle#: 24 Worklist Smp#: 131
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-11-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:32:10 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:31:38

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.658 18.677 -0.019 1.000 909778 11.2 30318

4 Perfluoroheptanoic acid

M

363.0 > 319.0 19.486 19.476 0.010 1.000 407 0.005149 0.6 M

* 5 13C2-PFOA

415.0 > 370.0 20.130 20.161 -0.031 740164 10.0 20322

* 8 13C4 PFOS

503.0 > 80.0 20.762 20.793 -0.031 1393613 28.7 37961

\$ 10 13C2 PFDA

515.0 > 470.0 21.578 21.597 -0.019 1.000 768602 10.8 26074

QC Flag Legend

Review Flags

M - Manually Integrated

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_089.d

Injection Date: 22-Jan-2017 06:40:53

Instrument ID: A6

Lims ID: 320-25078-A-11-A

Lab Sample ID: 320-25078-11

Client ID: WI-CV-1RW58-0117

Operator ID: CBW

ALS Bottle#: 24

Worklist Smp#: 131

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)



4 Perfluoroheptanoic acid (M)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (ND)




7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)



\$ 10 13C2 PFDA

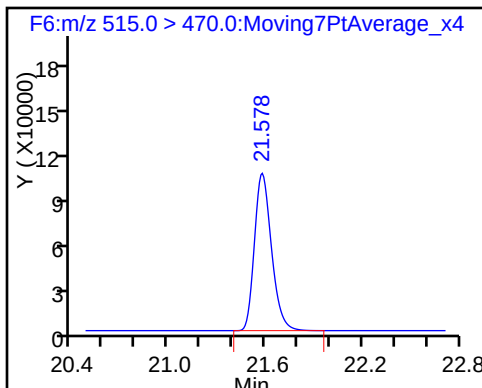

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_089.d
Lims ID: 320-25078-A-11-A
Client ID: WI-CV-1RW58-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 06:40:53 ALS Bottle#: 24 Worklist Smp#: 131
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-11-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:32:10 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:31:38

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	11.2	112.05
\$ 10 13C2 PFDA	10.0	10.8	107.81

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1FB58-0117 Lab Sample ID: 320-25078-12
 Matrix: Water Lab File ID: 20JAN2016A6A_090.d
 Analysis Method: 537 Date Collected: 01/16/2017 14:54
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 246.1 (mL) Date Analyzed: 01/22/2017 07:10
 Con. Extract Vol.: 1.0 (mL) Dilution Factor: 1
 Injection Volume: 10 (uL) GC Column: Acquity ID: 2.1 (mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147340 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.061	0.049	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0096
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	122		70-130
STL00996	13C2 PFDA	111		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_090.d
 Lims ID: 320-25078-A-12-A
 Client ID: WI-CV-1FB58-0117
 Sample Type: Client
 Inject. Date: 22-Jan-2017 07:10:32 ALS Bottle#: 25 Worklist Smp#: 132
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: 320-25078-a-12-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:32:10 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:31:57

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.658 18.677 -0.019 1.000 976325 12.2 32434

* 5 13C2-PFOA

415.0 > 370.0 20.130 20.161 -0.031 728702 10.0 20120

* 8 13C4 PFOS

503.0 > 80.0 20.774 20.793 -0.019 1371116 28.7 37439

\$ 10 13C2 PFDA

515.0 > 470.0 21.578 21.597 -0.019 1.000 782066 11.1 26600

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_090.d

Injection Date: 22-Jan-2017 07:10:32

Instrument ID: A6

Lims ID: 320-25078-A-12-A

Lab Sample ID: 320-25078-12

Client ID: WI-CV-1FB58-0117

Operator ID: CBW

ALS Bottle#: 25

Worklist Smp#: 132

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)



4 Perfluoroheptanoic acid (ND)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (ND)




7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)



\$ 10 13C2 PFDA



TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_090.d
Lims ID: 320-25078-A-12-A
Client ID: WI-CV-1FB58-0117
Sample Type: Client
Inject. Date: 22-Jan-2017 07:10:32 ALS Bottle#: 25 Worklist Smp#: 132
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: 320-25078-a-12-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:32:10 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 13:31:57

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	12.2	122.13
\$ 10 13C2 PFDA	10.0	11.1	111.43

FORM VI
LCMS BY INTERNAL STANDARD - INITIAL CALIBRATION DATA
CURVE EVALUATION

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1 Analy Batch No.: 147198

SDG No.: _____

Instrument ID: A6 GC Column: Acquity ID: 2.1 (mm) Heated Purge: (Y/N) N

Calibration Start Date: 01/20/2017 13:11 Calibration End Date: 01/20/2017 15:40 Calibration ID: 27741

Calibration Files:

LEVEL:	LAB SAMPLE ID:	LAB FILE ID:
Level 1	STD 320-147198/3	20JAN2016A6A_005.d
Level 2	STD 320-147198/4	20JAN2016A6A_006.d
Level 3	STD 320-147198/5	20JAN2016A6A_007.d
Level 4	STD 320-147198/6	20JAN2016A6A_008.d
Level 5	STD 320-147198/7	20JAN2016A6A_009.d
Level 6	STD 320-147198/8	20JAN2016A6A_010.d

ANALYTE	RRF					CURVE TYPE	COEFFICIENT			#	MIN RRF	%RSD	#	MAX %RSD	R^2 OR COD	#	MIN R^2 OR COD
	LVL 1 LVL 6	LVL 2	LVL 3	LVL 4	LVL 5		B	M1	M2								
Perfluorobutanesulfonic acid (PFBS)	0.7828 0.8011	0.8473	0.8521	0.8132	0.7911	Ave		0.8146				3.6		30.0			
Perfluorohexanesulfonic acid	0.8506 1.0702	0.9860	0.9811	0.9898	1.0031	Ave		0.9801				7.3		30.0			
Perfluoroheptanoic acid	1.0646 1.0906	1.0510	1.1474	1.0365	1.0178	Ave		1.0680				4.3		30.0			
Perfluorooctanoic acid (PFOA)	1.0177 1.1196	1.0564	1.1984	1.0665	1.0858	Ave		1.0907				5.7		30.0			
Perfluorooctanesulfonic acid (PFOS)	1.0154 1.2157	1.1323	1.1258	1.1501	1.1672	Ave		1.1344				5.9		30.0			
Perfluorononanoic acid	1.1187 1.1761	1.2075	1.2498	1.1279	1.0899	Ave		1.1616				5.2		30.0			
13C2 PFHxA	1.0126 1.1485	1.0941	1.1632	1.0882	1.0755	Ave		1.0970				4.9		30.0			
13C2 PFDA	0.9426 0.9915	0.9481	0.9918	0.9715	0.9335	Ave		0.9632				2.6		30.0			

Note: The m1 coefficient is the same as Ave RRF for an Ave curve type.

FORM VI
LCMS BY INTERNAL STANDARD - INITIAL CALIBRATION DATA
RESPONSE AND CONCENTRATION

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1 Analy Batch No.: 147198

SDG No.: _____

Instrument ID: A6 GC Column: Acquity ID: 2.1(mm) Heated Purge: (Y/N) N

Calibration Start Date: 01/20/2017 13:11 Calibration End Date: 01/20/2017 15:40 Calibration ID: 27741

Calibration Files:

LEVEL:	LAB SAMPLE ID:	LAB FILE ID:
Level 1	STD 320-147198/3	20JAN2016A6A_005.d
Level 2	STD 320-147198/4	20JAN2016A6A_006.d
Level 3	STD 320-147198/5	20JAN2016A6A_007.d
Level 4	STD 320-147198/6	20JAN2016A6A_008.d
Level 5	STD 320-147198/7	20JAN2016A6A_009.d
Level 6	STD 320-147198/8	20JAN2016A6A_010.d

ANALYTE	IS REF	CURVE TYPE	RESPONSE					CONCENTRATION (NG/ML)				
			LVL 1 LVL 6	LVL 2	LVL 3	LVL 4	LVL 5	LVL 1 LVL 6	LVL 2	LVL 3	LVL 4	LVL 5
Perfluorobutanesulfonic acid (PFBS)	PFOS	Ave	295138 5108592	823487	1597346	2856763	4483850	8.98 178	22.9	45.1	90.9	135
Perfluorohexanesulfonic acid	PFOS	Ave	108102 2300517	323035	619987	1172241	1916602	3.03 60.1	7.72	15.2	30.6	45.4
Perfluoroheptanoic acid	13PF OA	Ave	59252 1182413	150332	310070	583966	950736	0.990 19.7	2.52	4.97	10.0	14.9
Perfluorooctanoic acid (PFOA)	13PF OA	Ave	111671 2393220	297936	638558	1184736	1999775	1.95 38.8	4.98	9.81	19.8	29.3
Perfluorooctanesulfonic acid (PFOS)	PFOS	Ave	170882 3460463	491196	942021	1803557	2953057	4.01 79.6	10.2	20.1	40.6	60.1
Perfluorononanoic acid	13PF OA	Ave	130450 2671319	361888	707617	1331377	2133029	2.07 41.2	5.29	10.4	21.0	31.1
13C2 PFHxA	13PF OA	Ave	569231 632840	619933	631911	611664	676525	10.0 10.0	10.0	10.0	10.0	10.0
13C2 PFDA	13PF OA	Ave	529914 546342	537200	538763	546073	587235	10.0 10.0	10.0	10.0	10.0	10.0

Curve Type Legend:

Ave = Average ISTD

FORM VI
LCMS BY INTERNAL STANDARD - INITIAL CALIBRATION DATA
READBACK PERCENT ERROR

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1 Analy Batch No.: 147198

SDG No.: _____

Instrument ID: A6 GC Column: Acquity ID: 2.1(mm) Heated Purge: (Y/N) N

Calibration Start Date: 01/20/2017 13:11 Calibration End Date: 01/20/2017 15:40 Calibration ID: 27741

Calibration Files:


LEVEL:	LAB SAMPLE ID:	LAB FILE ID:
Level 1	STD 320-147198/3	20JAN2016A6A_005.d
Level 2	STD 320-147198/4	20JAN2016A6A_006.d
Level 3	STD 320-147198/5	20JAN2016A6A_007.d
Level 4	STD 320-147198/6	20JAN2016A6A_008.d
Level 5	STD 320-147198/7	20JAN2016A6A_009.d
Level 6	STD 320-147198/8	20JAN2016A6A_010.d

ANALYTE	PERCENT ERROR						PERCENT ERROR LIMIT					
	LVL 1 #	LVL 2 #	LVL 3 #	LVL 4 #	LVL 5 #	LVL 6 #	LVL 1	LVL 2	LVL 3	LVL 4	LVL 5	LVL 6
Perfluorobutanesulfonic acid (PFBS)	-3.9	4.0	4.6	-0.2	-2.9	-1.7	50	50	50	50	50	50
Perfluorohexanesulfonic acid	-13.2	0.6	0.1	1.0	2.3	9.2	50	50	50	50	50	50
Perfluoroheptanoic acid	-0.3	-1.6	7.4	-3.0	-4.7	2.1	50	50	50	50	50	50
Perfluorooctanoic acid (PFOA)	-6.7	-3.1	9.9	-2.2	-0.5	2.6	50	50	50	50	50	50
Perfluorooctanesulfonic acid (PFOS)	-10.5	-0.2	-0.8	1.4	2.9	7.2	50	50	50	50	50	50
Perfluorononanoic acid	-3.7	4.0	7.6	-2.9	-6.2	1.2	50	50	50	50	50	50
13C2 PFHxA	-7.7	-0.3	6.0	-0.8	-2.0	4.7	30	30	30	30	30	30
13C2 PFDA	-2.1	-1.6	3.0	0.9	-3.1	2.9	30	30	30	30	30	30

L4

20JAN2016A6A_008 Sm (Mn, 2x3)


1: MRM of 1 Channel ES-
299 > 80 (PFBS)
5.67e5
Area

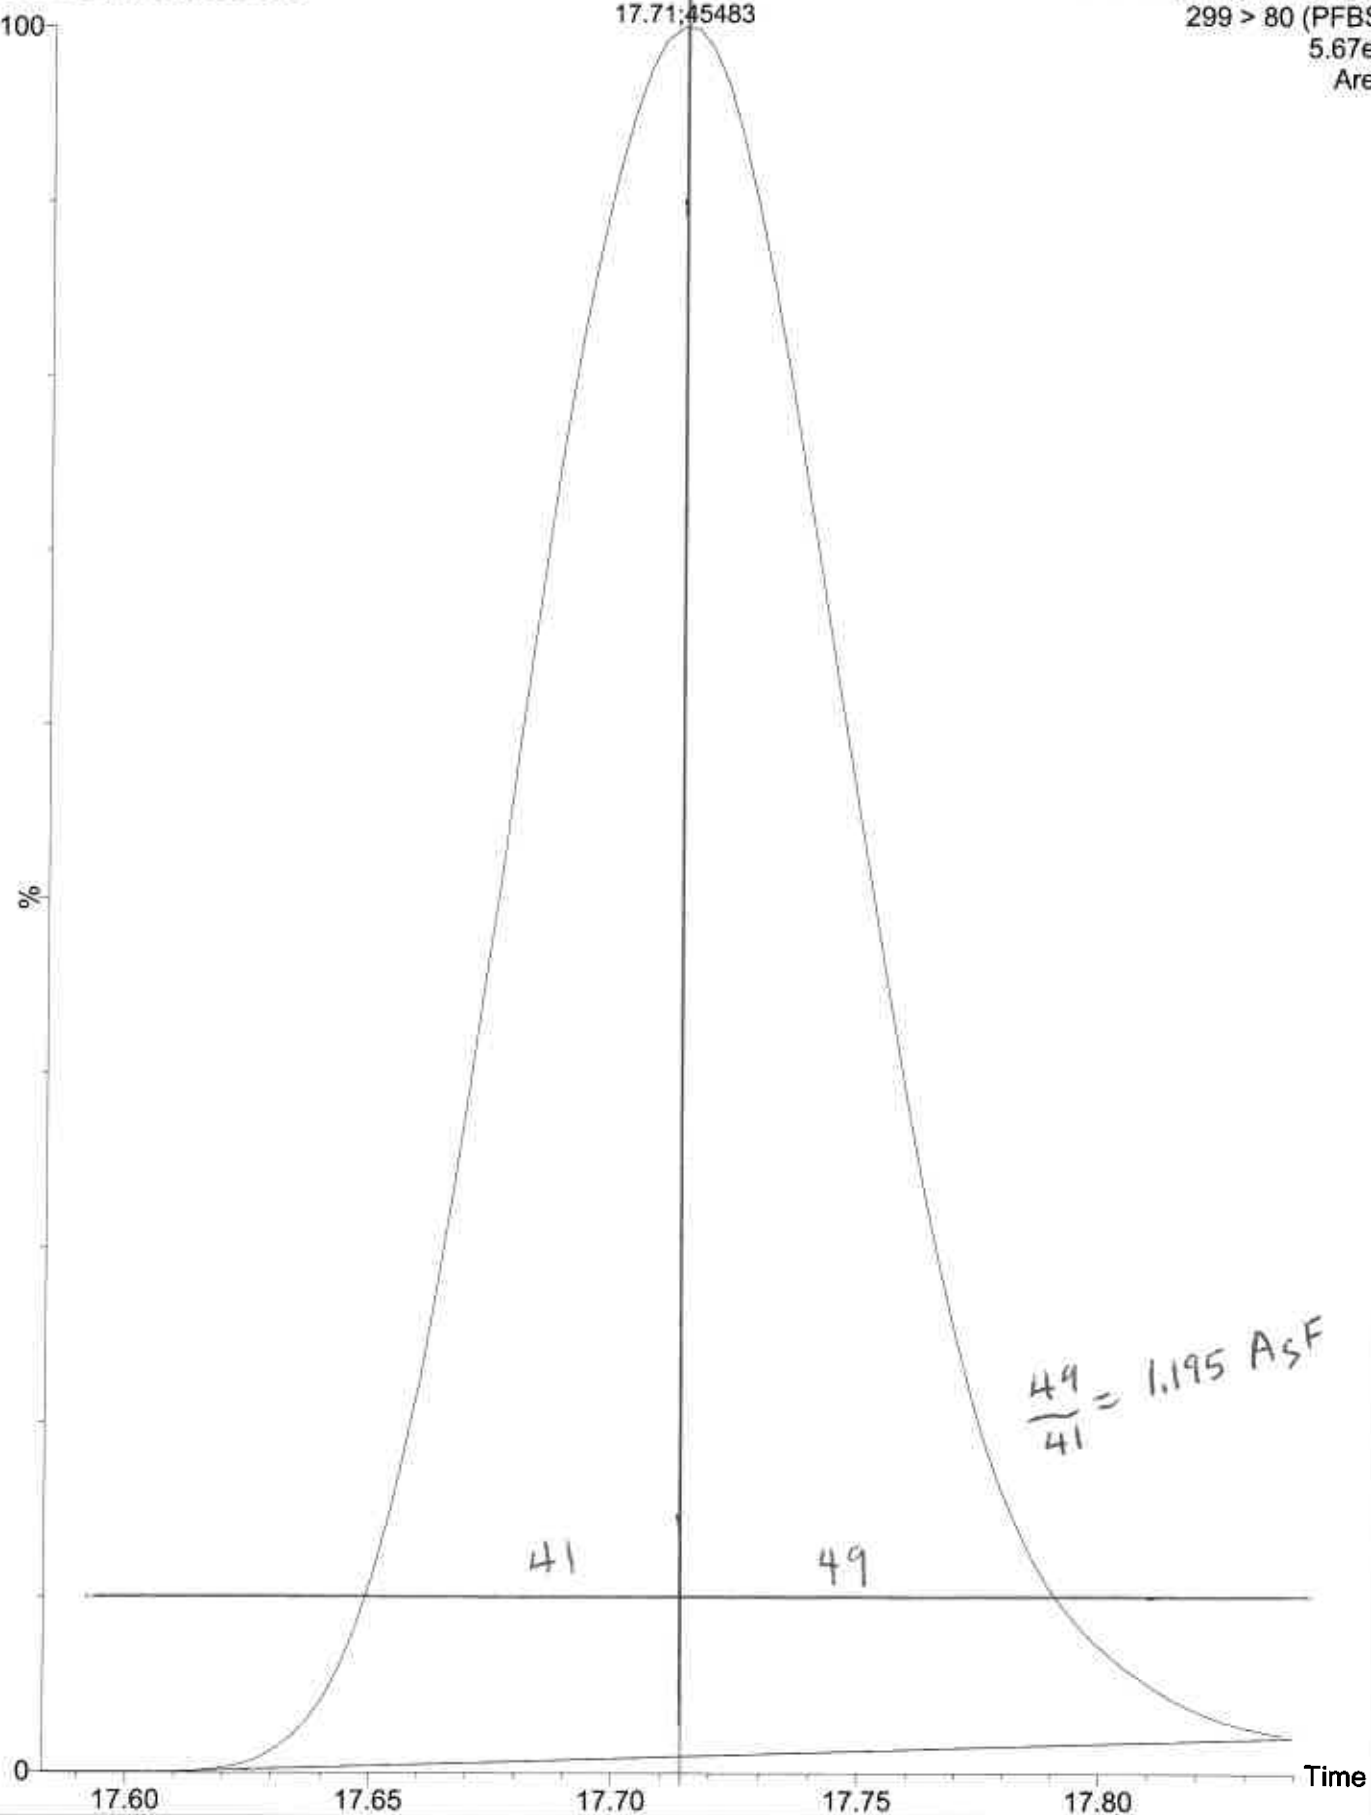

L4

20JAN2016A6A_008 Sm (Mn, 2x3)

2: MRM of 1 Channel ES-
315 > 270 (13C2-PFHxA)
1.06e5
Area

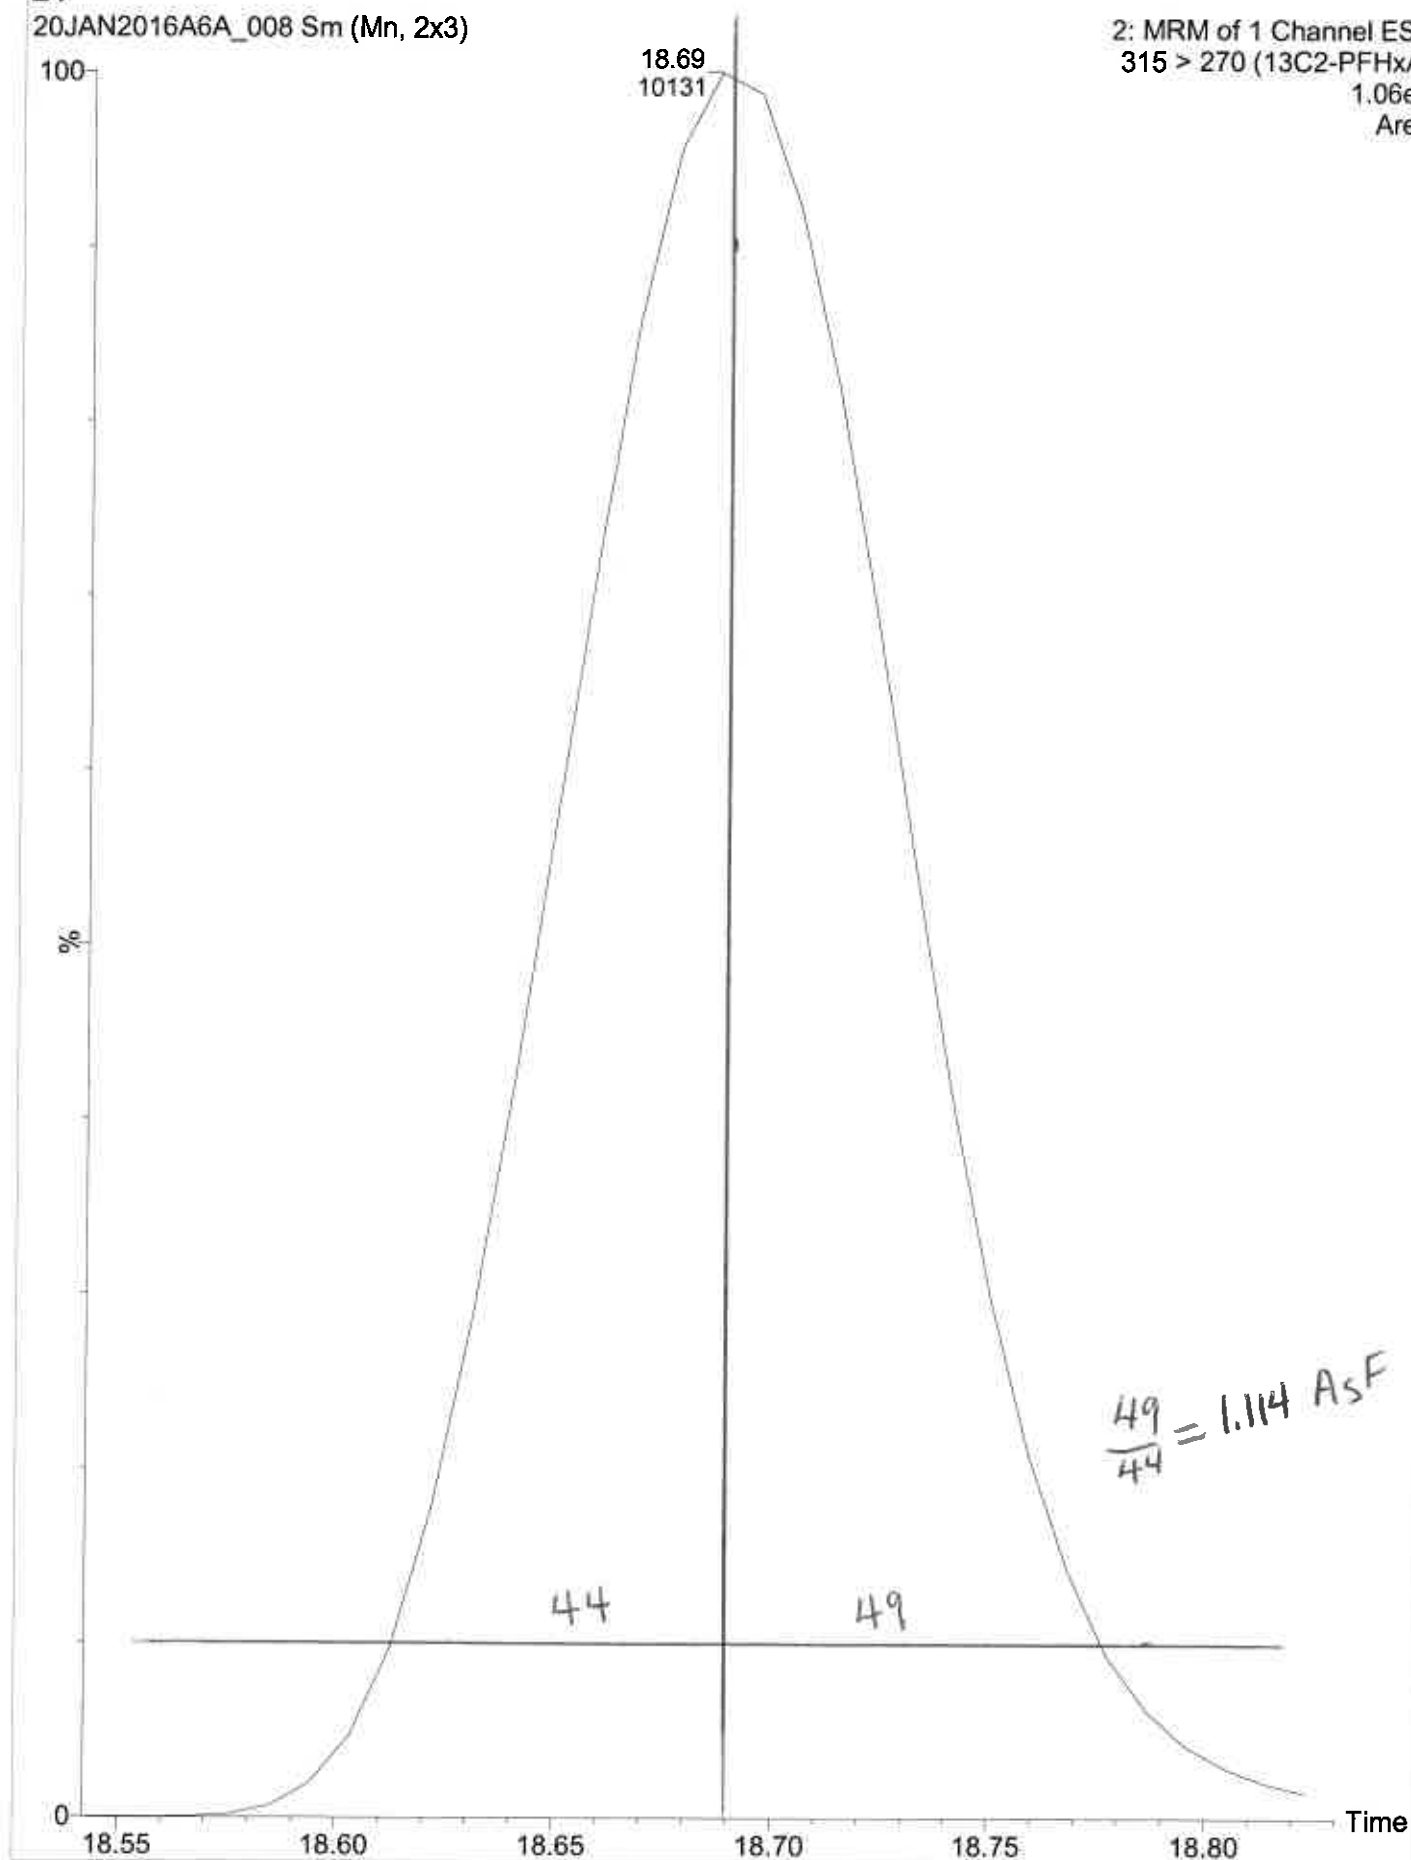

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_005.d
 Lims ID: STD L1
 Client ID:
 Sample Type: IC Calib Level: 1
 Inject. Date: 20-Jan-2017 13:11:51 ALS Bottle#: 1 Worklist Smp#: 3
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: STD L1 L1
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 21-Jan-2017 15:45:24 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK001

First Level Reviewer: barnettj Date: 20-Jan-2017 14:37:56

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
1 Perfluorobutanesulfonic acid								
299.0 > 80.0	17.705	17.708	-0.003	1.000	295138	8.63	398	
\$ 2 13C2 PFHxA								
315.0 > 270.0	18.677	18.677	0.0	1.000	569231	9.23	18868	
3 Perfluorohexanesulfonic acid								
399.0 > 80.0	19.451	19.445	0.006	1.000	108102	2.63	2564	
4 Perfluoroheptanoic acid								M
363.0 > 319.0	19.475	19.476	-0.001	1.000	59252	0.9869	75.5	M
* 5 13C2-PFOA								
415.0 > 370.0	20.153	20.161	-0.008		562174	10.0	15603	
6 Perfluorooctanoic acid								M
413.0 > 369.0	20.153	20.161	-0.008	1.000	111671	1.82	71.5	M
7 Perfluorooctane sulfonic acid								
499.0 > 80.0	20.786	20.766	0.020	1.000	170882	3.59	3016	
* 8 13C4 PFOS								
503.0 > 80.0	20.786	20.793	-0.007		1204619	28.7	26248	
9 Perfluorononanoic acid								
463.0 > 419.0	20.857	20.866	-0.009	1.000	130450	2.00	21.9	
\$ 10 13C2 PFDA								
515.0 > 470.0	21.587	21.597	-0.010	1.000	529914	9.79	17940	

QC Flag Legend

Review Flags

M - Manually Integrated

Reagents:

LC537-L1_00017

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_005.d

Injection Date: 20-Jan-2017 13:11:51

Instrument ID: A6

Lims ID: STD L1

Client ID:

Operator ID: CBW

ALS Bottle#: 1

Worklist Smp#: 3

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

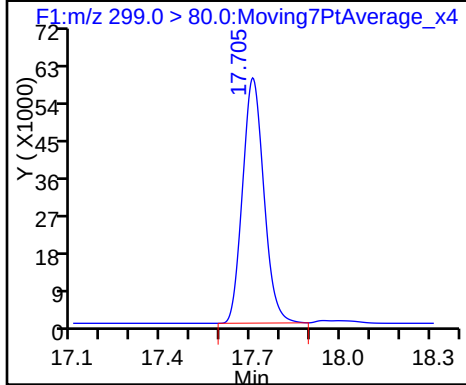

4 Perfluoroheptanoic acid (M)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (M)




7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid

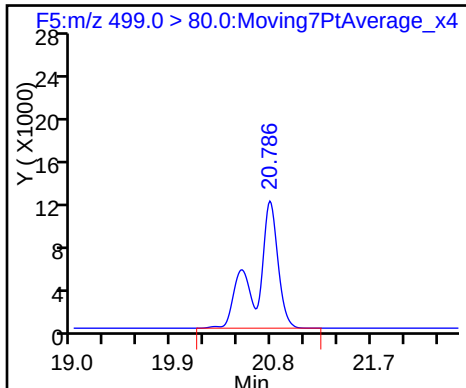

\$ 10 13C2 PFDA



TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_005.d
Injection Date: 20-Jan-2017 13:11:51 Instrument ID: A6
Lims ID: STD L1
Client ID:
Operator ID: CBW ALS Bottle#: 1 Worklist Smp#: 3
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F3:MRM

4 Perfluoroheptanoic acid, CAS: 375-85-9

Signal: 1


RT: 19.47
Area: 73918
Amount: 1.051213
Amount Units: ng/ml

Processing Integration Results

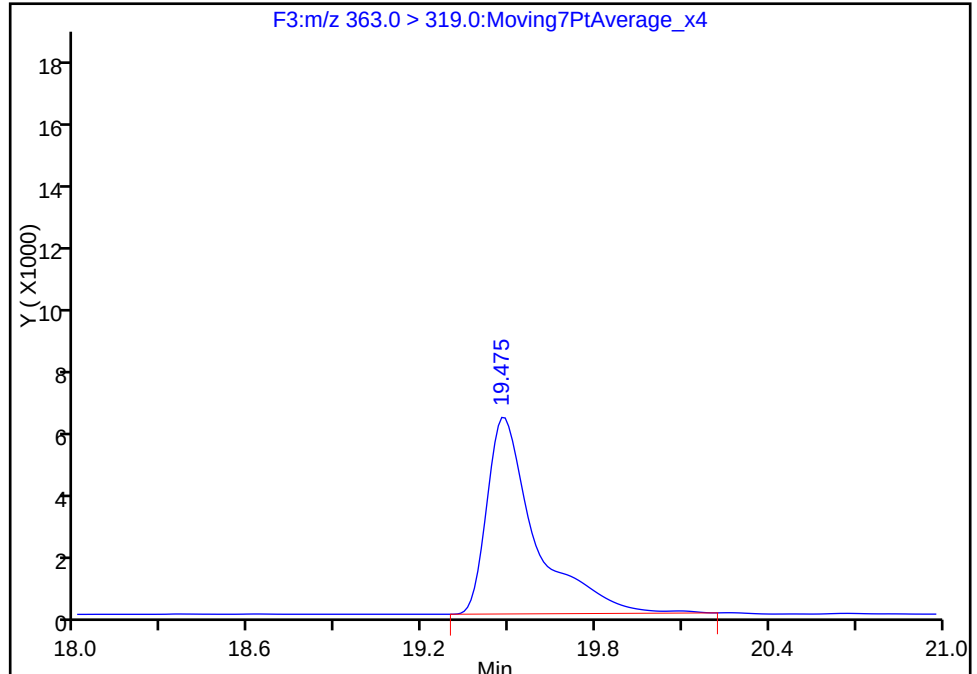

RT: 19.47
Area: 59252
Amount: 0.986906
Amount Units: ng/ml

Manual Integration Results

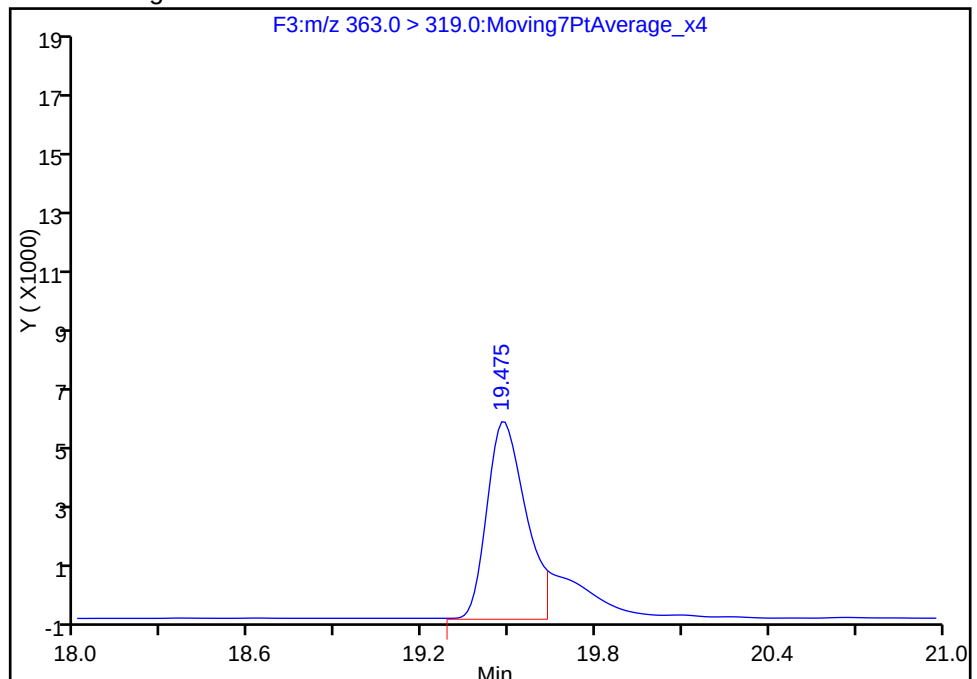

Reviewer: barnettj, 20-Jan-2017 14:37:56
Audit Action: Manually Integrated

Audit Reason: Split Peak

TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_005.d
Injection Date: 20-Jan-2017 13:11:51 Instrument ID: A6
Lims ID: STD L1
Client ID:
Operator ID: CBW ALS Bottle#: 1 Worklist Smp#: 3
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F4:MRM

6 Perfluorooctanoic acid, CAS: 335-67-1

Signal: 1


RT: 20.15
Area: 102952
Amount: 1.787224
Amount Units: ng/ml

Processing Integration Results

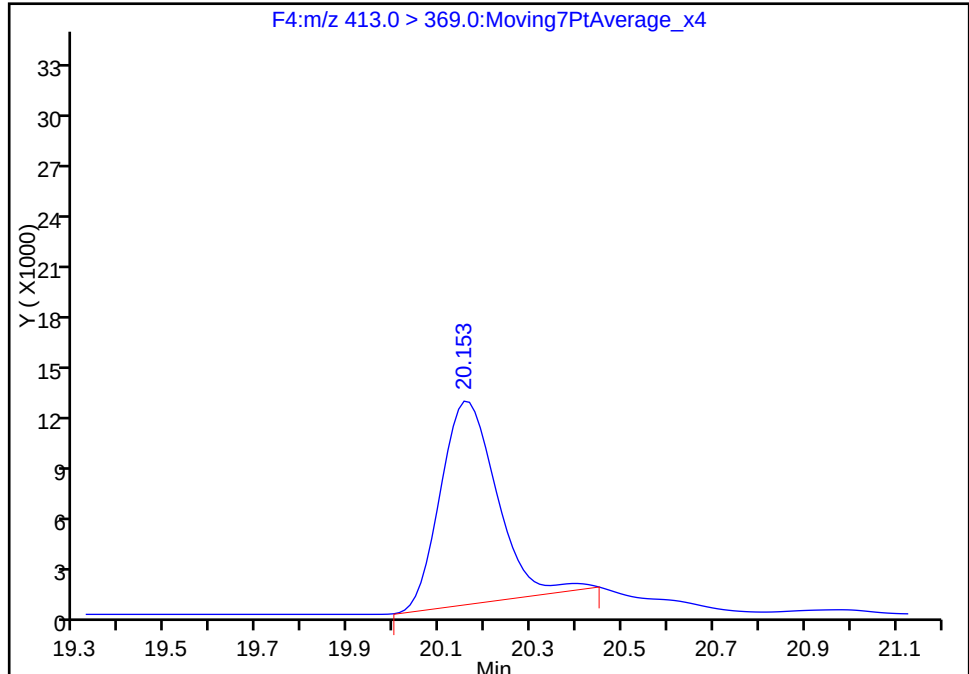

RT: 20.15
Area: 111671
Amount: 1.821155
Amount Units: ng/ml

Manual Integration Results

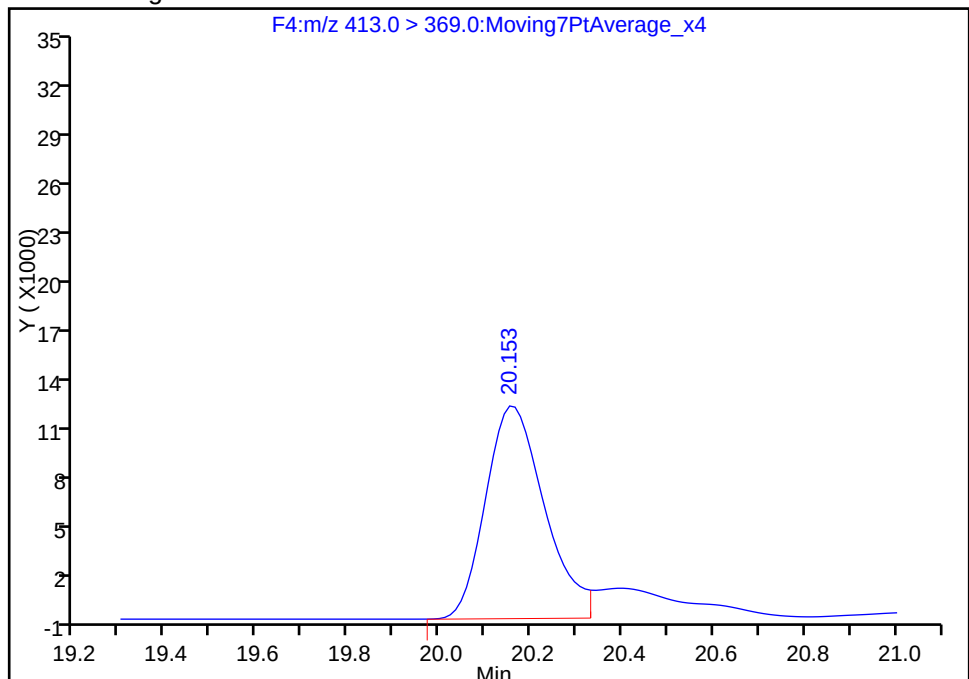

Reviewer: barnettj, 20-Jan-2017 14:37:56
Audit Action: Manually Integrated

Audit Reason: Split Peak

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_006.d
 Lims ID: STD L2
 Client ID:
 Sample Type: IC Calib Level: 2
 Inject. Date: 20-Jan-2017 13:41:27 ALS Bottle#: 2 Worklist Smp#: 4
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: STD L2 L2
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 21-Jan-2017 15:45:36 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK001

First Level Reviewer: barnettj

Date: 20-Jan-2017 14:38:53

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

1 Perfluorobutanesulfonic acid
 299.0 > 80.0 17.712 17.708 0.004 1.000 823487 23.8 529
 \$ 2 13C2 PFHxA
 315.0 > 270.0 18.677 18.677 0.0 1.000 619933 9.97 20614
 3 Perfluorohexanesulfonic acid
 399.0 > 80.0 19.451 19.445 0.006 1.000 323035 7.76 7587
 4 Perfluoroheptanoic acid M
 363.0 > 319.0 19.486 19.476 0.010 1.000 150332 2.48 157 M
 6 Perfluorooctanoic acid M
 413.0 > 369.0 20.165 20.161 0.004 1.000 297936 4.82 224 M
 * 5 13C2-PFOA
 415.0 > 370.0 20.165 20.161 0.004 566616 10.0 20938
 7 Perfluorooctane sulfonic acid
 499.0 > 80.0 20.761 20.766 -0.005 1.000 491196 10.2 7354
 * 8 13C4 PFOS
 503.0 > 80.0 20.797 20.793 0.004 1217755 28.7 26578
 9 Perfluorononanoic acid
 463.0 > 419.0 20.868 20.866 0.002 1.000 361888 5.50 73.9
 \$ 10 13C2 PFDA
 515.0 > 470.0 21.595 21.597 -0.002 1.000 537200 9.84 18242

QC Flag Legend

Review Flags

M - Manually Integrated

Reagents:

LC537-L2_00016

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_006.d

Injection Date: 20-Jan-2017 13:41:27

Instrument ID: A6

Lims ID: STD L2

Client ID:

Operator ID: CBW

ALS Bottle#: 2

Worklist Smp#: 4

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

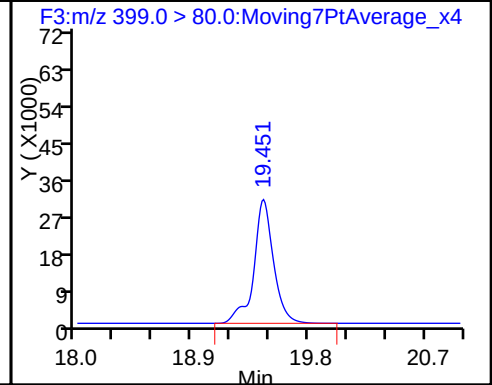

4 Perfluoroheptanoic acid (M)

6 Perfluorooctanoic acid (M)




* 5 13C2-PFOA

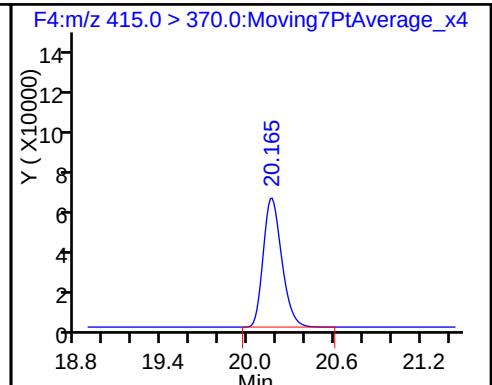


7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid

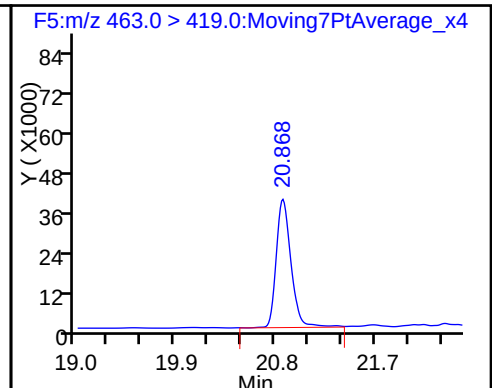

\$ 10 13C2 PFDA

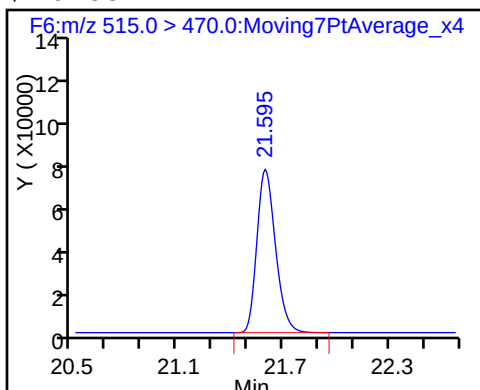

TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_006.d
Injection Date: 20-Jan-2017 13:41:27 Instrument ID: A6
Lims ID: STD L2
Client ID:
Operator ID: CBW ALS Bottle#: 2 Worklist Smp#: 4
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F3:MRM

4 Perfluoroheptanoic acid, CAS: 375-85-9

Signal: 1


RT: 19.49
Area: 167855
Amount: 2.647267
Amount Units: ng/ml

Processing Integration Results

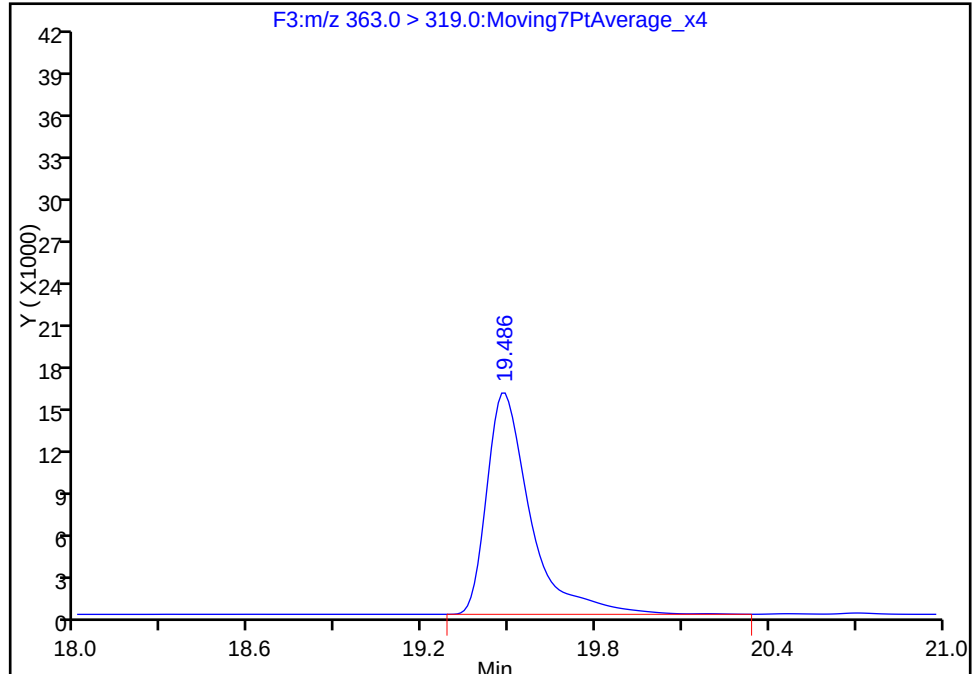

RT: 19.49
Area: 150332
Amount: 2.484312
Amount Units: ng/ml

Manual Integration Results

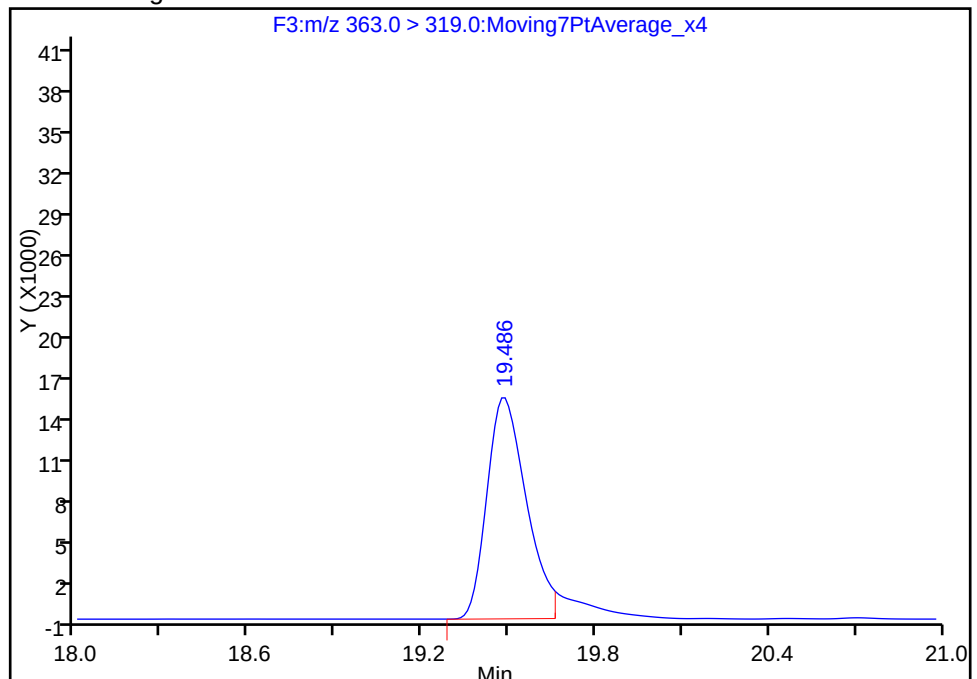

Reviewer: barnettj, 20-Jan-2017 14:38:53
Audit Action: Manually Integrated

Audit Reason: Split Peak

TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_006.d
Injection Date: 20-Jan-2017 13:41:27 Instrument ID: A6
Lims ID: STD L2
Client ID:
Operator ID: CBW ALS Bottle#: 2 Worklist Smp#: 4
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F4:MRM

6 Perfluorooctanoic acid, CAS: 335-67-1

Signal: 1


RT: 20.17
Area: 313361
Amount: 5.195777
Amount Units: ng/ml

Processing Integration Results

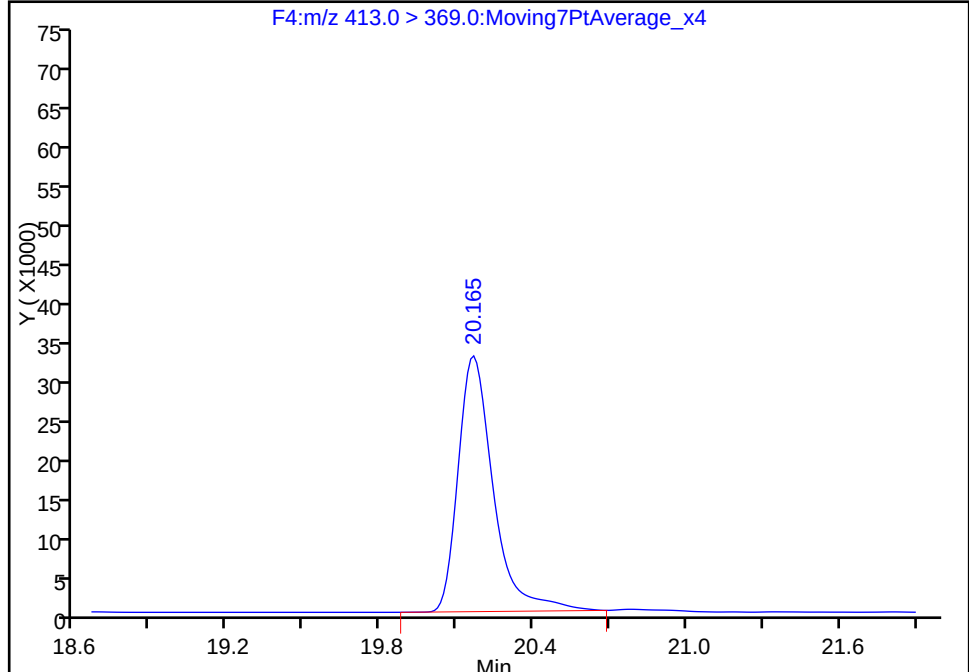

RT: 20.17
Area: 297936
Amount: 4.820714
Amount Units: ng/ml

Manual Integration Results

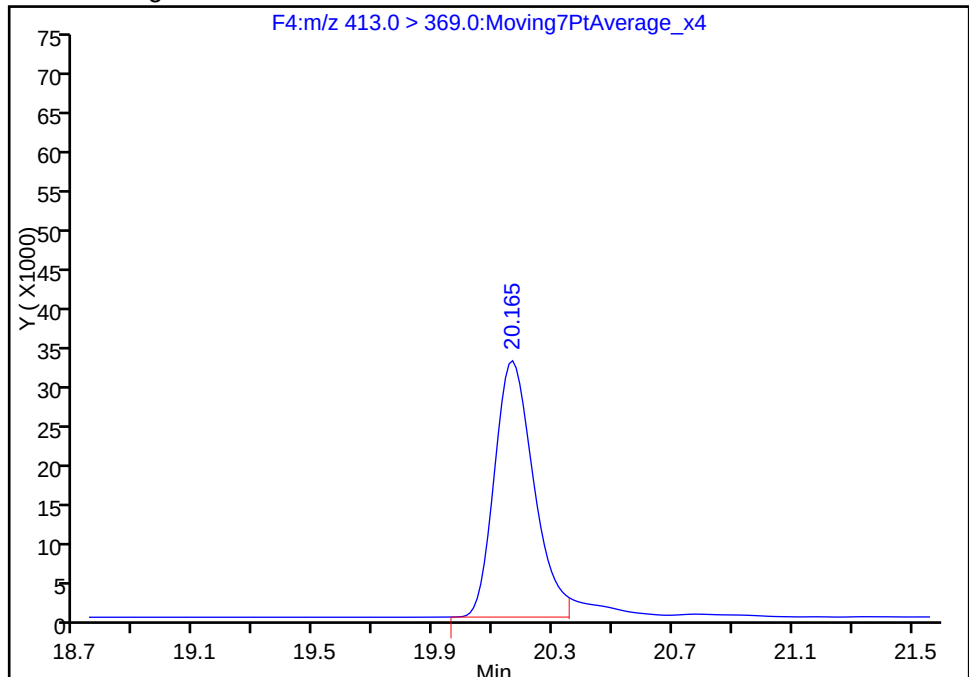

Reviewer: barnettj, 20-Jan-2017 14:38:53
Audit Action: Manually Integrated

Audit Reason: Split Peak

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_007.d
 Lims ID: STD L3
 Client ID:
 Sample Type: IC Calib Level: 3
 Inject. Date: 20-Jan-2017 14:11:00 ALS Bottle#: 3 Worklist Smp#: 5
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: STD L3 L3
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 21-Jan-2017 15:45:49 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK001

First Level Reviewer: barnettj

Date: 20-Jan-2017 15:28:27

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

1 Perfluorobutanesulfonic acid
 299.0 > 80.0 17.705 17.708 -0.003 1.000 1597346 47.2 21750
 \$ 2 13C2 PFHxA
 315.0 > 270.0 18.677 18.677 0.0 1.000 631911 10.6 14042
 3 Perfluorohexanesulfonic acid
 399.0 > 80.0 19.439 19.445 -0.006 1.000 619987 15.2 14649
 4 Perfluoroheptanoic acid
 363.0 > 319.0 19.474 19.476 -0.002 1.000 310070 5.34 506
 * 5 13C2-PFOA
 415.0 > 370.0 20.153 20.161 -0.008 543238 10.0 9849
 6 Perfluorooctanoic acid
 413.0 > 369.0 20.153 20.161 -0.008 1.000 638558 10.8 1212
 7 Perfluorooctane sulfonic acid
 499.0 > 80.0 20.762 20.766 -0.004 1.000 942021 20.0 13975
 * 8 13C4 PFOS
 503.0 > 80.0 20.785 20.793 -0.008 1191964 28.7 32491
 9 Perfluorononanoic acid
 463.0 > 419.0 20.868 20.866 0.002 1.000 707617 11.2 172
 \$ 10 13C2 PFDA
 515.0 > 470.0 21.595 21.597 -0.002 1.000 538763 10.3 18446

Reagents:

LC537-L3_00018

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_007.d

Injection Date: 20-Jan-2017 14:11:00

Instrument ID: A6

Lims ID: STD L3

Client ID:

Operator ID: CBW

ALS Bottle#: 3

Worklist Smp#: 5

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid



4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid




7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid



\$ 10 13C2 PFDA

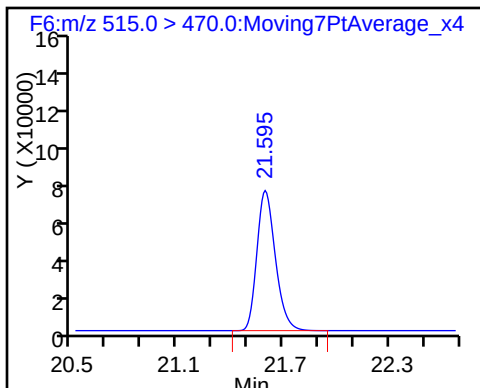

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_008.d
 Lims ID: STD L4
 Client ID:
 Sample Type: ICISAV Calib Level: 4
 Inject. Date: 20-Jan-2017 14:40:38 ALS Bottle#: 4 Worklist Smp#: 6
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: STD L4 L4
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 21-Jan-2017 15:46:00 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK001

First Level Reviewer: barnettj

Date: 20-Jan-2017 15:30:35

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

1 Perfluorobutanesulfonic acid
 299.0 > 80.0 17.712 17.708 0.004 1.000 2856763 90.7 48472
 \$ 2 13C2 PFHxA
 315.0 > 270.0 18.677 18.677 0.0 1.000 611664 9.92 20304
 3 Perfluorohexanesulfonic acid
 399.0 > 80.0 19.451 19.445 0.006 1.000 1172241 30.9 27003
 4 Perfluoroheptanoic acid
 363.0 > 319.0 19.474 19.476 -0.002 1.000 583966 9.73 916
 6 Perfluorooctanoic acid
 413.0 > 369.0 20.165 20.161 0.004 1.000 1184736 19.3 1862
 * 5 13C2-PFOA
 415.0 > 370.0 20.165 20.161 0.004 562090 10.0 15640
 7 Perfluorooctane sulfonic acid
 499.0 > 80.0 20.762 20.766 -0.004 1.000 1803557 41.1 7838
 * 8 13C4 PFOS
 503.0 > 80.0 20.797 20.793 0.004 1108641 28.7 30073
 9 Perfluorononanoic acid
 463.0 > 419.0 20.868 20.866 0.002 1.000 1331377 20.4 372
 \$ 10 13C2 PFDA
 515.0 > 470.0 21.604 21.597 0.007 1.000 546073 10.1 18474

Reagents:

LC537-L4_00017

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_008.d

Injection Date: 20-Jan-2017 14:40:38

Instrument ID: A6

Lims ID: STD L4

Client ID:

Operator ID: CBW

ALS Bottle#: 4

Worklist Smp#: 6

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

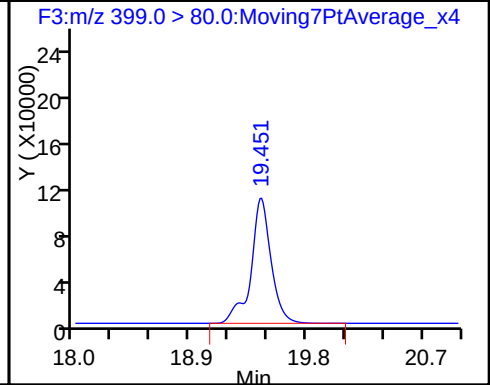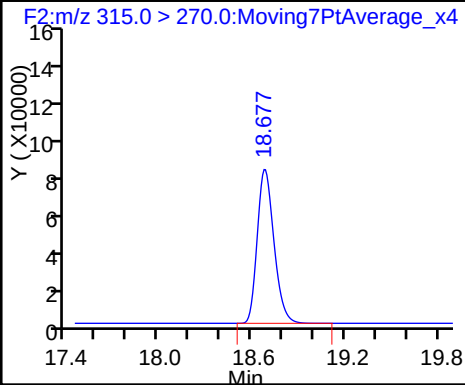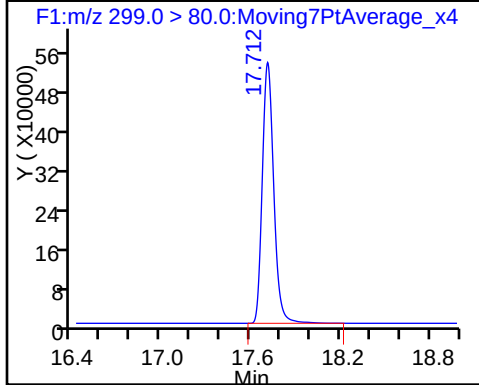

4 Perfluoroheptanoic acid

6 Perfluorooctanoic acid




* 5 13C2-PFOA

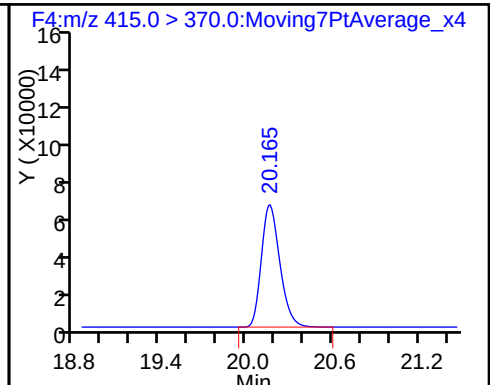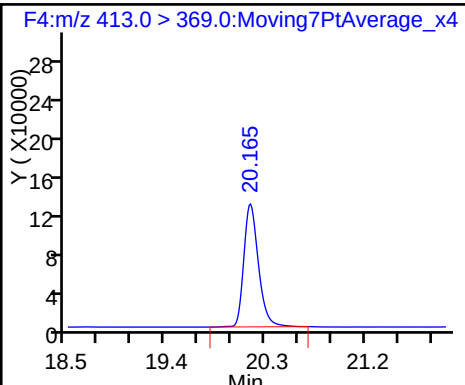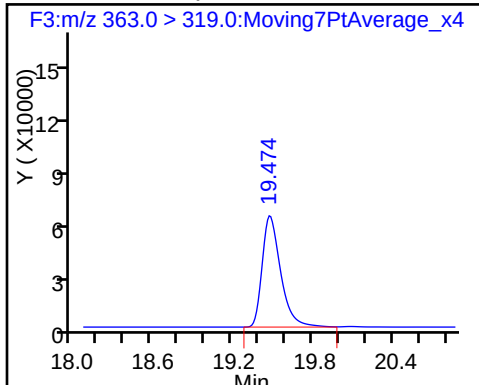


7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid

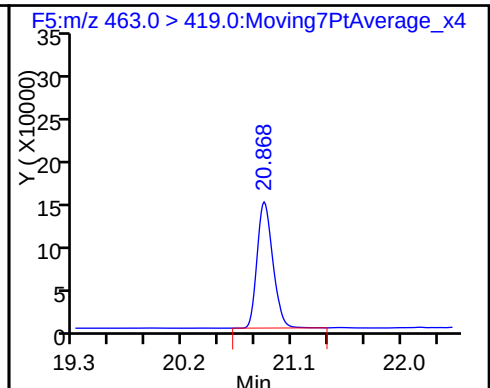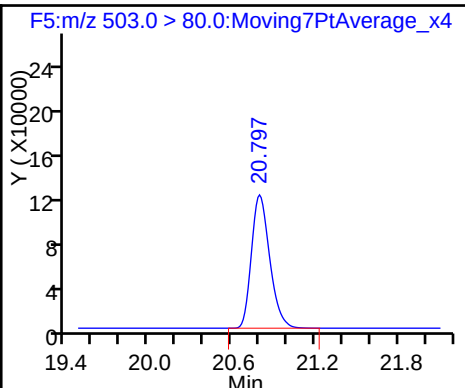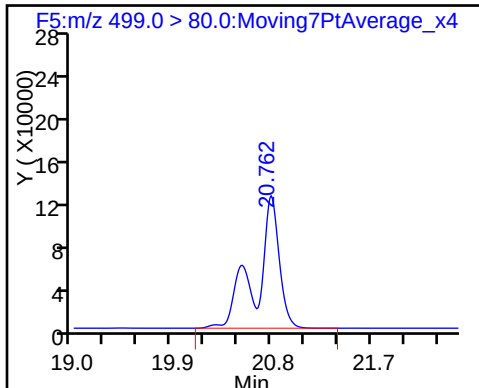

\$ 10 13C2 PFDA



TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_009.d
 Lims ID: STD L5
 Client ID:
 Sample Type: IC Calib Level: 5
 Inject. Date: 20-Jan-2017 15:11:21 ALS Bottle#: 5 Worklist Smp#: 7
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: STD L5 L5
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 21-Jan-2017 15:46:12 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK001

First Level Reviewer: barnettj

Date: 20-Jan-2017 15:50:15

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

1 Perfluorobutanesulfonic acid
 299.0 > 80.0 17.708 17.708 0.0 1.000 4483850 130.8 118398
 \$ 2 13C2 PFHxA
 315.0 > 270.0 18.677 18.677 0.0 1.000 676525 9.80 22490
 3 Perfluorohexanesulfonic acid
 399.0 > 80.0 19.439 19.445 -0.006 1.000 1916602 46.5 21677
 4 Perfluoroheptanoic acid
 363.0 > 319.0 19.474 19.476 -0.002 1.000 950736 14.2 8948
 * 5 13C2-PFOA
 415.0 > 370.0 20.165 20.161 0.004 629057 10.0 17163
 6 Perfluorooctanoic acid
 413.0 > 369.0 20.165 20.161 0.004 1.000 1999775 29.1 2723
 7 Perfluorooctane sulfonic acid
 499.0 > 80.0 20.762 20.766 -0.004 1.000 2953057 61.8 3916
 * 8 13C4 PFOS
 503.0 > 80.0 20.797 20.793 0.004 1207331 28.7 21805
 9 Perfluorononanoic acid
 463.0 > 419.0 20.868 20.866 0.002 1.000 2133029 29.2 654
 \$ 10 13C2 PFDA
 515.0 > 470.0 21.604 21.597 0.007 1.000 587235 9.69 19826

Reagents:

LC537-L5_00019

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_009.d

Injection Date: 20-Jan-2017 15:11:21

Instrument ID: A6

Lims ID: STD L5

Client ID:

Operator ID: CBW

ALS Bottle#: 5

Worklist Smp#: 7

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

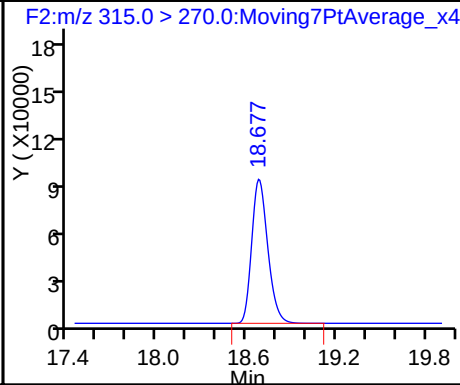

4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid

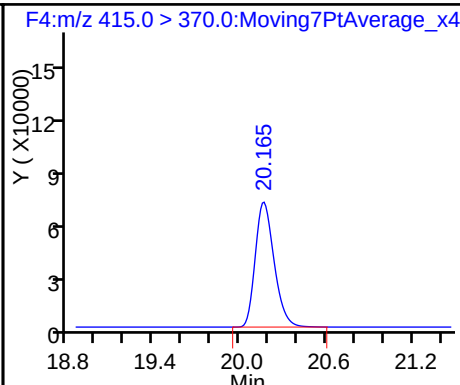


7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid

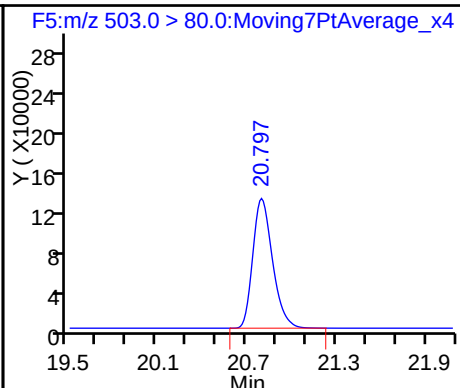

\$ 10 13C2 PFDA

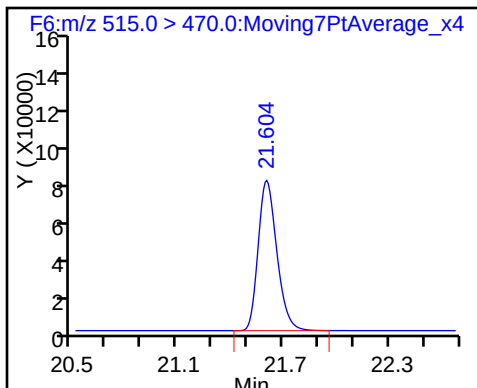

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Lims ID: STD L6
 Client ID:
 Sample Type: IC Calib Level: 6
 Inject. Date: 20-Jan-2017 15:40:56 ALS Bottle#: 6 Worklist Smp#: 8
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: STD L6 L6
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 21-Jan-2017 15:46:18 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK001

First Level Reviewer: barnettj

Date: 20-Jan-2017 16:18:53

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

1 Perfluorobutanesulfonic acid
 299.0 > 80.0 17.708 17.708 0.0 1.000 5108592 175.4 8476
 \$ 2 13C2 PFHxA
 315.0 > 270.0 18.677 18.677 0.0 1.000 632840 10.5 20922
 3 Perfluorohexanesulfonic acid
 399.0 > 80.0 19.439 19.445 -0.006 1.000 2300517 65.7 41737
 4 Perfluoroheptanoic acid
 363.0 > 319.0 19.474 19.476 -0.002 1.000 1182413 20.1 30740
 6 Perfluorooctanoic acid
 413.0 > 369.0 20.165 20.161 0.004 1.000 2393220 39.8 2801
 * 5 13C2-PFOA
 415.0 > 370.0 20.165 20.161 0.004 551000 10.0 20170
 7 Perfluorooctane sulfonic acid
 499.0 > 80.0 20.762 20.766 -0.004 1.000 3460463 85.3 5568
 * 8 13C4 PFOS
 503.0 > 80.0 20.797 20.793 0.004 1025171 28.7 18321
 9 Perfluorononanoic acid
 463.0 > 419.0 20.868 20.866 0.002 1.000 2671319 41.7 1186
 \$ 10 13C2 PFDA
 515.0 > 470.0 21.596 21.597 -0.001 1.000 546342 10.3 18528

Reagents:

LC537-L6_00016

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d

Injection Date: 20-Jan-2017 15:40:56

Instrument ID: A6

Lims ID: STD L6

Client ID:

Operator ID: CBW

ALS Bottle#: 6

Worklist Smp#: 8

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

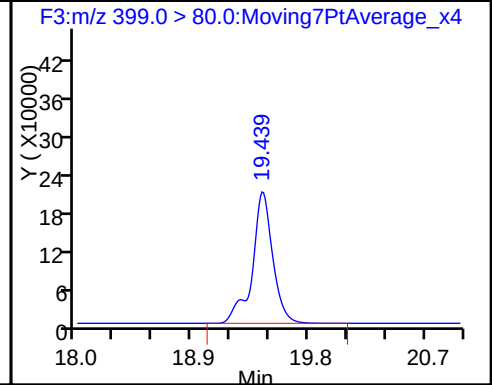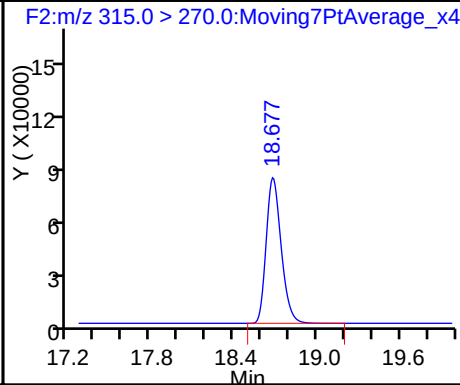

4 Perfluoroheptanoic acid

6 Perfluorooctanoic acid




* 5 13C2-PFOA

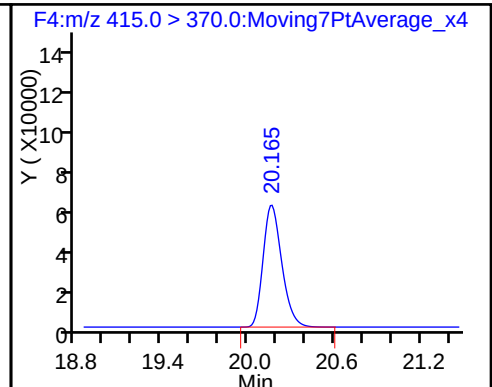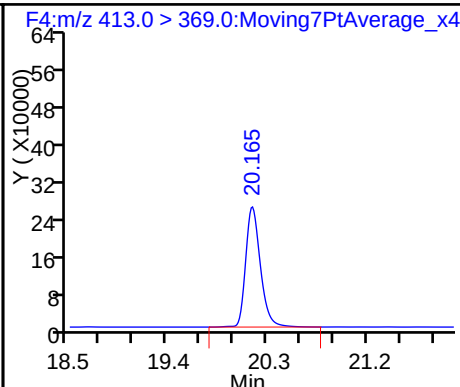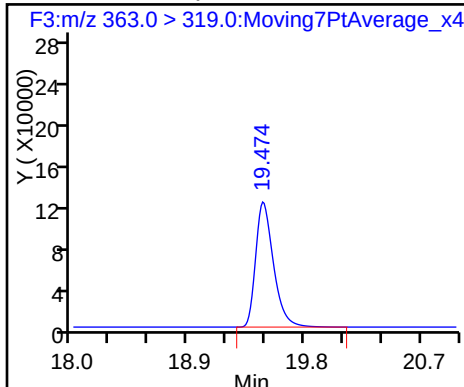


7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid

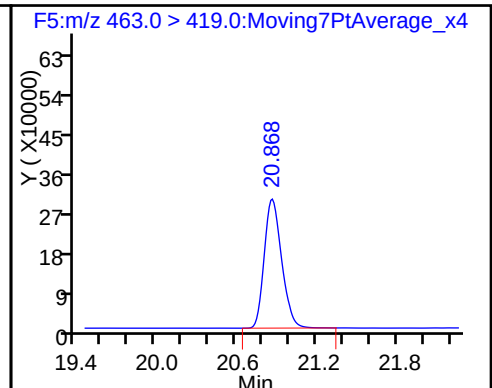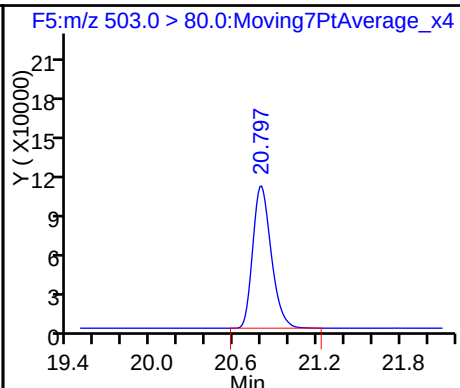

\$ 10 13C2 PFDA

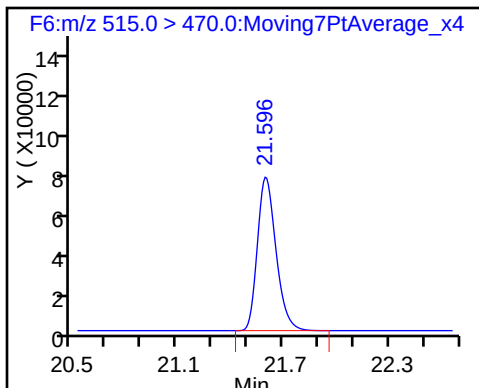

FORM VII
LCMS CONTINUING CALIBRATION DATA

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Lab Sample ID: CCV 320-147198/10 Calibration Date: 01/20/2017 16:40
 Instrument ID: A6 Calib Start Date: 01/20/2017 13:11
 GC Column: Acquity ID: 2.10 (mm) Calib End Date: 01/20/2017 15:40
 Lab File ID: 20JAN2016A6A_012.d Conc. Units: ng/mL

ANALYTE	CURVE TYPE	AVE RRF	RRF	MIN RRF	CALC AMOUNT	SPIKE AMOUNT	%D	MAX %D
Perfluorobutanesulfonic acid (PFBS)	Ave	0.8146	0.8737		24.5	22.9	7.3	50.0
Perfluorohexanesulfonic acid	Ave	0.9801	1.004		7.90	7.72	2.4	50.0
Perfluoroheptanoic acid	Ave	1.068	1.090		2.58	2.52	2.0	50.0
Perfluorooctanoic acid (PFOA)	Ave	1.091	1.084		4.95	4.98	-0.6	50.0
Perfluorooctanesulfonic acid (PFOS)	Ave	1.134	1.071		9.64	10.2	-5.6	50.0
Perfluorononanoic acid	Ave	1.162	1.210		5.51	5.29	4.1	50.0
13C2 PFHxA	Ave	1.097	1.094		9.98	10.0	-0.2	30.0
13C2 PFDA	Ave	0.9632	0.9401		9.76	10.0	-2.4	30.0

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_012.d
 Lims ID: CCV L2
 Client ID:
 Sample Type: CCVL
 Inject. Date: 20-Jan-2017 16:40:11 ALS Bottle#: 2 Worklist Smp#: 10
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: CCV L2 CCV L2
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 09:55:20 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: phomsophat

Date: 21-Jan-2017 15:21:46

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
1 Perfluorobutanesulfonic acid								
299.0 > 80.0	17.699	17.708	-0.009	1.000	808097	24.5	624	
\$ 2 13C2 PFHxA								
315.0 > 270.0	18.677	18.677	0.0	1.000	619360	9.98	20431	
3 Perfluorohexanesulfonic acid								
399.0 > 80.0	19.439	19.445	-0.006	1.000	312959	7.90	7478	
4 Perfluoroheptanoic acid								M
363.0 > 319.0	19.474	19.476	-0.002	1.000	155662	2.58	89.2	M
* 5 13C2-PFOA								
415.0 > 370.0	20.153	20.161	-0.008		565892	10.0	15592	
6 Perfluorooctanoic acid								M
413.0 > 369.0	20.153	20.161	-0.008	1.000	305373	4.95	174	M
7 Perfluorooctane sulfonic acid								
499.0 > 80.0	20.762	20.766	-0.004	1.000	442018	9.64	6719	
* 8 13C4 PFOS								
503.0 > 80.0	20.797	20.793	0.004		1158929	28.7	31529	
9 Perfluorononanoic acid								
463.0 > 419.0	20.868	20.866	0.002	1.000	362111	5.51	293	
\$ 10 13C2 PFDA								
515.0 > 470.0	21.604	21.597	0.007	1.000	532008	9.76	17984	

QC Flag Legend

Review Flags

M - Manually Integrated

Reagents:

LC537-L2_00016

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_012.d

Injection Date: 20-Jan-2017 16:40:11

Instrument ID: A6

Lims ID: CCV L2

Client ID:

Operator ID: CBW

ALS Bottle#: 2

Worklist Smp#: 10

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

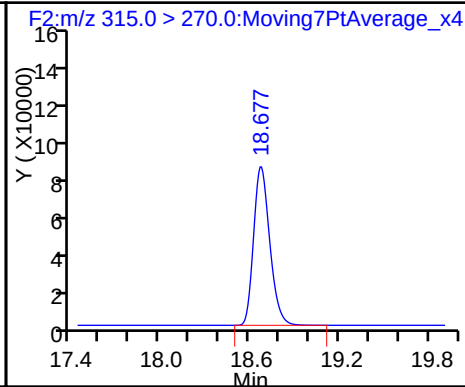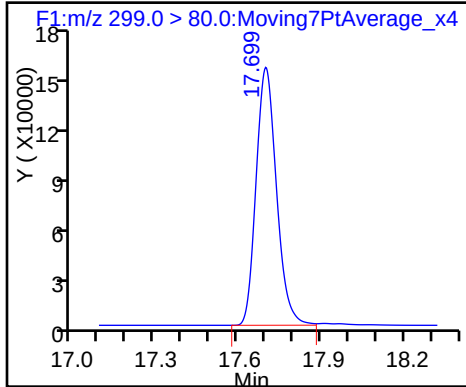

4 Perfluoroheptanoic acid (M)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (M)

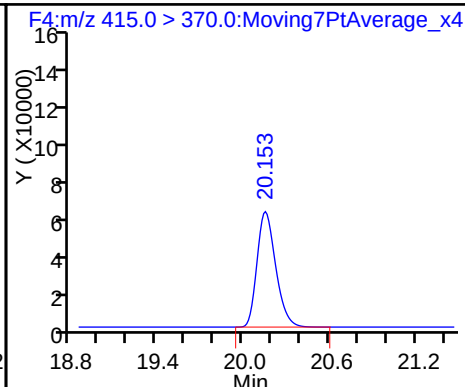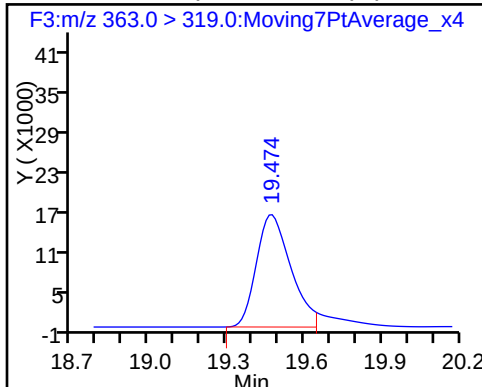


7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid

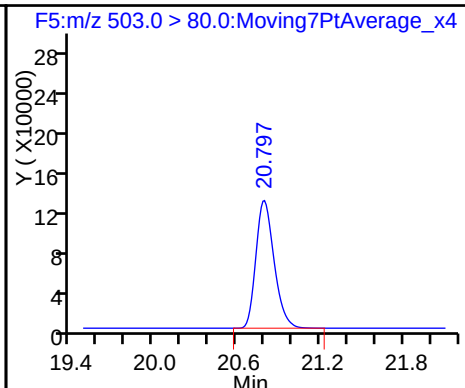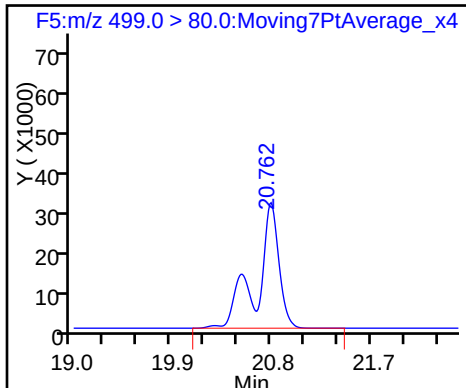

\$ 10 13C2 PFDA

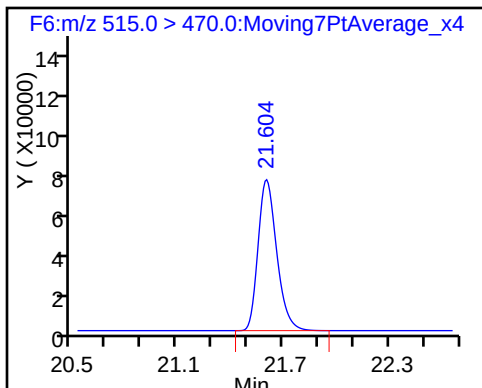

TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_012.d
Injection Date: 20-Jan-2017 16:40:11 Instrument ID: A6
Lims ID: CCV L2
Client ID:
Operator ID: CBW ALS Bottle#: 2 Worklist Smp#: 10
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F3:MRM

4 Perfluoroheptanoic acid, CAS: 375-85-9

Signal: 1


RT: 19.47
Area: 172011
Amount: 2.846205
Amount Units: ng/ml

Processing Integration Results

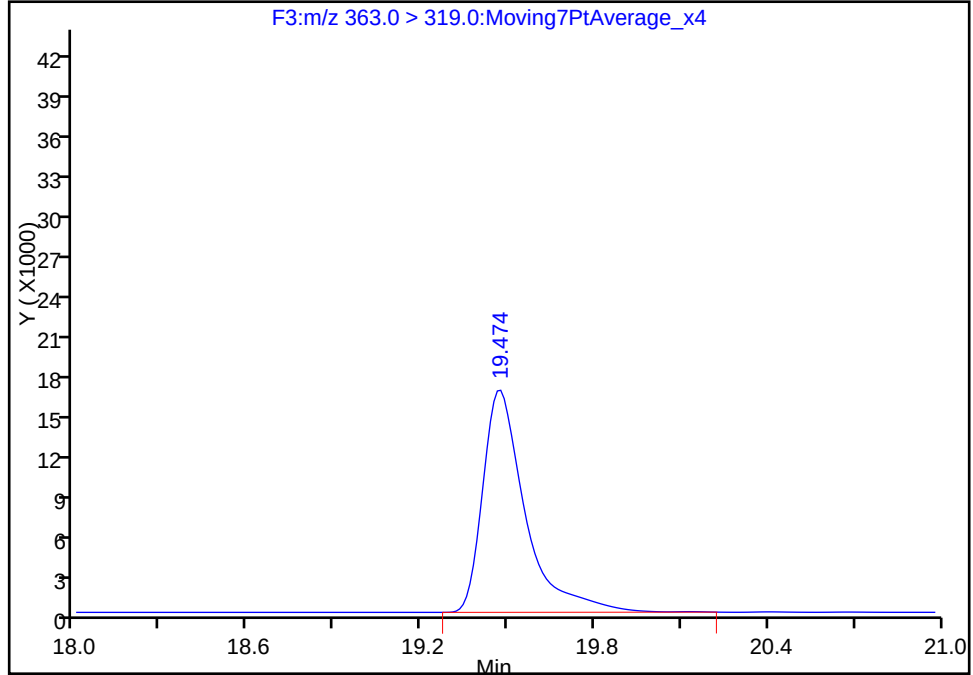

RT: 19.47
Area: 155662
Amount: 2.575684
Amount Units: ng/ml

Manual Integration Results

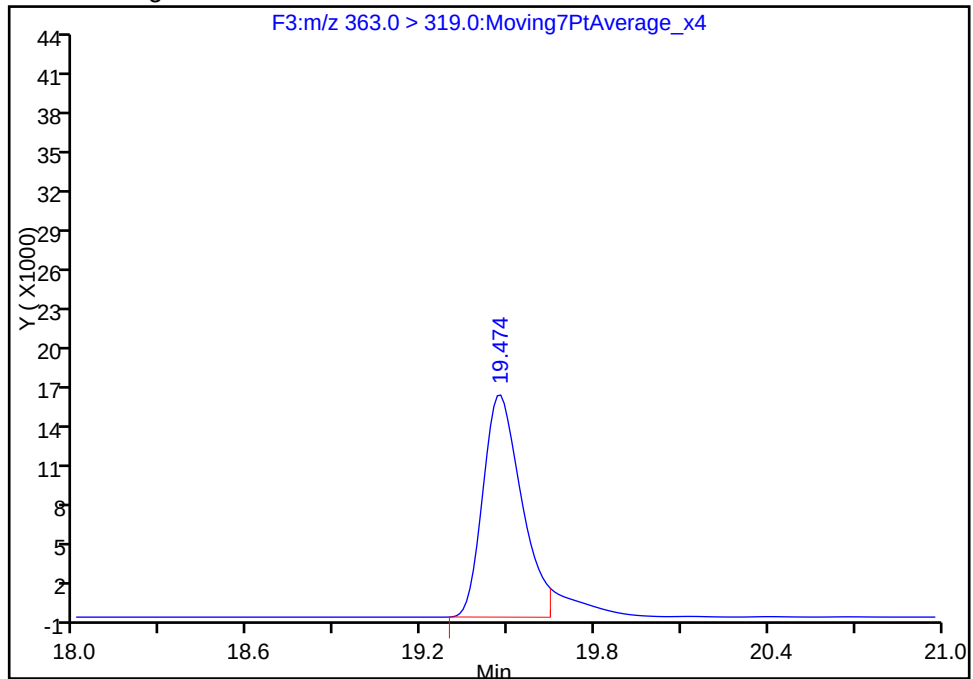

Reviewer: phomsophat, 21-Jan-2017 15:21:46

Audit Action: Manually Integrated

Audit Reason: Baseline

TestAmerica Sacramento


Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_012.d
Injection Date: 20-Jan-2017 16:40:11 Instrument ID: A6
Lims ID: CCV L2
Client ID:
Operator ID: CBW ALS Bottle#: 2 Worklist Smp#: 10
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Method: 537__A6 Limit Group: LC 537 ICAL
Column: Acquity BEH C18 (2.10 mm) Detector F4:MRM

6 Perfluorooctanoic acid, CAS: 335-67-1

Signal: 1


RT: 20.15
Area: 321626
Amount: 5.210685
Amount Units: ng/ml

Processing Integration Results

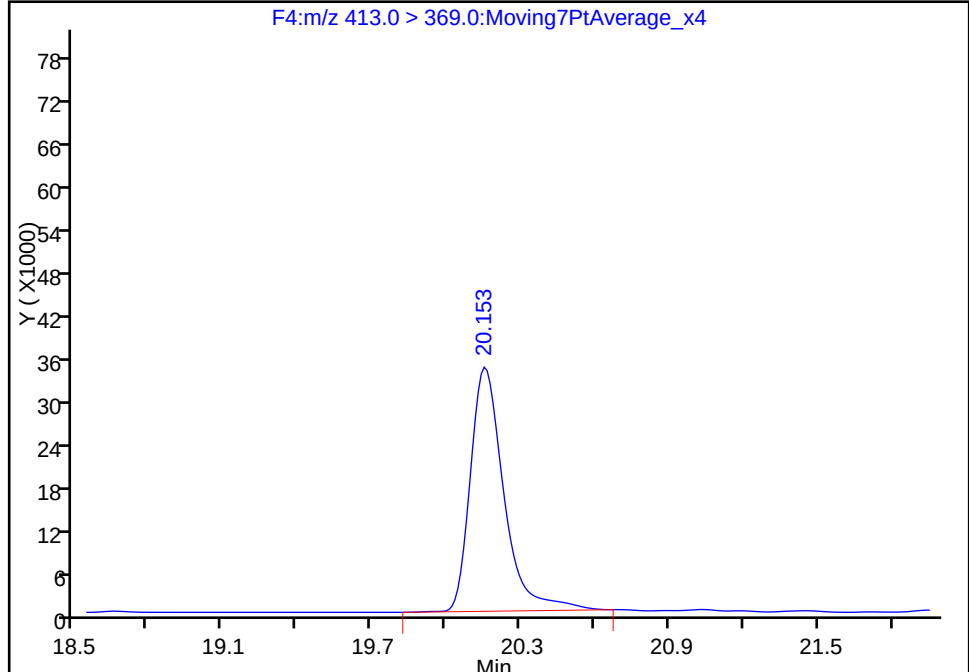

RT: 20.15
Area: 305373
Amount: 4.947369
Amount Units: ng/ml

Manual Integration Results

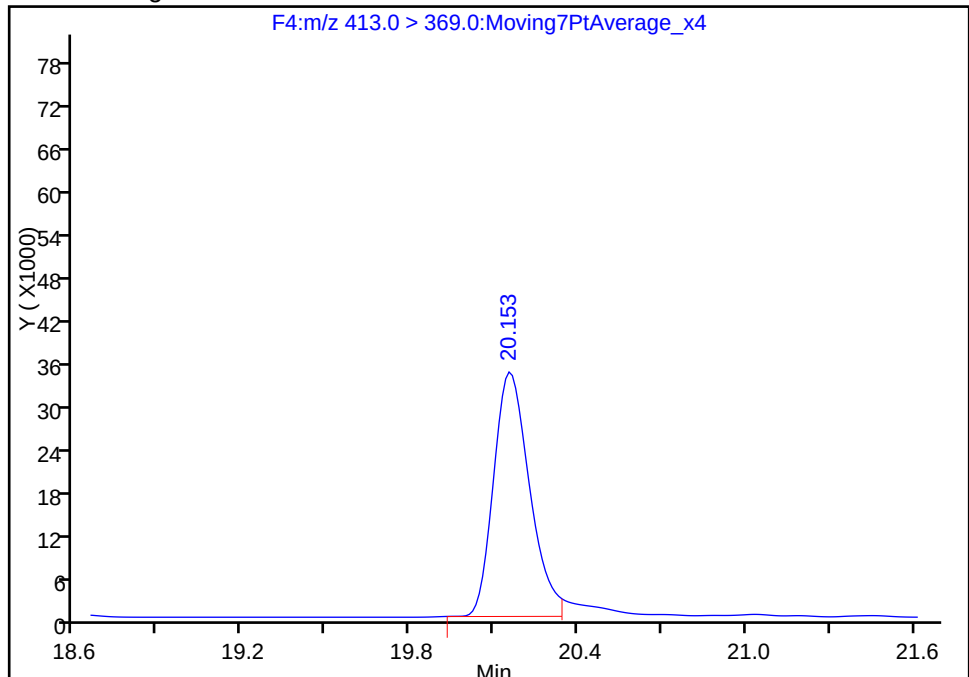

Reviewer: phomsophat, 21-Jan-2017 15:21:46

Audit Action: Manually Integrated

Audit Reason: Baseline

FORM VII
LCMS CONTINUING CALIBRATION DATA

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Lab Sample ID: ICV 320-147198/12 Calibration Date: 01/20/2017 17:39
 Instrument ID: A6 Calib Start Date: 01/20/2017 13:11
 GC Column: Acquity ID: 2.10 (mm) Calib End Date: 01/20/2017 15:40
 Lab File ID: 20JAN2016A6A_014.d Conc. Units: ng/mL

ANALYTE	CURVE TYPE	AVE RRF	RRF	MIN RRF	CALC AMOUNT	SPIKE AMOUNT	%D	MAX %D
Perfluorobutanesulfonic acid (PFBS)	Ave	0.8146	0.6337		89.3	115	-22.2	30.0
Perfluorohexanesulfonic acid	Ave	0.9801	0.7768		21.0	26.5	-20.8	30.0
Perfluoroheptanoic acid	Ave	1.068	0.9928		11.7	12.6	-7.0	30.0
Perfluorooctanoic acid (PFOA)	Ave	1.091	0.8986		20.6	25.0	-17.6	30.0
Perfluorooctanesulfonic acid (PFOS)	Ave	1.134	0.8821		21.2	27.2	-22.2	30.0
Perfluorononanoic acid	Ave	1.162	0.9346		20.1	25.0	-19.5	30.0
13C2 PFHxA	Ave	1.097	1.200		10.9	10.0	9.4	30.0
13C2 PFDA	Ave	0.9632	0.9438		9.80	10.0	-2.0	30.0

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_014.d
 Lims ID: ICV
 Client ID:
 Sample Type: ICV
 Inject. Date: 20-Jan-2017 17:39:23 ALS Bottle#: 7 Worklist Smp#: 12
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: ICV ICV
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist:
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 09:55:23 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: phomsophat

Date: 21-Jan-2017 15:29:14

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

1 Perfluorobutanesulfonic acid
 299.0 > 80.0 17.699 17.708 -0.009 1.000 2711247 89.3 1536
 \$ 2 13C2 PFHxA
 315.0 > 270.0 18.667 18.677 -0.010 1.000 653894 10.9 21816
 3 Perfluorohexanesulfonic acid
 399.0 > 80.0 19.439 19.445 -0.006 1.000 766858 21.0 18047
 4 Perfluoroheptanoic acid
 363.0 > 319.0 19.463 19.476 -0.013 1.000 681805 11.7 8869
 * 5 13C2-PFOA
 415.0 > 370.0 20.153 20.161 -0.008 545066 10.0 15057
 6 Perfluorooctanoic acid
 413.0 > 369.0 20.153 20.161 -0.008 1.000 1225640 20.6 2015
 7 Perfluorooctane sulfonic acid
 499.0 > 80.0 20.762 20.766 -0.004 1.000 895701 21.2 6360
 * 8 13C4 PFOS
 503.0 > 80.0 20.786 20.793 -0.007 1069204 28.7 23211
 9 Perfluorononanoic acid
 463.0 > 419.0 20.868 20.866 0.002 1.000 1274022 20.1 1342
 \$ 10 13C2 PFDA
 515.0 > 470.0 21.604 21.597 0.007 1.000 514432 9.80 17486

Reagents:

LC537-ICV_00019

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_014.d

Injection Date: 20-Jan-2017 17:39:23

Instrument ID: A6

Lims ID: ICV

Client ID:

Operator ID: CBW

ALS Bottle#: 7

Worklist Smp#: 12

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537_A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

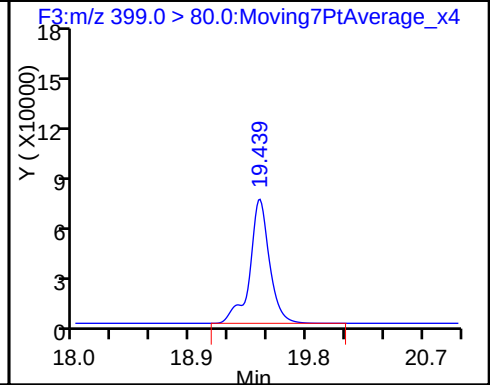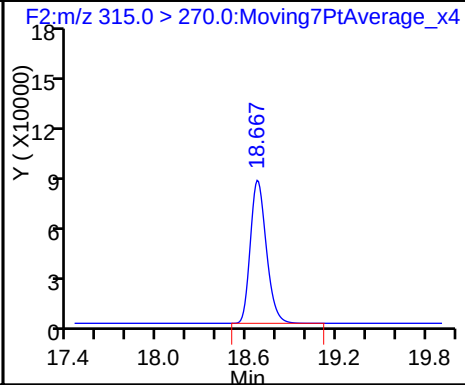

4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid

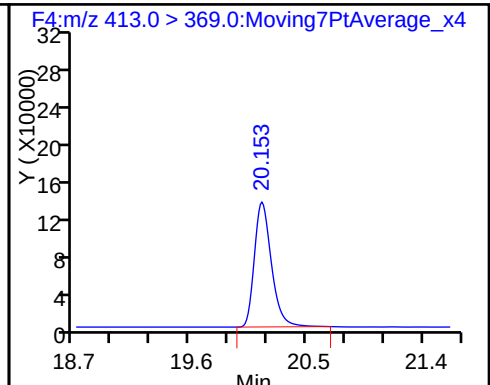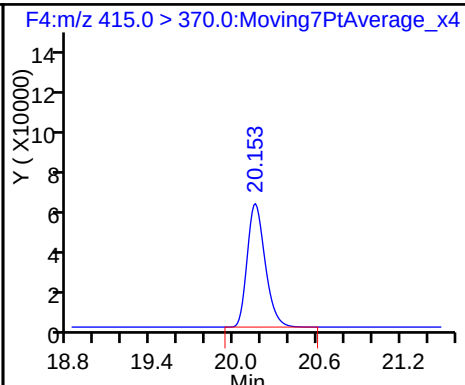


7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid

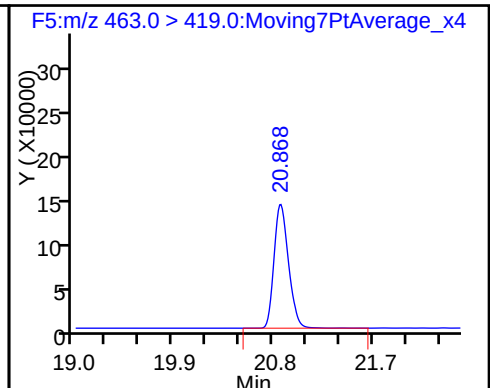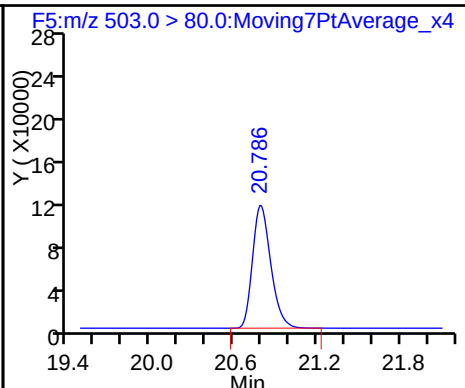

\$ 10 13C2 PFDA



FORM VII
LCMS CONTINUING CALIBRATION DATA

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Lab Sample ID: CCV 320-147271/60 Calibration Date: 01/21/2017 17:21
 Instrument ID: A6 Calib Start Date: 01/20/2017 13:11
 GC Column: Acquity ID: 2.10 (mm) Calib End Date: 01/20/2017 15:40
 Lab File ID: 20JAN2016A6A_062.d Conc. Units: ng/mL

ANALYTE	CURVE TYPE	AVE RRF	RRF	MIN RRF	CALC AMOUNT	SPIKE AMOUNT	%D	MAX %D
Perfluorobutanesulfonic acid (PFBS)	Ave	0.8146	0.7714		42.7	45.1	-5.3	30.0
Perfluorohexanesulfonic acid	Ave	0.9801	0.9123		14.2	15.2	-6.9	30.0
Perfluoroheptanoic acid	Ave	1.068	1.295		6.03	4.97	21.3	30.0
Perfluorooctanoic acid (PFOA)	Ave	1.091	1.191		10.7	9.81	9.2	30.0
Perfluorooctanesulfonic acid (PFOS)	Ave	1.134	1.115		19.8	20.1	-1.7	30.0
Perfluorononanoic acid	Ave	1.162	1.295		11.6	10.4	11.5	30.0
13C2 PFHxA	Ave	1.097	1.281		11.7	10.0	16.8	30.0
13C2 PFDA	Ave	0.9632	1.077		11.2	10.0	11.9	30.0

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_062.d
 Lims ID: CCV L3
 Client ID:
 Sample Type: CCVIS
 Inject. Date: 21-Jan-2017 17:21:29 ALS Bottle#: 3 Worklist Smp#: 60
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: CCV L3
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 11:05:02 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
1 Perfluorobutanesulfonic acid								
299.0 > 80.0	17.689	17.708	-0.019	1.000	1755086	42.7	66508	
\$ 2 13C2 PFHxA								
315.0 > 270.0	18.667	18.677	-0.010	1.000	933620	11.7	30953	
3 Perfluorohexanesulfonic acid								
399.0 > 80.0	19.427	19.445	-0.018	1.000	699733	14.2	16228	
4 Perfluoroheptanoic acid								
363.0 > 319.0	19.463	19.476	-0.013	1.000	469579	6.03	6902	
* 5 13C2-PFOA								
415.0 > 370.0	20.153	20.161	-0.008		728835	10.0	20080	
6 Perfluorooctanoic acid								
413.0 > 369.0	20.153	20.161	-0.008	1.000	851556	10.7	816	
7 Perfluorooctane sulfonic acid								
499.0 > 80.0	20.785	20.766	0.019	1.000	1132375	19.8	19643	
* 8 13C4 PFOS								
503.0 > 80.0	20.785	20.793	-0.008		1446705	28.7	22435	
9 Perfluorononanoic acid								
463.0 > 419.0	20.856	20.866	-0.010	1.000	983962	11.6	4491	
\$ 10 13C2 PFDA								
515.0 > 470.0	21.587	21.597	-0.010	1.000	785296	11.2	15206	

Reagents:

LC537-L3_00018

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_062.d

Injection Date: 21-Jan-2017 17:21:29

Instrument ID: A6

Lims ID: CCV L3

Client ID:

Operator ID: CBW

ALS Bottle#: 3

Worklist Smp#: 60

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537_A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid



4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid




7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid



\$ 10 13C2 PFDA



FORM VII
LCMS CONTINUING CALIBRATION DATA

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Lab Sample ID: CCV 320-147271/116 Calibration Date: 01/21/2017 23:16
 Instrument ID: A6 Calib Start Date: 01/20/2017 13:11
 GC Column: Acquity ID: 2.10 (mm) Calib End Date: 01/20/2017 15:40
 Lab File ID: 20JAN2016A6A_074.d Conc. Units: ng/mL

ANALYTE	CURVE TYPE	AVE RRF	RRF	MIN RRF	CALC AMOUNT	SPIKE AMOUNT	%D	MAX %D
Perfluorobutanesulfonic acid (PFBS)	Ave	0.8146	0.7219		119	135	-11.4	30.0
Perfluorohexanesulfonic acid	Ave	0.9801	1.002		46.4	45.4	2.2	30.0
Perfluoroheptanoic acid	Ave	1.068	1.158		16.1	14.9	8.4	30.0
Perfluorooctanoic acid (PFOA)	Ave	1.091	1.124		30.2	29.3	3.0	30.0
Perfluorooctanesulfonic acid (PFOS)	Ave	1.134	1.187		62.9	60.1	4.6	30.0
Perfluorononanoic acid	Ave	1.162	1.199		32.1	31.1	3.2	30.0
13C2 PFHxA	Ave	1.097	1.293		11.8	10.0	17.9	30.0
13C2 PFDA	Ave	0.9632	1.088		11.3	10.0	12.9	30.0

FORM VII
LCMS CONTINUING CALIBRATION DATA

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Lab Sample ID: CCV 320-147339/116 Calibration Date: 01/21/2017 23:16
 Instrument ID: A6 Calib Start Date: 01/20/2017 13:11
 GC Column: Acquity ID: 2.10 (mm) Calib End Date: 01/20/2017 15:40
 Lab File ID: 20JAN2016A6A_074.d Conc. Units: ng/mL

ANALYTE	CURVE TYPE	AVE RRF	RRF	MIN RRF	CALC AMOUNT	SPIKE AMOUNT	%D	MAX %D
Perfluorobutanesulfonic acid (PFBS)	Ave	0.8146	0.7219		119	135	-11.4	30.0
Perfluorohexanesulfonic acid	Ave	0.9801	1.002		46.4	45.4	2.2	30.0
Perfluoroheptanoic acid	Ave	1.068	1.158		16.1	14.9	8.4	30.0
Perfluorooctanoic acid (PFOA)	Ave	1.091	1.124		30.2	29.3	3.0	30.0
Perfluorooctanesulfonic acid (PFOS)	Ave	1.134	1.187		62.9	60.1	4.6	30.0
Perfluorononanoic acid	Ave	1.162	1.199		32.1	31.1	3.2	30.0
13C2 PFHxA	Ave	1.097	1.293		11.8	10.0	17.9	30.0
13C2 PFDA	Ave	0.9632	1.088		11.3	10.0	12.9	30.0

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_074.d
 Lims ID: CCV L5
 Client ID:
 Sample Type: CCVIS
 Inject. Date: 21-Jan-2017 23:16:46 ALS Bottle#: 5 Worklist Smp#: 116
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: CCV L5
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:21:47 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
1 Perfluorobutanesulfonic acid								
299.0 > 80.0	17.673	17.708	-0.035	1.000	4569448	119.3	38841	
\$ 2 13C2 PFHxA								
315.0 > 270.0	18.649	18.677	-0.028	1.000	1035241	11.8	27576	
3 Perfluorohexanesulfonic acid								
399.0 > 80.0	19.415	19.445	-0.030	1.000	2138214	46.4	49821	
4 Perfluoroheptanoic acid								
363.0 > 319.0	19.451	19.476	-0.025	1.000	1376883	16.1	36047	
* 5 13C2-PFOA								
415.0 > 370.0	20.130	20.161	-0.031		800746	10.0	22001	
6 Perfluorooctanoic acid								
413.0 > 369.0	20.130	20.161	-0.031	1.000	2634077	30.2	2152	
7 Perfluorooctane sulfonic acid								
499.0 > 80.0	20.773	20.766	0.007	1.000	3353628	62.9	35404	
* 8 13C4 PFOS								
503.0 > 80.0	20.773	20.793	-0.020		1348380	28.7	29132	
9 Perfluorononanoic acid								
463.0 > 419.0	20.856	20.866	-0.010	1.000	2986101	32.1	6123	
\$ 10 13C2 PFDA								
515.0 > 470.0	21.604	21.597	0.007	1.000	871066	11.3	29402	

Reagents:

LC537-L5_00019

Amount Added: 1.00

Units: mL

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_074.d
 Lims ID: CCV L5
 Client ID:
 Sample Type: CCVIS
 Inject. Date: 21-Jan-2017 23:16:46 ALS Bottle#: 5 Worklist Smp#: 116
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: CCV L5
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 14:05:16 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 14:05:16

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

1 Perfluorobutanesulfonic acid
 299.0 > 80.0 17.673 17.708 -0.035 1.000 4569448 119.3 38841
 \$ 2 13C2 PFHxA
 315.0 > 270.0 18.649 18.677 -0.028 1.000 1035241 11.8 27576
 3 Perfluorohexanesulfonic acid
 399.0 > 80.0 19.415 19.445 -0.030 1.000 2138214 46.4 49821
 4 Perfluoroheptanoic acid
 363.0 > 319.0 19.451 19.476 -0.025 1.000 1376883 16.1 36047
 * 5 13C2-PFOA
 415.0 > 370.0 20.130 20.161 -0.031 800746 10.0 22001
 6 Perfluorooctanoic acid
 413.0 > 369.0 20.130 20.161 -0.031 1.000 2634077 30.2 2152
 7 Perfluorooctane sulfonic acid
 499.0 > 80.0 20.773 20.766 0.007 1.000 3353628 62.9 35404
 * 8 13C4 PFOS
 503.0 > 80.0 20.773 20.793 -0.020 1348380 28.7 29132
 9 Perfluorononanoic acid
 463.0 > 419.0 20.856 20.866 -0.010 1.000 2986101 32.1 6123
 \$ 10 13C2 PFDA
 515.0 > 470.0 21.604 21.597 0.007 1.000 871066 11.3 29402

Reagents:

LC537-L5_00019

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_074.d

Injection Date: 21-Jan-2017 23:16:46

Instrument ID: A6

Lims ID: CCV L5

Client ID:

Operator ID: CBW

ALS Bottle#: 5

Worklist Smp#: 116

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

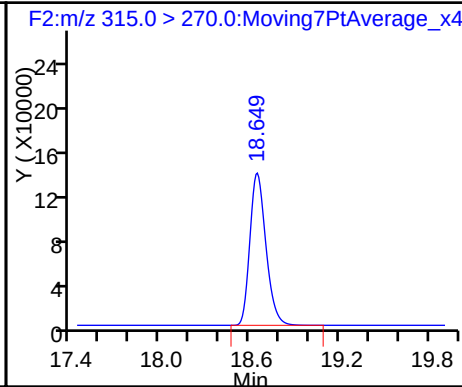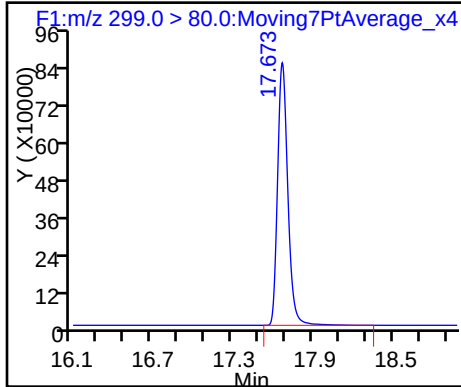

4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid

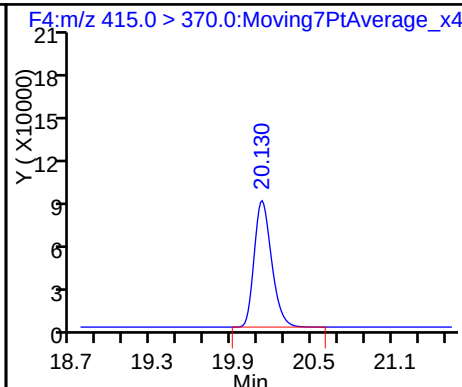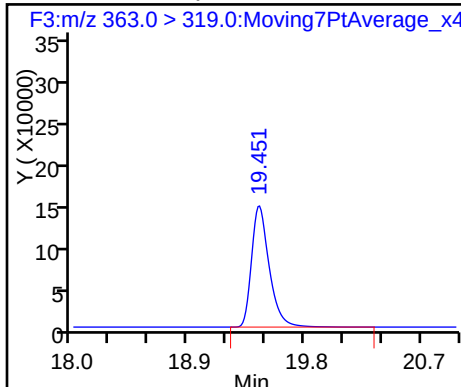


7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid



\$ 10 13C2 PFDA



TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_074.d

Injection Date: 21-Jan-2017 23:16:46

Instrument ID: A6

Lims ID: CCV L5

Client ID:

Operator ID: CBW

ALS Bottle#: 5

Worklist Smp#: 116

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

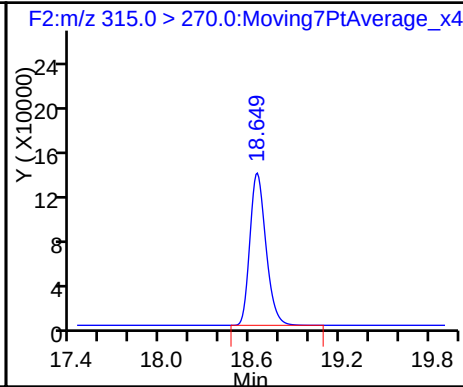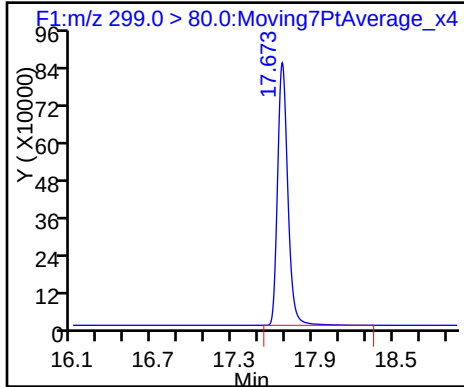

4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid

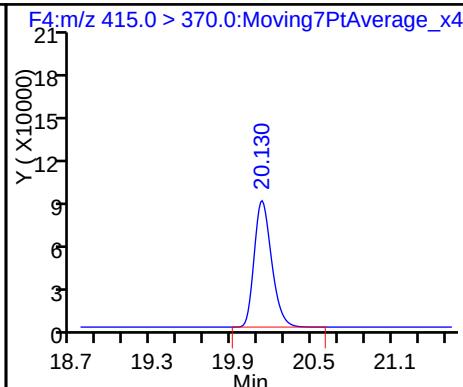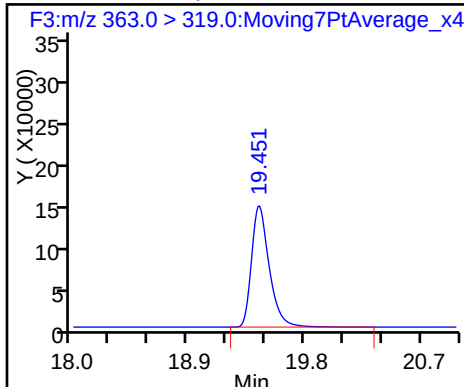


7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid



\$ 10 13C2 PFDA



FORM VII
LCMS CONTINUING CALIBRATION DATA

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Lab Sample ID: CCV 320-147339/129 Calibration Date: 01/22/2017 05:12
 Instrument ID: A6 Calib Start Date: 01/20/2017 13:11
 GC Column: Acquity ID: 2.10 (mm) Calib End Date: 01/20/2017 15:40
 Lab File ID: 20JAN2016A6A_086.d Conc. Units: ng/mL

ANALYTE	CURVE TYPE	AVE RRF	RRF	MIN RRF	CALC AMOUNT	SPIKE AMOUNT	%D	MAX %D
Perfluorobutanesulfonic acid (PFBS)	Ave	0.8146	0.7361		40.8	45.1	-9.6	30.0
Perfluorohexanesulfonic acid	Ave	0.9801	0.9754		15.1	15.2	-0.5	30.0
Perfluoroheptanoic acid	Ave	1.068	1.286		5.99	4.97	20.4	30.0
Perfluorooctanoic acid (PFOA)	Ave	1.091	1.180		10.6	9.81	8.2	30.0
Perfluorooctanesulfonic acid (PFOS)	Ave	1.134	1.103		19.6	20.1	-2.7	30.0
Perfluorononanoic acid	Ave	1.162	1.283		11.5	10.4	10.4	30.0
13C2 PFHxA	Ave	1.097	1.211		11.0	10.0	10.4	30.0
13C2 PFDA	Ave	0.9632	1.043		10.8	10.0	8.3	30.0

FORM VII
LCMS CONTINUING CALIBRATION DATA

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Lab Sample ID: CCV 320-147340/129 Calibration Date: 01/22/2017 05:12
 Instrument ID: A6 Calib Start Date: 01/20/2017 13:11
 GC Column: Acquity ID: 2.10 (mm) Calib End Date: 01/20/2017 15:40
 Lab File ID: 20JAN2016A6A_086.d Conc. Units: ng/mL

ANALYTE	CURVE TYPE	AVE RRF	RRF	MIN RRF	CALC AMOUNT	SPIKE AMOUNT	%D	MAX %D
Perfluorobutanesulfonic acid (PFBS)	Ave	0.8146	0.7361		40.8	45.1	-9.6	30.0
Perfluorohexanesulfonic acid	Ave	0.9801	0.9754		15.1	15.2	-0.5	30.0
Perfluoroheptanoic acid	Ave	1.068	1.286		5.99	4.97	20.4	30.0
Perfluorooctanoic acid (PFOA)	Ave	1.091	1.180		10.6	9.81	8.2	30.0
Perfluorooctanesulfonic acid (PFOS)	Ave	1.134	1.103		19.6	20.1	-2.7	30.0
Perfluorononanoic acid	Ave	1.162	1.283		11.5	10.4	10.4	30.0
13C2 PFHxA	Ave	1.097	1.211		11.0	10.0	10.4	30.0
13C2 PFDA	Ave	0.9632	1.043		10.8	10.0	8.3	30.0

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_086.d
 Lims ID: CCV L3
 Client ID:
 Sample Type: CCVIS
 Inject. Date: 22-Jan-2017 05:12:05 ALS Bottle#: 3 Worklist Smp#: 129
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: CCV L3
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:32:10 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
1 Perfluorobutanesulfonic acid								
299.0 > 80.0	17.679	17.708	-0.029	1.000	1618814	40.8	1053	
\$ 2 13C2 PFHxA								
315.0 > 270.0	18.658	18.677	-0.019	1.000	923354	11.0	30916	
3 Perfluorohexanesulfonic acid								
399.0 > 80.0	19.415	19.445	-0.030	1.000	723111	15.1	17148	
4 Perfluoroheptanoic acid								
363.0 > 319.0	19.451	19.476	-0.025	1.000	487754	5.99	12591	
* 5 13C2-PFOA								
415.0 > 370.0	20.130	20.161	-0.031		762579	10.0	21044	
6 Perfluorooctanoic acid								
413.0 > 369.0	20.141	20.161	-0.020	1.000	882762	10.6	770	
7 Perfluorooctane sulfonic acid								
499.0 > 80.0	20.774	20.766	0.008	1.000	1083044	19.6	18722	
* 8 13C4 PFOS								
503.0 > 80.0	20.774	20.793	-0.019		1398329	28.7	38010	
9 Perfluorononanoic acid								
463.0 > 419.0	20.845	20.866	-0.021	1.000	1019441	11.5	12451	
\$ 10 13C2 PFDA								
515.0 > 470.0	21.578	21.597	-0.019	1.000	795433	10.8	26978	

Reagents:

LC537-L3_00018

Amount Added: 1.00

Units: mL

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_086.d
 Lims ID: CCV L3
 Client ID:
 Sample Type: CCVIS
 Inject. Date: 22-Jan-2017 05:12:05 ALS Bottle#: 3 Worklist Smp#: 129
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: CCV L3
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:32:10 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
1 Perfluorobutanesulfonic acid								
299.0 > 80.0	17.679	17.708	-0.029	1.000	1618814	40.8	1053	
\$ 2 13C2 PFHxA								
315.0 > 270.0	18.658	18.677	-0.019	1.000	923354	11.0	30916	
3 Perfluorohexanesulfonic acid								
399.0 > 80.0	19.415	19.445	-0.030	1.000	723111	15.1	17148	
4 Perfluoroheptanoic acid								
363.0 > 319.0	19.451	19.476	-0.025	1.000	487754	5.99	12591	
* 5 13C2-PFOA								
415.0 > 370.0	20.130	20.161	-0.031		762579	10.0	21044	
6 Perfluorooctanoic acid								
413.0 > 369.0	20.141	20.161	-0.020	1.000	882762	10.6	770	
7 Perfluorooctane sulfonic acid								
499.0 > 80.0	20.774	20.766	0.008	1.000	1083044	19.6	18722	
* 8 13C4 PFOS								
503.0 > 80.0	20.774	20.793	-0.019		1398329	28.7	38010	
9 Perfluorononanoic acid								
463.0 > 419.0	20.845	20.866	-0.021	1.000	1019441	11.5	12451	
\$ 10 13C2 PFDA								
515.0 > 470.0	21.578	21.597	-0.019	1.000	795433	10.8	26978	

Reagents:

LC537-L3_00018

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_086.d

Injection Date: 22-Jan-2017 05:12:05

Instrument ID: A6

Lims ID: CCV L3

Client ID:

Operator ID: CBW

ALS Bottle#: 3

Worklist Smp#: 129

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537_A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

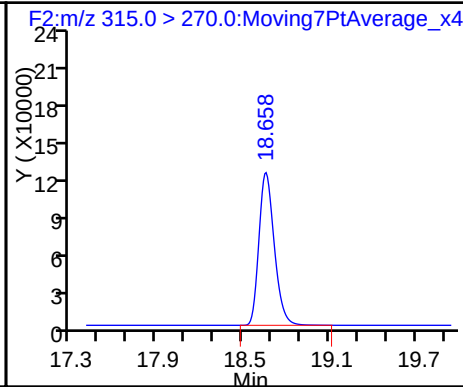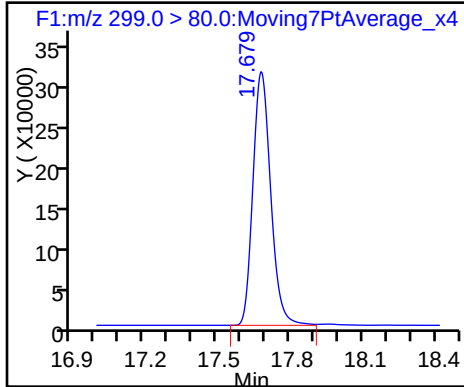

4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid




7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid



\$ 10 13C2 PFDA



TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_086.d

Injection Date: 22-Jan-2017 05:12:05

Instrument ID: A6

Lims ID: CCV L3

Client ID:

Operator ID: CBW

ALS Bottle#: 3

Worklist Smp#: 129

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537_A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid



4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid




7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid



\$ 10 13C2 PFDA



FORM VII
LCMS CONTINUING CALIBRATION DATA

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Lab Sample ID: CCV 320-147340/133 Calibration Date: 01/22/2017 07:40
 Instrument ID: A6 Calib Start Date: 01/20/2017 13:11
 GC Column: Acquity ID: 2.10 (mm) Calib End Date: 01/20/2017 15:40
 Lab File ID: 20JAN2016A6A_091.d Conc. Units: ng/mL

ANALYTE	CURVE TYPE	AVE RRF	RRF	MIN RRF	CALC AMOUNT	SPIKE AMOUNT	%D	MAX %D
Perfluorobutanesulfonic acid (PFBS)	Ave	0.8146	0.7578		125	135	-7.0	30.0
Perfluorohexanesulfonic acid	Ave	0.9801	1.036		48.0	45.4	5.7	30.0
Perfluoroheptanoic acid	Ave	1.068	1.201		16.7	14.9	12.4	30.0
Perfluorooctanoic acid (PFOA)	Ave	1.091	1.131		30.4	29.3	3.7	30.0
Perfluorooctanesulfonic acid (PFOS)	Ave	1.134	1.209		64.1	60.1	6.6	30.0
Perfluorononanoic acid	Ave	1.162	1.229		32.9	31.1	5.8	30.0
13C2 PFHxA	Ave	1.097	1.263		11.5	10.0	15.2	30.0
13C2 PFDA	Ave	0.9632	1.074		11.2	10.0	11.5	30.0

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_091.d
 Lims ID: CCV L5
 Client ID:
 Sample Type: CCVIS
 Inject. Date: 22-Jan-2017 07:40:07 ALS Bottle#: 5 Worklist Smp#: 133
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: CCV L5
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Sublist: chrom-537__A6*sub3
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:32:16 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
1 Perfluorobutanesulfonic acid								
299.0 > 80.0	17.679	17.708	-0.029	1.000	4620479	125.2	11404	
\$ 2 13C2 PFHxA								
315.0 > 270.0	18.658	18.677	-0.019	1.000	980004	11.5	32619	
3 Perfluorohexanesulfonic acid								
399.0 > 80.0	19.415	19.445	-0.030	1.000	2129982	48.0	49467	
4 Perfluoroheptanoic acid								
363.0 > 319.0	19.451	19.476	-0.025	1.000	1383267	16.7	24310	
* 5 13C2-PFOA								
415.0 > 370.0	20.130	20.161	-0.031		775762	10.0	21166	
6 Perfluorooctanoic acid								
413.0 > 369.0	20.130	20.161	-0.031	1.000	2569003	30.4	1969	
7 Perfluorooctane sulfonic acid								
499.0 > 80.0	20.762	20.766	-0.004	1.000	3290749	64.1	43485	
* 8 13C4 PFOS								
503.0 > 80.0	20.762	20.793	-0.031		1298870	28.7	34884	
9 Perfluorononanoic acid								
463.0 > 419.0	20.833	20.866	-0.033	1.000	2966952	32.9	13932	
\$ 10 13C2 PFDA								
515.0 > 470.0	21.578	21.597	-0.019	1.000	833311	11.2	28110	

Reagents:

LC537-L5_00019

Amount Added: 1.00

Units: mL

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_091.d

Injection Date: 22-Jan-2017 07:40:07

Instrument ID: A6

Lims ID: CCV L5

Client ID:

Operator ID: CBW

ALS Bottle#: 5

Worklist Smp#: 133

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

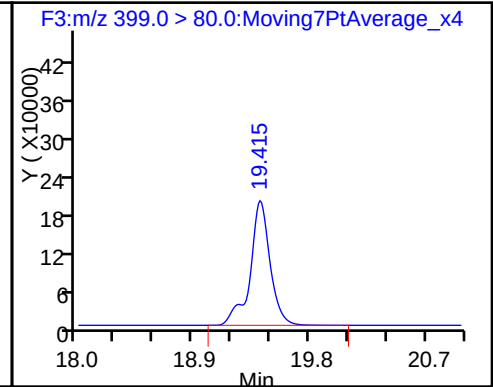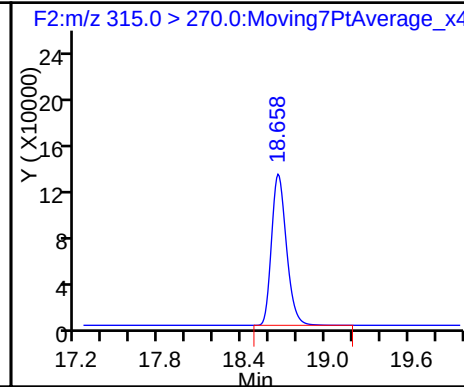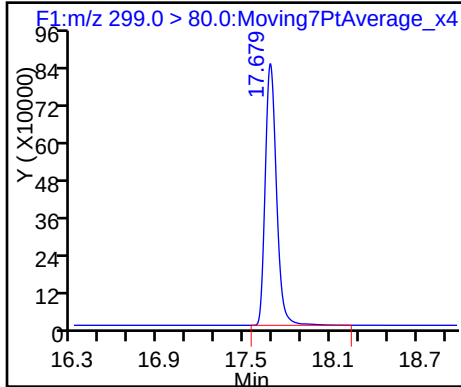

4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid

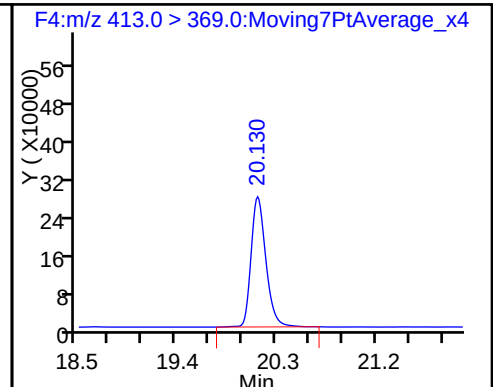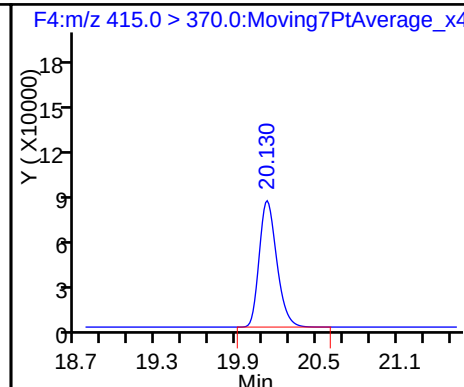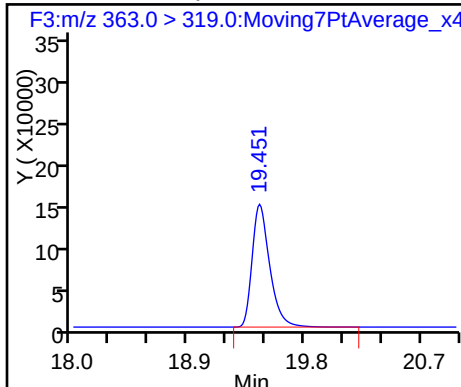


7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid

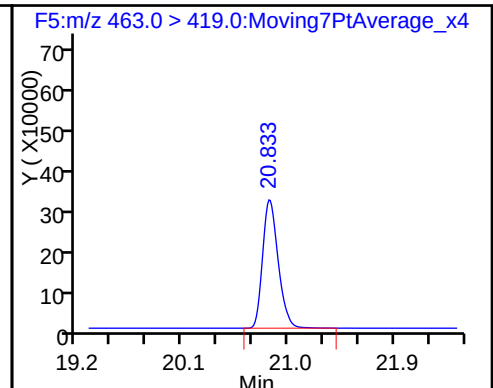

\$ 10 13C2 PFDA



FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: _____ Lab Sample ID: MB 320-147025/1-A
 Matrix: Water Lab File ID: 20JAN2016A6A_064.d
 Analysis Method: 537 Date Collected: _____
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 250 (mL) Date Analyzed: 01/21/2017 18:20
 Con. Extract Vol.: 1.0 (mL) Dilution Factor: 1
 Injection Volume: 10 (uL) GC Column: Acquity ID: 2.1 (mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147271 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	111		70-130
STL00996	13C2 PFDA	110		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_064.d
 Lims ID: MB 320-147025/1-A
 Client ID:
 Sample Type: MB
 Inject. Date: 21-Jan-2017 18:20:41 ALS Bottle#: 3 Worklist Smp#: 106
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: mb 320-147025/1-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:21:33 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 11:22:38

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

\$ 2 13C2 PFHxA

315.0 > 270.0 18.658 18.677 -0.019 1.000 923825 11.1 30386

* 5 13C2-PFOA

415.0 > 370.0 20.141 20.161 -0.020 758107 10.0 20895

* 8 13C4 PFOS

503.0 > 80.0 20.785 20.793 -0.008 1450316 28.7 22536

\$ 10 13C2 PFDA

515.0 > 470.0 21.587 21.597 -0.010 1.000 802823 11.0 27082

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_064.d

Injection Date: 21-Jan-2017 18:20:41

Instrument ID: A6

Lims ID: MB 320-147025/1-A

Client ID:

Operator ID: CBW

ALS Bottle#: 3

Worklist Smp#: 106

Injection Vol: 10.0 ul




Dil. Factor: 1.0000

Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid (ND) \$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid (ND)



4 Perfluoroheptanoic acid (ND)

* 5 13C2-PFOA




6 Perfluorooctanoic acid (ND)




7 Perfluorooctane sulfonic acid (ND)

* 8 13C4 PFOS

9 Perfluorononanoic acid (ND)



\$ 10 13C2 PFDA

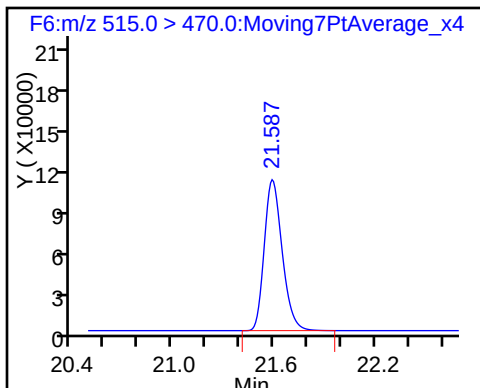

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_064.d
Lims ID: MB 320-147025/1-A
Client ID:
Sample Type: MB
Inject. Date: 21-Jan-2017 18:20:41 ALS Bottle#: 3 Worklist Smp#: 106
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: mb 320-147025/1-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:21:33 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 11:22:38

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	11.1	111.08
\$ 10 13C2 PFDA	10.0	11.0	109.95

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: _____ Lab Sample ID: LCS 320-147025/2-A
 Matrix: Water Lab File ID: 20JAN2016A6A_065.d
 Analysis Method: 537 Date Collected: _____
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 250 (mL) Date Analyzed: 01/21/2017 18:50
 Con. Extract Vol.: 1.0 (mL) Dilution Factor: 1
 Injection Volume: 10 (uL) GC Column: Acquity ID: 2.1 (mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147271 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.158		0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.0726		0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.304		0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	127		70-130
STL00996	13C2 PFDA	122		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_065.d
 Lims ID: LCS 320-147025/2-A
 Client ID:
 Sample Type: LCS
 Inject. Date: 21-Jan-2017 18:50:18 ALS Bottle#: 4 Worklist Smp#: 107
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: lcs 320-147025/2-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:21:33 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 11:23:06

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
--------	----	-----------	-----------	-----------	----------	-----------------	-----	-------

1 Perfluorobutanesulfonic acid
 299.0 > 80.0 17.676 17.708 -0.032 1.000 2651210 76.1 1647
 \$ 2 13C2 PFHxA
 315.0 > 270.0 18.649 18.677 -0.028 1.000 951901 12.7 31389
 3 Perfluorohexanesulfonic acid
 399.0 > 80.0 19.415 19.445 -0.030 1.000 1246710 29.7 29182
 4 Perfluoroheptanoic acid
 363.0 > 319.0 19.451 19.476 -0.025 1.000 814174 11.2 5012
 * 5 13C2-PFOA
 415.0 > 370.0 20.141 20.161 -0.020 682158 10.0 18674
 6 Perfluorooctanoic acid
 413.0 > 369.0 20.141 20.161 -0.020 1.000 1350911 18.2 1219
 7 Perfluorooctane sulfonic acid
 499.0 > 80.0 20.785 20.766 0.019 1.000 1919627 39.6 31296
 * 8 13C4 PFOS
 503.0 > 80.0 20.774 20.793 -0.019 1227030 28.7 26486
 9 Perfluorononanoic acid
 463.0 > 419.0 20.857 20.866 -0.009 1.000 1674186 21.1 20250
 \$ 10 13C2 PFDA
 515.0 > 470.0 21.587 21.597 -0.010 1.000 798810 12.2 26970

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_065.d

Injection Date: 21-Jan-2017 18:50:18

Instrument ID: A6

Lims ID: LCS 320-147025/2-A

Client ID:

Operator ID: CBW

ALS Bottle#: 4

Worklist Smp#: 107

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537__A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid



4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid




7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid



\$ 10 13C2 PFDA

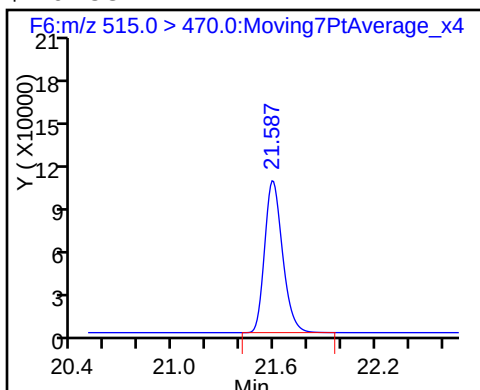

TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_065.d
Lims ID: LCS 320-147025/2-A
Client ID:
Sample Type: LCS
Inject. Date: 21-Jan-2017 18:50:18 ALS Bottle#: 4 Worklist Smp#: 107
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: lcs 320-147025/2-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:21:33 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

First Level Reviewer: barnettj

Date: 23-Jan-2017 11:23:06

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	12.7	127.20
\$ 10 13C2 PFDA	10.0	12.2	121.58

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: _____ Lab Sample ID: LCSD 320-147025/3-A
 Matrix: Water Lab File ID: 20JAN2016A6A_066.d
 Analysis Method: 537 Date Collected: _____
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 250 (mL) Date Analyzed: 01/21/2017 19:19
 Con. Extract Vol.: 1.0 (mL) Dilution Factor: 1
 Injection Volume: 10 (uL) GC Column: Acquity ID: 2.1 (mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147271 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.160		0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.0782		0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.290		0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	124		70-130
STL00996	13C2 PFDA	125		70-130

TestAmerica Sacramento
Target Compound Quantitation Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_066.d
 Lims ID: LCSD 320-147025/3-A
 Client ID:
 Sample Type: LCSD
 Inject. Date: 21-Jan-2017 19:19:51 ALS Bottle#: 5 Worklist Smp#: 108
 Injection Vol: 10.0 ul Dil. Factor: 1.0000
 Sample Info: lcsd 320-147025/3-a
 Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
 Operator ID: CBW Instrument ID: A6
 Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
 Limit Group: LC 537 ICAL
 Last Update: 23-Jan-2017 13:21:33 Calib Date: 20-Jan-2017 15:40:56
 Integrator: Picker
 Quant Method: Internal Standard Quant By: Initial Calibration
 Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
 Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
 Process Host: XAWRK013

Signal	RT	EXP RT	DLT RT	REL RT	Response	Amount ng/ml	S/N	Flags
1 Perfluorobutanesulfonic acid								
299.0 > 80.0	17.679	17.708	-0.029	1.000	2505772	72.5	118197	
\$ 2 13C2 PFHxA								
315.0 > 270.0	18.649	18.677	-0.028	1.000	912843	12.4	30089	
3 Perfluorohexanesulfonic acid								
399.0 > 80.0	19.415	19.445	-0.030	1.000	1251852	30.1	29382	
4 Perfluoroheptanoic acid								
363.0 > 319.0	19.451	19.476	-0.025	1.000	798944	11.1	16781	
* 5 13C2-PFOA								
415.0 > 370.0	20.141	20.161	-0.020		671066	10.0	18444	
6 Perfluorooctanoic acid								
413.0 > 369.0	20.141	20.161	-0.020	1.000	1430773	19.5	1612	
7 Perfluorooctane sulfonic acid								
499.0 > 80.0	20.774	20.766	0.008	1.000	1923414	40.0	25876	
* 8 13C4 PFOS								
503.0 > 80.0	20.774	20.793	-0.019		1216067	28.7	21837	
9 Perfluorononanoic acid								
463.0 > 419.0	20.845	20.866	-0.021	1.000	1690944	21.7	26331	
\$ 10 13C2 PFDA								
515.0 > 470.0	21.587	21.597	-0.010	1.000	808713	12.5	27319	

TestAmerica Sacramento

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_066.d

Injection Date: 21-Jan-2017 19:19:51

Instrument ID: A6

Lims ID: LCSD 320-147025/3-A

Client ID:

Operator ID: CBW

ALS Bottle#: 5

Worklist Smp#: 108

Injection Vol: 10.0 ul

Dil. Factor: 1.0000




Method: 537_A6

Limit Group: LC 537 ICAL

1 Perfluorobutanesulfonic acid

\$ 2 13C2 PFHxA




3 Perfluorohexanesulfonic acid

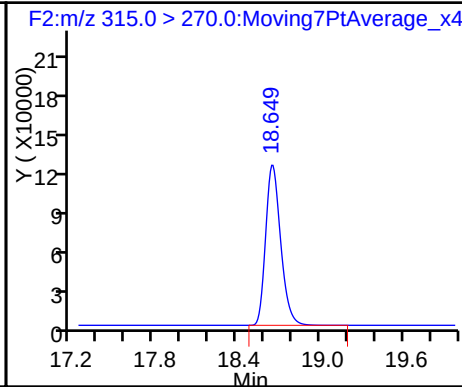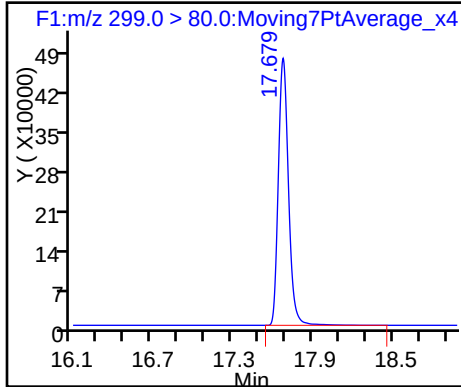

4 Perfluoroheptanoic acid

* 5 13C2-PFOA




6 Perfluorooctanoic acid

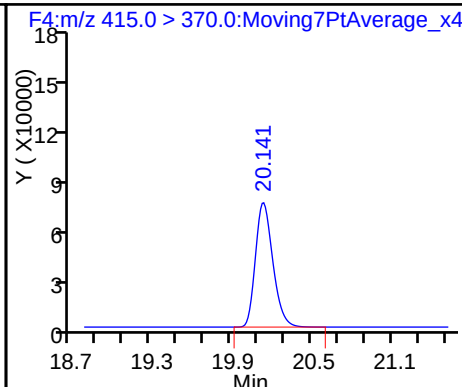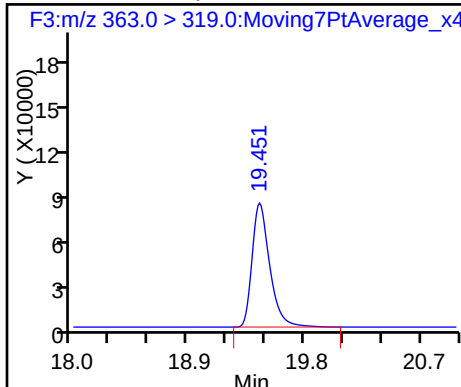


7 Perfluorooctane sulfonic acid

* 8 13C4 PFOS

9 Perfluorononanoic acid



\$ 10 13C2 PFDA



TestAmerica Sacramento
Recovery Report

Data File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_066.d
Lims ID: LCSD 320-147025/3-A
Client ID:
Sample Type: LCSD
Inject. Date: 21-Jan-2017 19:19:51 ALS Bottle#: 5 Worklist Smp#: 108
Injection Vol: 10.0 ul Dil. Factor: 1.0000
Sample Info: lcsd 320-147025/3-a
Misc. Info.: Acquity BEH 1.7um, 3X150mm T=35*C
Operator ID: CBW Instrument ID: A6
Method: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\537__A6.m
Limit Group: LC 537 ICAL
Last Update: 23-Jan-2017 13:21:33 Calib Date: 20-Jan-2017 15:40:56
Integrator: Picker
Quant Method: Internal Standard Quant By: Initial Calibration
Last ICal File: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b\20JAN2016A6A_010.d
Column 1 : Acquity BEH C18 (2.10 mm) Det: F1:MRM
Process Host: XAWRK013

Compound	Amount Added	Amount Recovered	% Rec.
\$ 2 13C2 PFHxA	10.0	12.4	124.00
\$ 10 13C2 PFDA	10.0	12.5	125.12

LCMS ANALYSIS RUN LOG

Lab Name: TestAmerica SacramentoJob No.: 320-25078-1

SDG No.: _____

Instrument ID: A6Start Date: 01/20/2017 13:11Analysis Batch Number: 147198End Date: 01/21/2017 01:32

LAB SAMPLE ID	CLIENT SAMPLE ID	DATE ANALYZED	DILUTION FACTOR	LAB FILE ID	COLUMN ID
STD 320-147198/3 IC		01/20/2017 13:11	1	20JAN2016A6A_00 5.d	Acquity 2.1 (mm)
STD 320-147198/4 IC		01/20/2017 13:41	1	20JAN2016A6A_00 6.d	Acquity 2.1 (mm)
STD 320-147198/5 IC		01/20/2017 14:11	1	20JAN2016A6A_00 7.d	Acquity 2.1 (mm)
STD 320-147198/6 ICISAV		01/20/2017 14:40	1	20JAN2016A6A_00 8.d	Acquity 2.1 (mm)
STD 320-147198/7 IC		01/20/2017 15:11	1	20JAN2016A6A_00 9.d	Acquity 2.1 (mm)
STD 320-147198/8 IC		01/20/2017 15:40	1	20JAN2016A6A_01 0.d	Acquity 2.1 (mm)
ZZZZZ		01/20/2017 16:10	1		Acquity 2.1 (mm)
CCV 320-147198/10 CCVL		01/20/2017 16:40	1	20JAN2016A6A_01 2.d	Acquity 2.1 (mm)
ZZZZZ		01/20/2017 17:09	1		Acquity 2.1 (mm)
ICV 320-147198/12		01/20/2017 17:39	1	20JAN2016A6A_01 4.d	Acquity 2.1 (mm)
ZZZZZ		01/20/2017 20:07	1		Acquity 2.1 (mm)
ZZZZZ		01/20/2017 20:37	1		Acquity 2.1 (mm)
ZZZZZ		01/20/2017 21:06	1		Acquity 2.1 (mm)
ZZZZZ		01/20/2017 21:36	1		Acquity 2.1 (mm)
ZZZZZ		01/20/2017 22:05	1		Acquity 2.1 (mm)
ZZZZZ		01/20/2017 22:35	1		Acquity 2.1 (mm)
ZZZZZ		01/20/2017 23:04	1		Acquity 2.1 (mm)
ZZZZZ		01/20/2017 23:34	1		Acquity 2.1 (mm)
ZZZZZ		01/21/2017 00:03	1		Acquity 2.1 (mm)
ZZZZZ		01/21/2017 00:33	1		Acquity 2.1 (mm)
ZZZZZ		01/21/2017 01:03	1		Acquity 2.1 (mm)
CCV 320-147198/28 CCVIS		01/21/2017 01:32	1		Acquity 2.1 (mm)

LCMS ANALYSIS RUN LOG

Lab Name: TestAmerica SacramentoJob No.: 320-25078-1

SDG No.: _____

Instrument ID: A6Start Date: 01/21/2017 17:21Analysis Batch Number: 147271End Date: 01/21/2017 23:16

LAB SAMPLE ID	CLIENT SAMPLE ID	DATE ANALYZED	DILUTION FACTOR	LAB FILE ID	COLUMN ID
CCV 320-147271/60 CCVIS		01/21/2017 17:21	1	20JAN2016A6A_06 2.d	Acquity 2.1 (mm)
ZZZZZ		01/21/2017 17:51	1		Acquity 2.1 (mm)
MB 320-147025/1-A		01/21/2017 18:20	1	20JAN2016A6A_06 4.d	Acquity 2.1 (mm)
LCS 320-147025/2-A		01/21/2017 18:50	1	20JAN2016A6A_06 5.d	Acquity 2.1 (mm)
LCSD 320-147025/3-A		01/21/2017 19:19	1	20JAN2016A6A_06 6.d	Acquity 2.1 (mm)
ZZZZZ		01/21/2017 19:49	1		Acquity 2.1 (mm)
ZZZZZ		01/21/2017 20:19	1		Acquity 2.1 (mm)
ZZZZZ		01/21/2017 20:48	1		Acquity 2.1 (mm)
ZZZZZ		01/21/2017 21:18	1		Acquity 2.1 (mm)
ZZZZZ		01/21/2017 21:47	1		Acquity 2.1 (mm)
ZZZZZ		01/21/2017 22:17	1		Acquity 2.1 (mm)
ZZZZZ		01/21/2017 22:47	1		Acquity 2.1 (mm)
CCV 320-147271/116 CCVIS		01/21/2017 23:16	1	20JAN2016A6A_07 4.d	Acquity 2.1 (mm)

LCMS ANALYSIS RUN LOG

Lab Name: TestAmerica SacramentoJob No.: 320-25078-1

SDG No.: _____

Instrument ID: A6Start Date: 01/21/2017 23:16Analysis Batch Number: 147339End Date: 01/22/2017 05:12

LAB SAMPLE ID	CLIENT SAMPLE ID	DATE ANALYZED	DILUTION FACTOR	LAB FILE ID	COLUMN ID
CCV 320-147339/116 CCVIS		01/21/2017 23:16	1	20JAN2016A6A_07 4.d	Acquity 2.1 (mm)
ZZZZZ		01/21/2017 23:46	1		Acquity 2.1 (mm)
ZZZZZ		01/22/2017 00:15	1		Acquity 2.1 (mm)
320-25078-1		01/22/2017 00:45	1	20JAN2016A6A_07 7.d	Acquity 2.1 (mm)
320-25078-2		01/22/2017 01:15	1	20JAN2016A6A_07 8.d	Acquity 2.1 (mm)
320-25078-3		01/22/2017 01:44	1	20JAN2016A6A_07 9.d	Acquity 2.1 (mm)
320-25078-4		01/22/2017 02:14	1	20JAN2016A6A_08 0.d	Acquity 2.1 (mm)
320-25078-5		01/22/2017 02:44	1	20JAN2016A6A_08 1.d	Acquity 2.1 (mm)
320-25078-6		01/22/2017 03:13	1	20JAN2016A6A_08 2.d	Acquity 2.1 (mm)
320-25078-7		01/22/2017 03:43	1	20JAN2016A6A_08 3.d	Acquity 2.1 (mm)
320-25078-8		01/22/2017 04:12	1	20JAN2016A6A_08 4.d	Acquity 2.1 (mm)
320-25078-9		01/22/2017 04:42	1	20JAN2016A6A_08 5.d	Acquity 2.1 (mm)
CCV 320-147339/129 CCVIS		01/22/2017 05:12	1	20JAN2016A6A_08 6.d	Acquity 2.1 (mm)

LCMS ANALYSIS RUN LOG

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1

SDG No.: _____

Instrument ID: A6 Start Date: 01/22/2017 05:12

Analysis Batch Number: 147340 End Date: 01/22/2017 07:40

LAB SAMPLE ID	CLIENT SAMPLE ID	DATE ANALYZED	DILUTION FACTOR	LAB FILE ID	COLUMN ID
CCV 320-147340/129 CCVIS		01/22/2017 05:12	1	20JAN2016A6A_08 6.d	Acquity 2.1 (mm)
ZZZZZ		01/22/2017 05:41	1		Acquity 2.1 (mm)
320-25078-10		01/22/2017 06:11	1	20JAN2016A6A_08 8.d	Acquity 2.1 (mm)
320-25078-11		01/22/2017 06:40	1	20JAN2016A6A_08 9.d	Acquity 2.1 (mm)
320-25078-12		01/22/2017 07:10	1	20JAN2016A6A_09 0.d	Acquity 2.1 (mm)
CCV 320-147340/133 CCVIS		01/22/2017 07:40	1	20JAN2016A6A_09 1.d	Acquity 2.1 (mm)

LCMS BATCH WORKSHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1

SDG No.: _____

Batch Number: 147025 Batch Start Date: 01/19/17 14:13 Batch Analyst: Kolstad, Kate MBatch Method: 537 Batch End Date: 01/20/17 13:00

Lab Sample ID	Client Sample ID	Method Chain	Basis	GrossWeight	TareWeight	InitialAmount	FinalAmount	ReceivedpH	LC537-IS 00030
MB 320-147025/1		537, 537				250 mL	1.0 mL	7 SU	20 uL
LCS 320-147025/2		537, 537				250 mL	1.0 mL	7 SU	20 uL
LCSD 320-147025/3		537, 537				250 mL	1.0 mL	7 SU	20 uL
320-25078-A-1	WI-CV-1RW53-0117	537, 537	T	271.83 g	26.42 g	245.4 mL	1.0 mL	7 SU	20 uL
320-25078-A-2	WI-CV-1FB53-0117	537, 537	T	275.16 g	26.10 g	249.1 mL	1.0 mL	7 SU	20 uL
320-25078-A-3	WI-CV-1RW54-0117	537, 537	T	274.96 g	26.39 g	248.6 mL	1.0 mL	7 SU	20 uL
320-25078-A-4	WI-CV-1FB54-0117	537, 537	T	277.46 g	26.59 g	250.9 mL	1.0 mL	7 SU	20 uL
320-25078-A-5	WI-CV-1RW55-0117	537, 537	T	277.23 g	27.06 g	250.2 mL	1.0 mL	7 SU	20 uL
320-25078-A-6	WI-CV-1FB55-0117	537, 537	T	274.03 g	26.35 g	247.7 mL	1.0 mL	7 SU	20 uL
320-25078-A-7	WI-CV-1RW56-0117	537, 537	T	270.63 g	26.54 g	244.1 mL	1.0 mL	7 SU	20 uL
320-25078-A-8	WI-CV-1FB56-0117	537, 537	T	276.13 g	26.20 g	249.9 mL	1.0 mL	7 SU	20 uL
320-25078-A-9	WI-CV-1RW57-0117	537, 537	T	276.26 g	26.97 g	249.3 mL	1.0 mL	7 SU	20 uL
320-25078-A-10	WI-CV-1FB57-0117	537, 537	T	277.00 g	26.13 g	250.9 mL	1.0 mL	7 SU	20 uL
320-25078-A-11	WI-CV-1RW58-0117	537, 537	T	270.44 g	26.92 g	243.5 mL	1.0 mL	7 SU	20 uL
320-25078-A-12	WI-CV-1FB58-0117	537, 537	T	272.23 g	26.09 g	246.1 mL	1.0 mL	7 SU	20 uL

Lab Sample ID	Client Sample ID	Method Chain	Basis	LC537-MSP 00017	LC537-SU 00028	AnalysisComment			
MB 320-147025/1		537, 537			50 uL	chlorine=ND			
LCS 320-147025/2		537, 537		50 uL	50 uL	chlorine=ND			
LCSD 320-147025/3		537, 537		50 uL	50 uL	chlorine=ND			
320-25078-A-1	WI-CV-1RW53-0117	537, 537	T		50 uL	chlorine=ND			
320-25078-A-2	WI-CV-1FB53-0117	537, 537	T		50 uL	chlorine=ND			
320-25078-A-3	WI-CV-1RW54-0117	537, 537	T		50 uL	chlorine=ND			
320-25078-A-4	WI-CV-1FB54-0117	537, 537	T		50 uL	chlorine=ND			
320-25078-A-5	WI-CV-1RW55-0117	537, 537	T		50 uL	chlorine=ND			
320-25078-A-6	WI-CV-1FB55-0117	537, 537	T		50 uL	chlorine=ND			
320-25078-A-7	WI-CV-1RW56-0117	537, 537	T		50 uL	chlorine=ND			
320-25078-A-8	WI-CV-1FB56-0117	537, 537	T		50 uL	chlorine=ND			

The pound sign (#) in the amount added field denotes that the reagent was used undiluted. All calculations are performed using the stated concentration for this reagent.

LCMS BATCH WORKSHEET

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1

SDG No.: _____

Batch Number: 147025 Batch Start Date: 01/19/17 14:13 Batch Analyst: Kolstad, Kate MBatch Method: 537 Batch End Date: 01/20/17 13:00

Lab Sample ID	Client Sample ID	Method Chain	Basis	LC537-MSP 00017	LC537-SU 00028	AnalysisComment			
320-25078-A-9	WI-CV-1RW57-0117	537, 537	T		50 uL	chlorine=ND			
320-25078-A-10	WI-CV-1FB57-0117	537, 537	T		50 uL	chlorine=ND			
320-25078-A-11	WI-CV-1RW58-0117	537, 537	T		50 uL	chlorine=ND			
320-25078-A-12	WI-CV-1FB58-0117	537, 537	T		50 uL	chlorine=ND			

Batch Notes	
Manifold ID	3, 10
Methanol ID	827185
Pipette ID	MD05306
Analyst ID - IS Reagent Drop	NSH
Analyst ID - IS Reagent Drop Witness	JER
Analyst ID - SU Reagent Drop	JER
Analyst ID - SU Reagent Drop Witness	KMK
Analyst ID - TA Reagent Drop	JER
Analyst ID - TA Reagent Drop Witness	KMK
SPE Cartridge ID	6341059-03
Trizma ID	SLBR4303V
Reagent Water ID	SIZ 1-13-17

Basis	Basis Description
T	Total/NA

The pound sign (#) in the amount added field denotes that the reagent was used undiluted. All calculations are performed using the stated concentration for this reagent.

Method 537 CCV/Data Review Checklist

A6

Job No: 25077, 25078 Instrument ID & Date: 1-21-17 ICAL Batch: 147198
 Extraction Batch: 147025 Worklist #: 39022 TALS Batch: 147271, 147339, 147340

Review Items	Level 1			Level 2
	Yes	No	N/A	
Initial Calibration				
1. Is ICAL verified and locked in Chrom & TALS?	✓			✓
2. Is ICV properly linked in TALS?	✓			✓
Continuing Calibration				
1. Low-range CCV injected at start of analytical run? CCV injected after every 10 samples and at the end of the analytical run and alternated between Low-range, Mid-range and High-range?	✓			✓
2. If sequence was not after an ICAL was a low and mid range CCV injected at the start of the analytical run?			✓	
3. Native compounds and surrogates in control? Low-range within $\pm 50\%$ of true value Mid and High-range within $\pm 30\%$ of true value	✓			✓
4. Internal Standard areas in control? Areas $\geq 50\%$ of average area of the ICAL and 70-140% of the most recent CCV.	✓			✓
Client Samples & QC Sample Results				
1. Were preparation and analysis done within holding times?	✓			✓
2. Are Chromatograms reviewed and spectra verified?	✓			✓
3. Are positive results within calibration range?	✓			✓
4. Dilutions due to target cpds? Dilutions due to non-targets?			✓	
5. All target compounds in MB $< 1/3$ RL? (Requires NCM if "no.")	✓			✓
6. Are target constituents in LCS/LCSD within method control limits?	✓			✓
7. Internal Standard areas in control for all samples and QC reported? $\pm 50\%$ from the average area of the ICAL and 70-140% of the most recent CCV	✓			✓
8. Do results (e.g., dilutions/trip blanks) make sense?	✓			✓
9. Are MS/MSD recoveries and RPDs within method control limits?			✓	
10. Are all QC samples properly linked in TALS?	✓			✓
11. All manual integrations appropriate and completely documented?	✓			✓
12. Are nonconformances documented as NCMs?	✓			✓
13. Are all Chrom graphics uploaded?	✓			✓

1st Level Reviewer / Date: JRB 1-23-17

2nd Level Reviewer / Date: Murray 1/23/2017

NCM # and Comments: _____

A6

Instrument ID & Date: 1-20-17 Worklist#: 39022

ICAL Batch: 147198, 147199 Calibration ID number: 27741, 27742

Review Items	-- Level 1 --			Level 2
	Yes	No	N/A	
Initial Calibration				
1. Mass calibration, as needed, verified by full scan of PFC stock standard. All PFC ions used for quantitation are within 0.3 m/z of true mass?	✓			✓
2. Responses increase with increasing concentration?	✓			✓
3. Fit used (circle): <u>Average</u> Linear (1/x ²) Linear Quadratic (6 points minimum)				
4. Meets fit criteria? Intercept ≤ ½ RL RSD ≤ 30% for Average R ² ≥ 0.990 for Linear R ² ≥ 0.990 for Quadratic NOTE: "Force through Zero" must be used and weighted if needed	✓			✓
5. If quadratic fit used the curve does not "bend over".			✓	
6. Feed calibration points into the calculated curve. Are points ≤MRL within ±50% of true value? Are points >MRL within ±30% of true value?	✓			✓
7. Any carryover from the high calibration point must be ≤ 1/3 RL	✓			✓
8. Asymmetry check meets criteria for the first two eluting peaks? (0.8 - 1.5).	✓			✓
9. Is the asymmetry check scanned and linked in TALS to the calibration point?	✓			✓
10. Is ICV (2 nd source) ± 30% of true value?	✓			✓
11. Is ICV (2 nd source) internal standards ±50% of average area of the ICAL?	✓			✓
12. ICAL locked in Chrom and uploaded to TALS?	✓			✓
13. ICAL locked in TALS and scanned?				✓

1st Level Reviewer / Date: JRB 1-23-17

2nd Level Reviewer / Date: Murray 1/23/2017

NCM # and Comments:

TestAmerica Laboratories
Worklist QC Batch Report

Worklist Name: 20JAN2017A_A6 537

Worklist Number: 39022

Instrument Name: A6

Chrom Method: 537_A6

Data Directory: \\ChromNA\Sacramento\ChromData\A6\20170120-39022.b

QC Batching: Enabled

Limit Group Batching: Enabled

QC Batch: 1	LC 537 ICAL Raw Batch: 147198	LC 537 CS ICAL Raw Batch: 147199
# 1 RB	# 1 RB	
# 2 RB	# 2 RB	
# 3 STD L1	# 3 STD L1	# 3 STD L1
# 4 STD L2	# 4 STD L2	# 4 STD L2
# 5 STD L3	# 5 STD L3	# 5 STD L3
# 6 STD L4	# 6 STD L4	# 6 STD L4
# 7 STD L5	# 7 STD L5	# 7 STD L5
# 8 STD L6	# 8 STD L6	# 8 STD L6
# 9 RB	# 9 RB	# 9 RB
#10 CCV L2	#10 CCV L2	#10 CCV L2
#11 RB	#11 RB	#11 RB
#12 ICV	#12 ICV	#12 ICV
#13 TPFOA	#13 TPFOA	
#14 QC LEVEL 3	#14 QC LEVEL 3	
#15 QC LEVEL 5	#15 QC LEVEL 5	
#16 RB	#16 RB	
#17 RB	#17 RB	
#18 MB 320-146821/1-A	#18 MB 320-146821/1-A	
#19 LCS 320-146821/2-A	#19 LCS 320-146821/2-A	
#20 LCSD 320-146821/3-A	#20 LCSD 320-146821/3-A	
#21 320-25044-A-1-A	#21 320-25044-A-1-A	
#22 320-25044-A-2-A	#22 320-25044-A-2-A	
#23 320-25044-A-3-A	#23 320-25044-A-3-A	
#24 320-25044-A-4-A	#24 320-25044-A-4-A	
#25 320-25044-A-5-A	#25 320-25044-A-5-A	
#26 320-25044-A-6-A	#26 320-25044-A-6-A	
#27 320-25044-A-7-A	#27 320-25044-A-7-A	
#28 CCV L5	#28 CCV L5	

QC Batch: 2	LC 537 ICAL Raw Batch: 147256
#28 CCV L5	#28 CCV L5
#29 RB	#29 RB
#30 320-25044-A-8-A	#30 320-25044-A-8-A
#31 320-25044-A-9-A	#31 320-25044-A-9-A
#32 320-25044-A-10-A	#32 320-25044-A-10-A
#33 320-25044-A-11-A	#33 320-25044-A-11-A
#34 320-25044-A-12-A	#34 320-25044-A-12-A
#35 320-25044-A-13-A	#35 320-25044-A-13-A
#36 320-25044-A-14-A	#36 320-25044-A-14-A
#37 320-25044-A-15-A	#37 320-25044-A-15-A
#38 CCV L3	#38 CCV L3

QC Batch: 3	LC 537 ICAL Raw Batch: 147257
#38 CCV L3	#38 CCV L3
#39 RB	#39 RB
#40 MB 320-146891/1-A	#40 MB 320-146891/1-A
#41 LLCS 320-146891/2-A	#41 LLCS 320-146891/2-A
#42 LLCSD 320-146891/3-A	#42 LLCSD 320-146891/3-A
#43 320-25051-A-1-A	#43 320-25051-A-1-A
#44 320-25051-A-2-A	#44 320-25051-A-2-A

QC Batch: 3	LC 537 ICAL Raw Batch: 147257
#45 320-25051-A-3-A	#45 320-25051-A-3-A
#46 320-25051-A-4-A	#46 320-25051-A-4-A
#47 320-25051-A-5-A	#47 320-25051-A-5-A
#48 320-25051-A-6-A	#48 320-25051-A-6-A
#49 320-25051-A-7-A	#49 320-25051-A-7-A
#50 CCV L5	#50 CCV L5

QC Batch: 4	LC 537 ICAL Raw Batch: 147258
#50 CCV L5	#50 CCV L5
#51 RB	#51 RB
#52 320-25051-A-8-A	#52 320-25051-A-8-A
#53 320-25051-A-9-A	#53 320-25051-A-9-A
#54 320-25051-A-10-A	#54 320-25051-A-10-A
#55 320-25051-A-11-A	#55 320-25051-A-11-A
#56 320-25051-A-12-A	#56 320-25051-A-12-A
#57 320-25051-A-13-A	#57 320-25051-A-13-A
#58 320-25051-A-14-A	#58 320-25051-A-14-A
#59 320-25051-A-15-A	#59 320-25051-A-15-A
#60 CCV L3	#60 CCV L3

QC Batch: 5	LC 537 ICAL Raw Batch: 147271
#60 CCV L3	#60 CCV L3
#61 RB	#61 RB
#106 MB 320-147025/1-A	#106 MB 320-147025/1-A
#107 LCS 320-147025/2-A	#107 LCS 320-147025/2-A
#108 LCSD 320-147025/3-A	#108 LCSD 320-147025/3-A
#109 320-25077-A-1-A	#109 320-25077-A-1-A
#110 320-25077-A-2-A	#110 320-25077-A-2-A
#111 320-25077-A-3-A	#111 320-25077-A-3-A
#112 320-25077-A-4-A	#112 320-25077-A-4-A
#113 320-25077-A-5-A	#113 320-25077-A-5-A
#114 320-25077-A-6-A	#114 320-25077-A-6-A
#115 320-25077-A-7-A	#115 320-25077-A-7-A
#116 CCV L5	#116 CCV L5

QC Batch: 6	LC 537 ICAL Raw Batch: 147339
#116 CCV L5	#116 CCV L5
#117 RB	#117 RB
#118 320-25077-A-8-A	#118 320-25077-A-8-A
#119 320-25078-A-1-A	#119 320-25078-A-1-A
#120 320-25078-A-2-A	#120 320-25078-A-2-A
#121 320-25078-A-3-A	#121 320-25078-A-3-A
#122 320-25078-A-4-A	#122 320-25078-A-4-A
#123 320-25078-A-5-A	#123 320-25078-A-5-A
#124 320-25078-A-6-A	#124 320-25078-A-6-A
#125 320-25078-A-7-A	#125 320-25078-A-7-A
#126 320-25078-A-8-A	#126 320-25078-A-8-A
#127 320-25078-A-9-A	#127 320-25078-A-9-A
#129 CCV L3	#129 CCV L3

QC Batch: 7	LC 537 ICAL Raw Batch: 147340
#129 CCV L3	#129 CCV L3
#128 RB	#128 RB

QC Batch: 7	LC 537 ICAL Raw Batch: 147340
#130 320-25078-A-10-A	#130 320-25078-A-10-A
#131 320-25078-A-11-A	#131 320-25078-A-11-A
#132 320-25078-A-12-A	#132 320-25078-A-12-A
#133 CCV L5	#133 CCV L5

QC Batch: 8	LC 537 ICAL Raw Batch: 147341
#133 CCV L5	#133 CCV L5
#134 RB	#134 RB
#135 MB 320-147025/1-A	#135 MB 320-147025/1-A
#136 LCS 320-147025/2-A	#136 LCS 320-147025/2-A
#137 LCSD 320-147025/3-A	#137 LCSD 320-147025/3-A
#138 320-25077-A-1-A	#138 320-25077-A-1-A
#139 320-25077-A-2-A	#139 320-25077-A-2-A
#140 320-25077-A-3-A	#140 320-25077-A-3-A
#141 320-25077-A-4-A	#141 320-25077-A-4-A
#142 QC 537 MB CART	#142 QC 537 MB CART
#143 QC 537 LCS CART	#143 QC 537 LCS CART
#146 CCV L3	#146 CCV L3
#145 RB	#145 RB

Aqueous Extraction Analysis Sheet

(To Accompany Samples to Instruments)

Analyst: Kolstad, Kate M

Batch Number: 320-147025

Method Code: 320-537_Prep-320

Batch Open: 1/19/2017 2:13:00PM

Batch End: 1/20/2017 1:00:00PM

Extraction of Perfluorinated Alkyl Acids

Input Sample Lab ID (Analytical Method)	SDG (Job #)	GrossWt TareWt	InitAmt FinAmt	PHS		Due Date	Analytical TAT	Div Rank	Comments	Output Sample Lab ID
				Rcvd	Adj1 Adj2					
1 MB-320-147025/1 N/A	N/A		250 mL 1.0 mL	7		N/A	N/A	N/A	chlorine=ND	MB 320-147025/1-A
2 LCS-320-147025/2 N/A	N/A		250 mL 1.0 mL	7		N/A	N/A	N/A	chlorine=ND	LCS 320-147025/2-A
3 LCSD-320-147025/3 N/A	N/A		250 mL 1.0 mL	7		N/A	N/A	N/A	chlorine=ND	LCS 320-147025/3-A
4 320-25077-A-1 (537_DOD5)	N/A (320-25077-1)	271.89 g 26.94 g	245 mL 1.0 mL	7		1/22/17	5_Days	4	chlorine=ND	320-25077-A-1-A
5 320-25077-A-2 (537_DOD5)	N/A (320-25077-1)	279.43 g 26.55 g	252.9 mL 1.0 mL	7		1/22/17	5_Days	4	chlorine=ND	320-25077-A-2-A
6 320-25077-A-3 (537_DOD5)	N/A (320-25077-1)	275.42 g 26.99 g	248.4 mL 1.0 mL	7		1/22/17	5_Days	4	chlorine=ND	320-25077-A-3-A
7 320-25077-A-4 (537_DOD5)	N/A (320-25077-1)	278.56 g 26.73 g	251.8 mL 1.0 mL	7		1/22/17	5_Days	4	chlorine=ND	320-25077-A-4-A
8 320-25077-A-5 (537_DOD5)	N/A (320-25077-1)	278.42 g 26.81 g	251.6 mL 1.0 mL	7		1/22/17	5_Days	4	chlorine=ND	320-25077-A-5-A
9 320-25077-A-6 (537_DOD5)	N/A (320-25077-1)	281.34 g 25.92 g	255.4 mL 1.0 mL	7		1/22/17	5_Days	4	chlorine=ND	320-25077-A-6-A
10 320-25077-A-7 (537_DOD5)	N/A (320-25077-1)	273.61 g 26.59 g	247 mL 1.0 mL	7		1/22/17	5_Days	4	chlorine=ND	320-25077-A-7-A

Aqueous Extraction Analysis Sheet

(To Accompany Samples to Instruments)

Batch Number: 320-147025

Method Code: 320-537_Prep-320

Analyst: Kolstad, Kate M

Batch Open: 1/19/2017 2:13:00PM

Batch End: 1/20/2017 1:00:00PM

11	320-25077-A-8 (537_DOD5)	N/A (320-25077-1)	279.81 g 26.71 g	253.1 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
12	320-25078-A-1 (537_DOD5)	N/A (320-25078-1)	271.83 g 26.42 g	245.4 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
13	320-25078-A-2 (537_DOD5)	N/A (320-25078-1)	275.16 g 26.10 g	249.1 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
14	320-25078-A-3 (537_DOD5)	N/A (320-25078-1)	274.96 g 26.39 g	248.6 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
15	320-25078-A-4 (537_DOD5)	N/A (320-25078-1)	277.46 g 26.59 g	250.9 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
16	320-25078-A-5 (537_DOD5)	N/A (320-25078-1)	277.23 g 27.06 g	250.2 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
17	320-25078-A-6 (537_DOD5)	N/A (320-25078-1)	274.03 g 26.35 g	247.7 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
18	320-25078-A-7 (537_DOD5)	N/A (320-25078-1)	270.63 g 26.54 g	244.1 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
19	320-25078-A-8 (537_DOD5)	N/A (320-25078-1)	276.13 g 26.20 g	249.9 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
20	320-25078-A-9 (537_DOD5)	N/A (320-25078-1)	276.26 g 26.97 g	249.3 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
21	320-25078-A-10 (537_DOD5)	N/A (320-25078-1)	277.00 g 26.13 g	250.9 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	
22	320-25078-A-11 (537_DOD5)	N/A (320-25078-1)	270.44 g 26.92 g	243.5 mL 1.0 mL	7				1/22/17	5_Days	4	chlorine=ND	

Aqueous Extraction Analysis Sheet

(To Accompany Samples to Instruments)

Batch Number: 320-147025

Method Code: 320-537_Prep-320

Analyst: Kolstad, Kate M

Batch Open: 1/19/2017 2:13:00PM

Batch End: 1/20/2017 1:00:00PM

320-25078-A-12 (537_DOD5)	N/A (320-25078-1)	272.23 g	246.1 mL	7	1/22/17	5_Days	4	chlorine=ND	
N/A	N/A	26.09 g	1.0 mL						
N/A	N/A								

Batch Notes

Manifold ID 3, 10

Trizma ID SLBR4303V

SPE Cartridge ID 6341059-03

Methanol ID 827185

Reagent Water ID SIZ 1-13-17

Pipette ID MD05306

Analyst ID - TA Reagent Drop JER

Analyst ID - TA Reagent Drop KMK

Analyst ID - SU Reagent Drop JER

Analyst ID - SU Reagent Drop KMK

Analyst ID - IS Reagent Drop NSH

Analyst ID - IS Reagent Drop JER

Batch Comment

Comments

Aqueous Extraction Analysis Sheet

(To Accompany Samples to Instruments)

Batch Number: 320-147025

Analyst: Kolstad, Kate M

Batch Open: 1/19/2017 2:13:00PM

Method Code: 320-537_Prep-320

Batch End:

320-25078-A-12 (537_DOD5)	N/A (320-25078-1)	272.23 g	246.1 mL	7		1/22/17	5_Days	4	chlorine=ND	
		26.09 g	0.5 mL							
N/A	N/A					N/A	N/A	N/A		

23

24

Batch Notes

Manifold ID 3, 10

Trizma ID SLBR4303V

SPE Cartridge ID 6341059-03

Methanol ID 827185

Reagent Water ID SIZ 1-13-17

Pipette ID MD05306

Analyst ID - TA Reagent Drop JER

Analyst ID - TA Reagent Drop KMK

Witness

Analyst ID - SU Reagent Drop JER

Analyst ID - SU Reagent Drop KMK

Witness

Analyst ID - IS Reagent Drop

Analyst ID - IS Reagent Drop

Witness

Batch Comment

1/20/17
NSH 20 µL 827698 ext 7/17/17
JER 1/20/17

01/24/2017

Comments

Printed : 1/19/2017

Page 3 of 5

TestAmerica Sacramento

Aqueous Extraction Analysis Sheet

(To Accompany Samples to Instruments)

Batch Number: 320-147025

Method Code: 320-537_Prep-320

Analyst: Kolstad, Kate M

Batch Open: 1/19/2017 2:13:00PM

Batch End:

Reagent Additions Worksheet

Lab ID	Reagent Code	Amount Added	Final Amount	By	Witness
MB 320-147025/1	LC537-SU_00028	50 uL	0.5 mL		KMK 1-19-17
LCS 320-147025/2	LC537-MSP_00017	50 uL	0.5 mL		1-19-17
LCS 320-147025/2	LC537-SU_00028	50 uL	0.5 mL		
LCSD 320-147025/3	LC537-MSP_00017	50 uL	0.5 mL		
LCSD 320-147025/3	LC537-SU_00028	50 uL	0.5 mL		
320-25077-A-1	LC537-SU_00028	50 uL	0.5 mL		
320-25077-A-2	LC537-SU_00028	50 uL	0.5 mL		
320-25077-A-3	LC537-SU_00028	50 uL	0.5 mL		
320-25077-A-4	LC537-SU_00028	50 uL	0.5 mL		
320-25077-A-5	LC537-SU_00028	50 uL	0.5 mL		
320-25077-A-6	LC537-SU_00028	50 uL	0.5 mL		
320-25077-A-7	LC537-SU_00028	50 uL	0.5 mL		
320-25077-A-8	LC537-SU_00028	50 uL	0.5 mL		
320-25078-A-1	LC537-SU_00028	50 uL	0.5 mL		
320-25078-A-2	LC537-SU_00028	50 uL	0.5 mL		
320-25078-A-3	LC537-SU_00028	50 uL	0.5 mL		
320-25078-A-4	LC537-SU_00028	50 uL	0.5 mL		
320-25078-A-5	LC537-SU_00028	50 uL	0.5 mL		

Aqueous Extraction Analysis Sheet

(To Accompany Samples to Instruments)

Batch Number: 320-147025

Analyst: Kolstad, Kate M

Method Code: 320-537_Prep-320

Batch Open: 1/19/2017 2:13:00PM

Batch End:

320-25078-A-6	LC537-SU_00028	50 uL	0.5 mL	<i>[Signature]</i>	KMK 1-19-17
320-25078-A-7	LC537-SU_00028	50 uL	0.5 mL		
320-25078-A-8	LC537-SU_00028	50 uL	0.5 mL		
320-25078-A-9	LC537-SU_00028	50 uL	0.5 mL		
320-25078-A-10	LC537-SU_00028	50 uL	0.5 mL		
320-25078-A-11	LC537-SU_00028	50 uL	0.5 mL		
320-25078-A-12	LC537-SU_00028	50 uL	0.5 mL		

1.0 mL

Other Reagents:

Reagent

Amount/Units

Lot#:

Preparation Batch Number(s): 147025

Test: 537-Prep

Earliest Holding Time: 1-30-17

Sample List Tab	1 st Level Reviewer	2 nd Level Reviewer
Samples identified to the correct method	✓	✓
All necessary NCMs filed (including holding time)	✓	✓
Method/sample/login/QAS checked and correct	✓	✓
Worksheet Tab	1 st Level Reviewer	2 nd Level Reviewer
All samples properly preserved	✓	✓
Weights in anticipated range and not targeted	✓	✓
All additional test requirements performed, documented, and uploaded to TALS correctly (e.g. final amount, initial amount, turbidity, and CI Check)	✓	✓
The pH is transcribed correctly in TALS	✓	✓
All additional information transcribed into TALS is correct and raw data is attached	✓	✓
Comments are transcribed correctly in TALS	✓	✓
Reagents Tab	1 st Level Reviewer	2 nd Level Reviewer
All necessary reagents not expired and entered into TALS	✓	✓
All spike amounts correct and added to necessary samples and QC	✓	✓
Batch Information	1 st Level Reviewer	2 nd Level Reviewer
Date and time accurate and entered into TALS correctly	✓	✓
All necessary 'batch information' complete and entered into TALS correctly	✓	✓

1st Level Reviewer: 

Date: 1/20/17

2nd Level Reviewer: VPM

Date: 1/20/17

Comments: _____

Shipping and Receiving Documents

Chain of Custody Record

1 labeled @ 1301
2 ↓ 1300
no 1-18-17

Login Sample Receipt Checklist

Client: CH2M Hill Constructors, Inc.

Job Number: 320-25078-1

Login Number: 25078

List Number: 1

Creator: Nelson, Kym D

List Source: TestAmerica Sacramento

Question	Answer	Comment
Radioactivity wasn't checked or is $\leq$ background as measured by a survey meter.	True	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	N/A	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	N/A	
There are no discrepancies between the containers received and the COC.	False	Times on containers do not match the COC. Logged in per COC.
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

**DATA VALIDATION SUMMARY REPORT
WHIDBEY ISLAND, WASHINGTON**

Client: CH2M HILL, Inc., Corvallis, Oregon
SDG: 320-25078-1
Laboratory: Test America, Sacramento, California
Site: Whidbey Island, CTO-0008, Washington
Date: February 1, 2017

PFCs			
EDS ID	Client Sample ID	Laboratory Sample ID	Matrix
1	WI-CV-1RW53-0117	320-25078-1	Water
2	WI-CV-1FB53-0117	320-25078-2	Water
3	WI-CV-1RW54-0117	320-25078-3	Water
4	WI-CV-1FB54-0117	320-25078-4	Water
5	WI-CV-1RW55-0117	320-25078-5	Water
6	WI-CV-1FB55-0117	320-25078-6	Water
7	WI-CV-1RW56-0117	320-25078-7	Water
8	WI-CV-1FB56-0117	320-25078-8	Water
9	WI-CV-1RW57-0117	320-25078-9	Water
10	WI-CV-1FB57-0117	320-25078-10	Water
11	WI-CV-1RW58-0117	320-25078-11	Water
12	WI-CV-1FB58-0117	320-25078-12	Water

A full data validation was performed on the analytical data for six water samples and six aqueous field blank samples collected on January 16, 2017 by CH2M HILL at the Whidbey Island site in Washington. The samples were analyzed under the EPA Method "Determination of Selected Perfluorinated Alkyl Acids in Drinking Water by Solid Phase Extraction and Liquid Chromatography/Tandem Mass Spectrometry (LC/MS/MS)".

Specific method references are as follows:

Analysis
PFCs

Method References
USEPA Method 537 Rev 1.1 Modified

The data have been validated according to the protocols and quality control (QC) requirements of the analytical method, and the U.S. Department of Defense (DoD) Quality Systems Manual (QSM), Version 5.0 (DoD 2013) and the USEPA National Functional Guidelines for Organic Data Review as follows:

- The USEPA "Contract Laboratories Program National Functional Guidelines for Superfund Organic Methods Data Review," August 2014;
- and the reviewer's professional judgment.

The following data quality indicators were reviewed for this report:

Organics

- Date Completeness, Case Narrative & Custody Documentation
- Holding times
- Gas Chromatography/Mass Spectrometry (GC/MS) Tuning
- Initial and continuing calibration summaries
- Method blank and field QC blank contamination
- Surrogate Spike recoveries
- Matrix Spike/Matrix Spike Duplicate (MS/MSD) recoveries
- Laboratory Control Sample/Laboratory Control Sample Duplicate (LCS/LCSD) recoveries
- Internal standard area and retention time summary forms
- Target Compound Identification
- Compound Quantitation
- Field Duplicate sample precision

A full (Level IV) data validation was performed with this review including a recalculation of 10% of the detected results in the samples.

Data Usability Assessment

There were no rejections of data.

Overall the data is acceptable for the intended purposes. There were no qualifications.

Perfluorinated Compounds (PFCs)

Data Completeness, Case Narrative & Custody Documentation

- The case narrative and chain-of-custody documentation were included in the data package as required. The chain-of-custody did not match the laboratory IDs. The client provided the correct sample IDs which matched the laboratory Form I IDs.

Holding Times

- All samples were extracted within 14 days for water samples and analyzed within 28 days.

GC/MS Tuning

- All criteria were met.

Initial Calibration

- All relative standard deviation (%RSD) and/or correlation coefficients criteria were met.

Continuing Calibration

- All percent difference (%D) and RRF criteria were met.

Method Blank

- The method blanks were free of contamination.

Field QC Blank

- The field blank samples were free of contamination.

Surrogate Spike Recoveries

- All samples exhibited acceptable surrogate %R values.

Matrix Spike/Matrix Spike Duplicate (MS/MSD) Recoveries

- A MS/MSD sample was not collected.

Laboratory Control Samples/Laboratory Control Sample Duplicates

- The LCS/LCSD samples exhibited acceptable percent recoveries (%R) and RPD values.

Internal Standard (IS) Area Performance

- All internal standards met response and retention time (RT) criteria.

Target Compound Identification

- All mass spectra and quantitation criteria were met.

Compound Quantitation


- All criteria were met.

Field Duplicate Sample Precision

- Field duplicate samples were not collected.

Please contact the undersigned at (757) 564-0090 if you have any questions or need further information.

Signed:



Nancy Weaver
Senior Chemist

Dated: 2/2/17

Data Qualifier	Definition
U	The analyte was analyzed for, but was not detected above the level of the reported sample quantitation limit.
J	The analyte is an estimated quantity. The associated numerical value is the approximate concentration of the analyte in the sample.
NJ	The analysis has been "tentatively identified" or "presumptively" as present and the associated numerical value is the estimated concentration in the samples.
UJ	The analyte was analyzed for but was not detected. The reported quantitation limit is approximate and may be inaccurate or imprecise.
R	The data are unusable. The sample results are rejected due to serious deficiencies in meeting QC criteria. The analyte may or may not be present in the samples.

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Client Sample ID: WI-CV-1RW53-0117

Lab Sample ID: 320-25078-1

Matrix: Water

Lab File ID: 20JAN2016A6A_077.d

Analysis Method: 537

Date Collected: 01/16/2017 09:17

Extraction Method: 537

Date Extracted: 01/19/2017 14:14

Sample wt/vol: 245.4 (mL)

Date Analyzed: 01/22/2017 00:45

Con. Extract. Vol.: 1.0 (mL)

Dilution Factor: 1

Injection Volume: 10 (uL)

GC Column: Acquity ID: 2.1 (mm)

% Moisture: _____

GPC Cleanup: (Y/N) N

Analysis Batch No.: 147339

Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.049	U M	0.061	0.049	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U M	0.031	0.024	0.0096
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	112		70-130
STL00996	13C2 PFDA	108		70-130

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

2

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.:

Client Sample ID: WI-CV-1FB53-0117

Lab Sample ID: 320-25078-2

Matrix: Water

Lab File ID: 20JAN2016A6A_078.d

Analysis Method: 537

Date Collected: 01/16/2017 09:16

Extraction Method: 537

Date Extracted: 01/19/2017 14:14

Sample wt/vol: 249.1(mL)

Date Analyzed: 01/22/2017 01:15

Con. Extract Vol.: 1.0(mL)

Dilution Factor: 1

Injection Volume: 10(uL)

GC Column: Acquity ID: 2.1(mm)

% Moisture:

GPC Cleanup: (Y/N) N

Analysis Batch No.: 147339

Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0095
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	115		70-130
STL00996	13C2 PFDA	108		70-130

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

3

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1RW54-0117 Lab Sample ID: 320-25078-3
 Matrix: Water Lab File ID: 20JAN2016A6A_079.d
 Analysis Method: 537 Date Collected: 01/16/2017 10:36
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 248.6(mL) Date Analyzed: 01/22/2017 01:44
 Con. Extract Vol.: 1.0(mL) Dilution Factor: 1
 Injection Volume: 10(uL) GC Column: Acquity ID: 2.1(mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0095
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	115		70-130
STL00996	13C2 PFDA	112		70-130

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

4

Lab Name: <u>TestAmerica Sacramento</u>	Job No.: <u>320-25078-1</u>
SDG No.: _____	
Client Sample ID: <u>WI-CV-1FB54-0117</u>	Lab Sample ID: <u>320-25078-4</u>
Matrix: <u>Water</u>	Lab File ID: <u>20JAN2016A6A_080.d</u>
Analysis Method: <u>537</u>	Date Collected: <u>01/16/2017 10:35</u>
Extraction Method: <u>537</u>	Date Extracted: <u>01/19/2017 14:14</u>
Sample wt/vol: <u>250.9(mL)</u>	Date Analyzed: <u>01/22/2017 02:14</u>
Con. Extract Vol.: <u>1.0(mL)</u>	Dilution Factor: <u>1</u>
Injection Volume: <u>10(uL)</u>	GC Column: <u>Acquity</u> ID: <u>2.1(mm)</u>
% Moisture: _____	GPC Cleanup: (Y/N) <u>N</u>
Analysis Batch No.: <u>147339</u>	Units: <u>ug/L</u>

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.015
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.047

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	122		70-130
STL00996	13C2 PFDA	115		70-130

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

5

Lab Name: TestAmerica Sacramento	Job No.: 320-25078-1
SDG No.:	
Client Sample ID: WI-CV-1RW55-0117	Lab Sample ID: 320-25078-5
Matrix: Water	Lab File ID: 20JAN2016A6A_081.d
Analysis Method: 537	Date Collected: 01/16/2017 10:51
Extraction Method: 537	Date Extracted: 01/19/2017 14:14
Sample wt/vol: 250.2(mL)	Date Analyzed: 01/22/2017 02:44
Con. Extract Vol.: 1.0(mL)	Dilution Factor: 1
Injection Volume: 10(uL)	GC Column: Acquity ID: 2.1(mm)
% Moisture:	GPC Cleanup: (Y/N) N
Analysis Batch No.: 147339	Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.015
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U M	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	124		70-130
STL00996	13C2 PFDA	122		70-130

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

6

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.:

Client Sample ID: WI-CV-1FB55-0117

Lab Sample ID: 320-25078-6

Matrix: Water

Lab File ID: 20JAN2016A6A_082.d

Analysis Method: 537

Date Collected: 01/16/2017 10:50

Extraction Method: 537

Date Extracted: 01/19/2017 14:14

Sample wt/vol: 247.7(mL)

Date Analyzed: 01/22/2017 03:13

Con. Extract Vol.: 1.0(mL)

Dilution Factor: 1

Injection Volume: 10(uL)

GC Column: Acquity ID: 2.1(mm)

% Moisture:

GPC Cleanup: (Y/N) N

Analysis Batch No.: 147339

Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.061	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0095
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	122		70-130
STL00996	13C2 PFDA	111		70-130

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

7

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Client Sample ID: WI-CV-1RW56-0117

Lab Sample ID: 320-25078-7

Matrix: Water

Lab File ID: 20JAN2016A6A_083.d

Analysis Method: 537

Date Collected: 01/16/2017 12:51

Extraction Method: 537

Date Extracted: 01/19/2017 14:14

Sample wt/vol: 244.1(mL)

Date Analyzed: 01/22/2017 03:43

Con. Extract Vol.: 1.0(mL)

Dilution Factor: 1

Injection Volume: 10(uL)

GC Column: Acquity ID: 2.1(mm)

% Moisture: _____

GPC Cleanup: (Y/N) N

Analysis Batch No.: 147339

Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.061	0.049	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.025	U M	0.031	0.025	0.0096
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.049

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	115		70-130
STL00996	13C2 PFDA	110		70-130

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

8

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.:

Client Sample ID: WI-CV-1FB56-0117

Lab Sample ID: 320-25078-8

Matrix: Water

Lab File ID: 20JAN2016A6A_084.d

Analysis Method: 537

Date Collected: 01/16/2017 12:50

Extraction Method: 537

Date Extracted: 01/19/2017 14:14

Sample wt/vol: 249.9(mL)

Date Analyzed: 01/22/2017 04:12

Con. Extract Vol.: 1.0(mL)

Dilution Factor: 1

Injection Volume: 10(uL)

GC Column: Acquity ID: 2.1(mm)

% Moisture:

GPC Cleanup: (Y/N) N

Analysis Batch No.: 147339

Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	114		70-130
STL00996	13C2 PFDA	108		70-130

w 2/1/17

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

9

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
 SDG No.: _____
 Client Sample ID: WI-CV-1RW57-0117 Lab Sample ID: 320-25078-9
 Matrix: Water Lab File ID: 20JAN2016A6A_085.d
 Analysis Method: 537 Date Collected: 01/16/2017 14:26
 Extraction Method: 537 Date Extracted: 01/19/2017 14:14
 Sample wt/vol: 249.3(mL) Date Analyzed: 01/22/2017 04:42
 Con. Extract Vol.: 1.0(mL) Dilution Factor: 1
 Injection Volume: 10(uL) GC Column: Acquity ID: 2.1(mm)
 % Moisture: _____ GPC Cleanup: (Y/N) N
 Analysis Batch No.: 147339 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U N	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	111		70-130
STL00996	13C2 PFDA	116		70-130

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

10

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
SDG No.:
Client Sample ID: WI-CV-1FB57-0117 Lab Sample ID: 320-25078-10
Matrix: Water Lab File ID: 20JAN2016A6A_088.d
Analysis Method: 537 Date Collected: 01/16/2017 14:25
Extraction Method: 537 Date Extracted: 01/19/2017 14:14
Sample wt/vol: 250.9(mL) Date Analyzed: 01/22/2017 06:11
Con. Extract Vol.: 1.0(mL) Dilution Factor: 1
Injection Volume: 10(uL) GC Column: Acquity ID: 2.1(mm)
% Moisture: GPC Cleanup: (Y/N) N
Analysis Batch No.: 147340 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.048	U	0.060	0.048	0.015
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0094
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.047

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	119		70-130
STL00996	13C2 PFDA	115		70-130

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

11

Lab Name: TestAmerica Sacramento Job No.: 320-25078-1
SDG No.:
Client Sample ID: WI-CV-1RW58-0117 Lab Sample ID: 320-25078-11
Matrix: Water Lab File ID: 20JAN2016A6A_089.d
Analysis Method: 537 Date Collected: 01/16/2017 14:55
Extraction Method: 537 Date Extracted: 01/19/2017 14:14
Sample wt/vol: 243.5(mL) Date Analyzed: 01/22/2017 06:40
Con. Extract Vol.: 1.0(mL) Dilution Factor: 1
Injection Volume: 10(uL) GC Column: Acquity ID: 2.1(mm)
% Moisture: GPC Cleanup: (Y/N) N
Analysis Batch No.: 147340 Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.062	0.049	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.025	U	0.031	0.025	0.0097
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.049

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	112		70-130
STL00996	13C2 PFDA	108		70-130

2021117

FORM I
LCMS ORGANICS ANALYSIS DATA SHEET

12

Lab Name: TestAmerica Sacramento

Job No.: 320-25078-1

SDG No.: _____

Client Sample ID: WI-CV-1FB58-0117

Lab Sample ID: 320-25078-12

Matrix: Water

Lab File ID: 20JAN2016A6A_090.d

Analysis Method: 537

Date Collected: 01/16/2017 14:54

Extraction Method: 537

Date Extracted: 01/19/2017 14:14

Sample wt/vol: 246.1(mL)

Date Analyzed: 01/22/2017 07:10

Con. Extract Vol.: 1.0(mL)

Dilution Factor: 1

Injection Volume: 10(uL)

GC Column: Acquity ID: 2.1(mm)

% Moisture: _____


GPC Cleanup: (Y/N) N

Analysis Batch No.: 147340

Units: ug/L

CAS NO.	COMPOUND NAME	RESULT	Q	LOQ	LOD	DL
1763-23-1	Perfluorooctanesulfonic acid (PFOS)	0.049	U	0.061	0.049	0.016
335-67-1	Perfluorooctanoic acid (PFOA)	0.024	U	0.030	0.024	0.0096
375-73-5	Perfluorobutanesulfonic acid (PFBS)	0.11	U	0.14	0.11	0.048

CAS NO.	SURROGATE	%REC	Q	LIMITS
STL00993	13C2 PFHxA	122		70-130
STL00996	13C2 PFDA	111		70-130

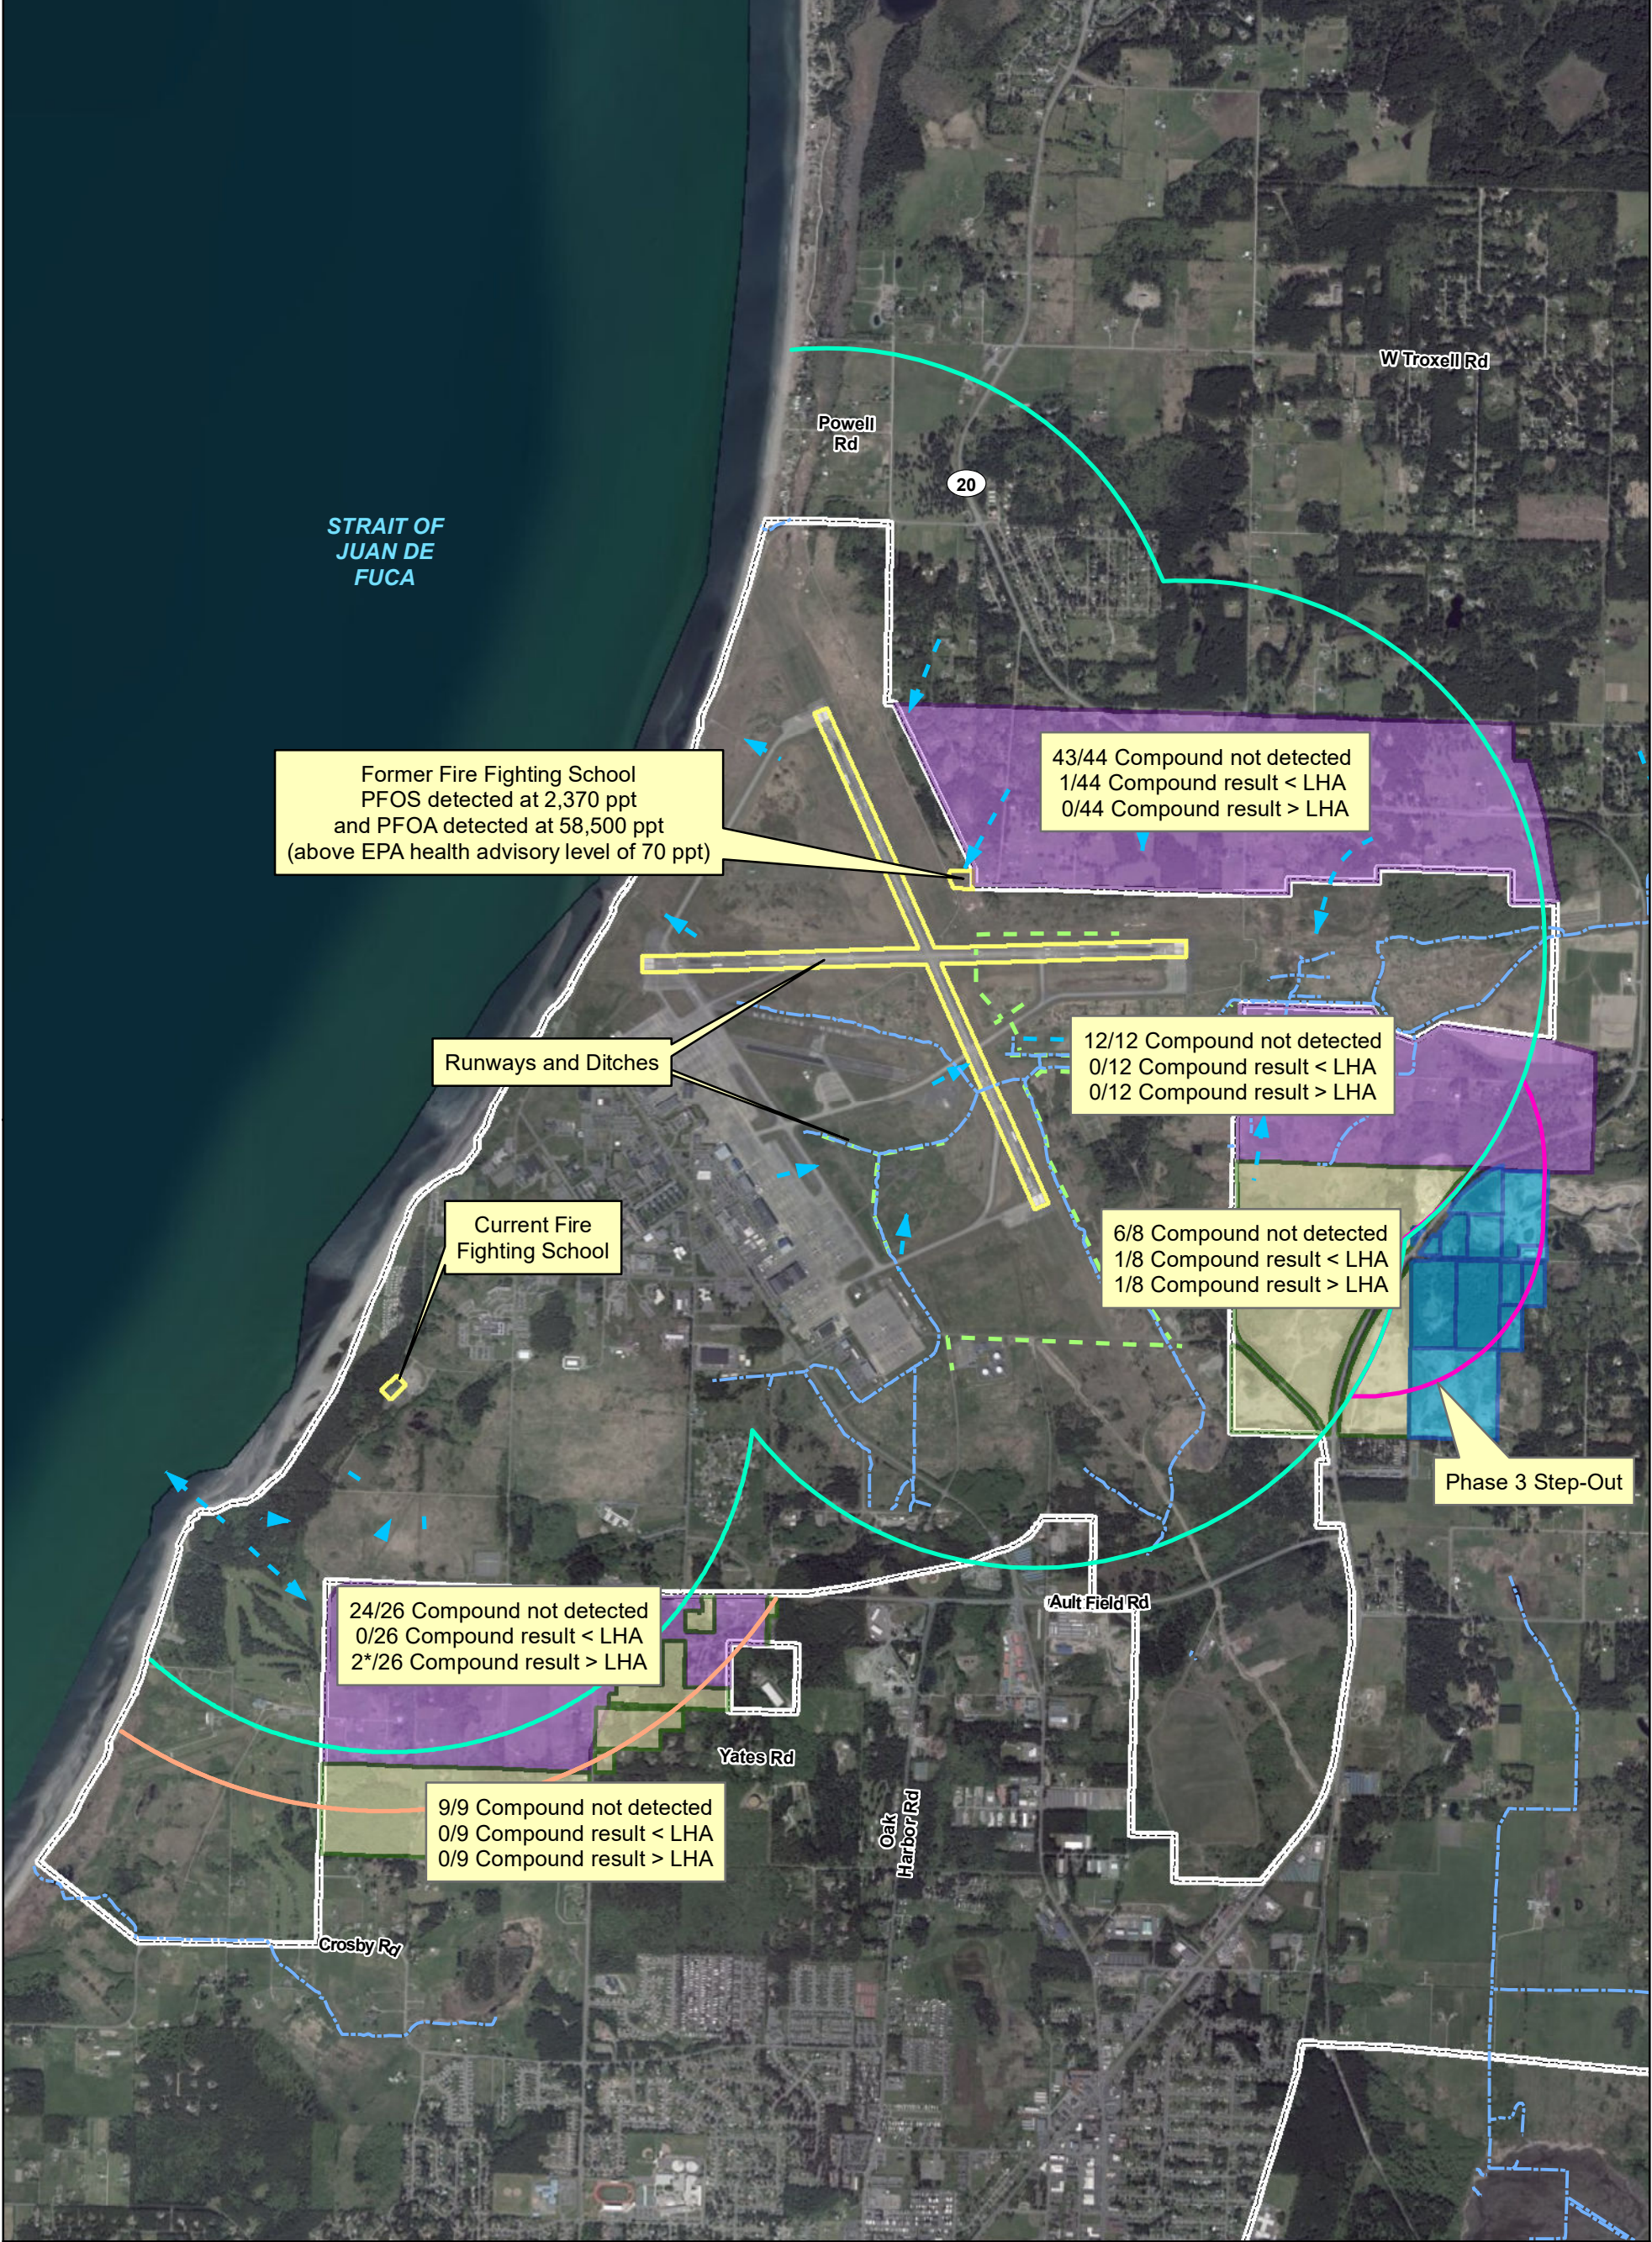

Legend

- 1 Mile Zone
- Half-mile Step-out Downgradient
- Surface Water
- Drainage Ditch
- Half-mile Step-out Downgradient
- Suspected Source Area
- Parcels in Phase 1 Sampling Area
- Parcels Identified in Phase 2 Sampling Area
- Parcels Identified in Phase 3 Sampling Area

- Base Boundary
- Inferred Groundwater Flow Direction
- * Second result above the EPA health advisory is from a duplicate sample collected from the well with the first exceedance near Ault Field.
- Note: PFOA and PFOS results reflected on figure, PFBS results discussed in Table 2 and text.




Figure 2
Results for Drinking Water Well Sampling
Ault Field
Naval Air Station Whidbey Island
Oak Harbor, Washington