

N60200.AR.000827
NAS CECIL FIELD, FL
5090.3a

SAMPLING AND ANALYSIS OUTLINE FOR BUILDING 141 BASE REALIGNMENT AND
CLOSURE ZONE B DEVELOPED NON-INDUSTRIAL AREA GROUP 7 NAS CECIL FIELD FL
3/1/1996
ABB ENVIRONMENTAL SERVICES INC

**SAMPLING AND ANALYSIS OUTLINE
BUILDING 141
BASE REALIGNMENT AND CLOSURE**

**ZONE B, DEVELOPED NONINDUSTRIAL AREA
GROUP VII**

**NAVAL AIR STATION CECIL FIELD
JACKSONVILLE, FLORIDA**

Unit Identification No. N60200

Contract No. N62467-89-D-0317/090

Prepared by:

**ABB Environmental Services, Inc.
2590 Executive Center Circle, East
Tallahassee, Florida 32301**

Prepared for:

**Department of the Navy, Southern Division
Naval Facilities Engineering Command
2155 Eagle Drive
North Charleston, South Carolina 29419**

Steve Wilson, Code 18B9, BRAC Environmental Coordinator

March 1996

TABLE OF CONTENTS

Sampling and Analysis Outline
Building 141
Base Realignment and Closure
Zone B, Developed Nonindustrial Area Group VII
Naval Air Station Cecil Field
Jacksonville, Florida

<u>Chapter</u>	<u>Title</u>	<u>Page No.</u>
1.0	SITE DESCRIPTION	1
2.0	ENVIRONMENTAL BASELINE SURVEY COLOR DESIGNATION	1
3.0	RECOMMENDATIONS	1
4.0	REFERENCES	1

LIST OF FIGURES

<u>Figure</u>	<u>Title</u>	<u>Page No.</u>
1	Building 141 Emergency Generator Station	2

GLOSSARY

ABB-ES ABB Environmental Services, Inc.
EBS Environmental Baseline Survey
UST underground storage tank

1.0 SITE DESCRIPTION

This Base Realignment and Closure Phase II Sampling and Analysis Outline briefly describes and proposes a plan for assessment of Building 141 at Naval Air Station Cecil Field. Building 141 is located north of Fourth Street, between G Avenue and H Avenue (Figure 1).

The facility is referred to as an Emergency Generator Station in the Environmental Baseline Survey (EBS) Report (ABB Environmental Services, Inc. [ABB-ES], 1994). The emergency generator at this facility provides backup power for an adjacent lift station.

2.0 ENVIRONMENTAL BASELINE SURVEY COLOR DESIGNATION

Building 141 was color-coded Grey in the EBS Report because of the presence of a 250-gallon diesel fuel underground storage tank (UST). No other environmental concerns were noted in the EBS report. The conclusions of the EBS Report are consistent with field observations made during a walkover reconnaissance of the site by ABB-ES on August 9, 1995.

3.0 RECOMMENDATIONS

Potential environmental concerns associated with the diesel fuel UST will be addressed separately by the Tank Management Plan. No other concerns were identified in the EBS Report, or during subsequent site walkovers. Therefore, no Phase II sampling or analysis is recommended for this facility.

A recommendation to reclassify the color code for Building 141 is pending a satisfactory resolution of UST issues.

4.0 SELECTED REFERENCES

ABB Environmental Services, Inc. (ABB-ES), 1994a, Base Realignment and Closure Environmental Baseline Survey Report, Naval Air Station (NAS) Cecil Field, Jacksonville, Florida: prepared for Southern Division, Naval Facilities Engineering Command (SOUTHNAVFACENGCOC), November.

ABB-ES, 1994b, Project Operations Plan for Cecil Field and Health and Safety Plan: prepared for SOUTHNAVFACENGCOC, December.

ABB-ES, in press, Base Realignment and Closure Tank Management Plan for NAS Cecil Field, Jacksonville, Florida: prepared for SOUTHNAVFACENGCOC.

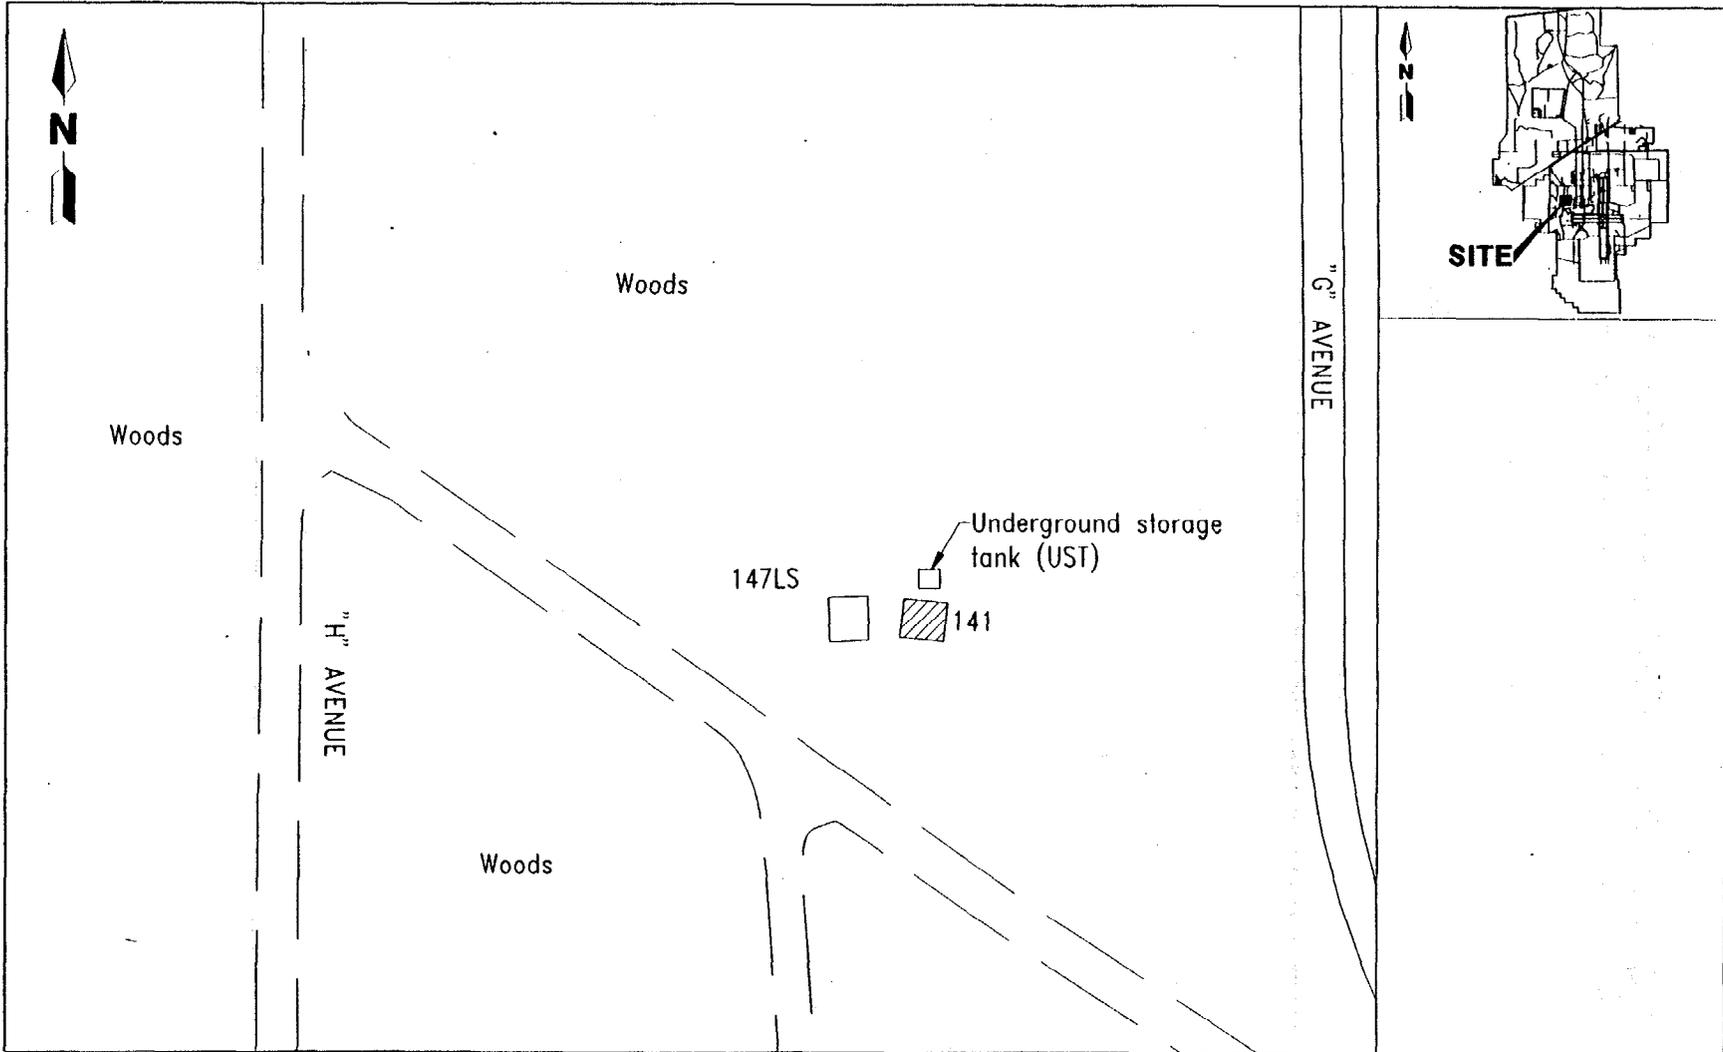


FIGURE 1
BUILDING 141
EMERGENCY GENERATOR STATION



**GROUP VII SAMPLING AND
ANALYSIS OUTLINE**

**NAS CECIL FIELD
JACKSONVILLE, FLORIDA**