

N61165.AR.005677
CNC CHARLESTON
5090.3a

UNDERGROUND STORAGE TANK (UST) ASSESSMENT REPORT FOR QUARTERS N CNC
CHARLESTON SC
04/27/1998
SOUTH CAROLINA DEPARTMENT OF HEALTH AND ENVIRONMENTAL CONTROL

NFA
7

L16.5.98
L07.15.98

RECEIVED
JUN 4 1998
Water Monitoring, Assessment & Protection Division

South Carolina Department of Health and Environmental Control (S.C.D.H.E.C.)
Underground Storage Tank (UST) Assessment Report

Submit Completed Form to:

Date Received

State Use Only

UST Regulatory Section
SCDHEC
2600 Bull Street
Columbia, South Carolina 29201
Telephone (803) 734-5331

I OWNERSHIP OF UST(S)

Agency/Owner: Southern Division, Naval Facilities Engineering Command, Caretaker Site Office

Mailing Address: P.O. Box 190010

City: N. Charleston State: SC Zip Code: 29419-9010

Area Code: 843 Telephone Number: 743-9985 Contact Person: Henry N. Shepard II, P. E.

II SITE IDENTIFICATION AND LOCATION

Site I.D. #: Unregulated

Facility Name: Charleston Naval Base Complex, Housing Quarters N

Street Address: 161 Everglades Ave.

City: North Charleston, 29405-2413 County: Charleston

III CLOSURE INFORMATION

Closure Started: 21 April 1998 Closure Completed: 27 April 1998

Number of USTs Closed: 1

N/A Consultant SPORTENVDETCASN UST Removal Contractor

IV. CERTIFICATION (Read and Sign after completing entire submittal)

I certify that I have personally examined and am familiar with the information submitted in this and all attached documents, and that based on my inquiry of those individuals responsible for obtaining this information, I believe that the submitted information is true, accurate and complete.
Henry Shepard II, P. E.
Name (Type or Print)
Henry N. Shepard II PE 5/20/98
Signature

V. UST INFORMATION

- A. Product.....
- B. Capacity.....
- C. Age.....
- D. Construction Material.....
- E. Month/Year of Last Use.....
- F. Depth (ft.) To Base of Tank.....
- G. Spill Prevention Equipment Y/N.....
- H. Overfill Prevention Equipment Y/N.....
- I. Method of Closure Removed/Filled.....
- J. Visible Corrosion or Pitting Y/N.....
- K. Visible Holes Y/N.....

	Tank 1	Tank 2	Tank 3	Tank 4	Tank 5
Fuel oil					
550 gal					
Unk.					
Steel					
3/98					
6'					
N					
N					
R					
Y					
N					

- L. Method of disposal for any USTs removed from the ground (attach disposal manifests)

UST Quarters N was removed, drained, cut open at both ends, and cleaned with a steam cleaner. It was then cut up for recycling as scrap metal. (See Attachment III.)

- M. Method of disposal for any liquid petroleum, sludges, or waste waters removed from the USTs (attach disposal manifests)

The sludge, waste water, and residual fuel oil from UST Quarters N were recycled.

- N. If any corrosion, pitting, or holes were observed, describe the location and extent for each UST

UST Quarters N was covered with a protective coating of pitch. The tank was in good condition. Patches of corrosion were present, but no holes or pitting were found.

VI. PIPING INFORMATION

- A. Construction Material.....
- B. Distance from UST to Dispenser.....
- C. Number of Dispensers.....
- D. Type of System P/S.....
- E. Was Piping Removed from the Ground? Y/N....
- F. Visible Corrosion or Pitting Y/N.....
- G. Visible Holes Y/N.....
- H. Age.....

Note 1: UST Quarters N provided heating fuel oil to housing Quarters N.

	Tank 1	Tank 2	Tank 3	Tank 4	Tank 5
Copper & Steel					
73' See note 1					
1 see note 1					
S					
Y					
Y					
N					
Unk.					

- I. If any corrosion, pitting, or holes were observed, describe the location and extent for each line.

The steel ventilation pipe was corroded throughout its length, but no holes were found. The copper supply and return lines were in good condition.

VII. BRIEF SITE DESCRIPTION AND HISTORY

Quarters N was built in the late 1930s. It served as housing for Naval families until base closure.

VIII. SITE CONDITIONS

Yes No Unk

	Yes	No	Unk
<p>A. Were any petroleum-stained or contaminated soils found in the UST excavation, soil borings, trenches, or monitoring wells?</p> <p>If yes, indicate depth and location on the site map.</p>		X	
<p>B. Were any petroleum odors detected in the excavation, soil borings, trenches, or monitoring wells?</p> <p>If yes, indicate location on site map and describe the odor (strong, mild, etc.)</p>		X	
<p>C. Was water present in the UST excavation, soil borings, or trenches?</p> <p>If yes, how far below land surface (indicate location and depth)?</p> <p>_____</p>		X	
<p>D. Did contaminated soils remain stockpiled on site after closure?</p> <p>If yes, indicate the stockpile location on the site map.</p> <p>Name of DHEC representative authorizing soil removal:</p> <p>_____</p>		X*	
<p>E. Was a petroleum sheen or free product detected on any excavation or boring waters?</p> <p>If yes, indicate location and thickness.</p>		X**	

* All excavated soil was returned to the tank pit.

** No groundwater was encountered.

X. SAMPLING METHODOLOGY

Provide a detailed description of the methods used to collect and store (preserve) the samples.

After the removal of UST Quarters N, soil samples were taken. Sampling was performed in accordance with SC DHEC R.61-92 Part 280 and SC DHEC UST Assessment Guidelines.

Sample jars were prepared by the testing laboratory. The grab method was utilized to fill the sample containers leaving as little head space as possible and immediately capped. Samples were extracted at the tank ends and from beneath the piping at the mechanical connections.

The samples were marked, logged, and immediately placed in sample coolers packed with ice to maintain an approximate temperature of 4° C. Tools were thoroughly cleaned and decontaminated with organic-free soap and water after each sample.

The samples remained in the custody of SPORTENVDETCHASN until they were transferred to General Engineering Laboratories for analysis as documented in the attached Chain-of-Custody Record.

The laboratory soil used for the soil trip blanks that accompanied the samples was taken from the wrong container. This soil exhibited contamination of naphthalene at approximately 6 ug/kg, toluene at ~1 ug/kg, and xylenes at ~ 1 ug/kg. Although this had no effect on the soil samples, the condition renders the use of these trip blanks as unsatisfactory for quality control purposes. Accordingly, the data is not included with the site samples. The problem has been corrected and the unsatisfactory soil has been removed from the lab.

XI. RECEPTORS



Yes No

<p>A. Are there any lakes, ponds, streams, or wetlands located within 1000 feet of the UST system? <div style="text-align: center;">[Cooper River ~ 150']</div> <p>If yes, indicate type of receptor, distance, and direction on site map.</p> </p>	X	
<p>B. Are there any public, private, or irrigation water supply wells within 1000 feet of the UST system? <p>If yes, indicate type of well, distance, and direction on site map.</p> </p>		X
<p>C. Are there any underground structures (e.g., basements) located within 100 feet of the UST system? <p>If yes, indicate the type of structure, distance, and direction on site map.</p> </p>		X
<p>D. Are there any underground utilities (e.g., telephone, electricity, gas, water, sewer, storm drain) located within 100 feet of the UST system that could potentially come in contact with the contamination? <div style="text-align: center;">[storm drain, water, phone]</div> <p>If yes, indicate the type of utility, distance, and direction on the site map.</p> </p>	X	
<p>E. Has contaminated soil been identified at a depth of less than 3 feet below land surface in an area that is not capped by asphalt or concrete? <p>If yes, indicate the area of contaminated soil on the site map.</p> </p>		X

SITE MAP

You must supply a scaled site map. It should include all buildings, road names, utilities, tank and pump island locations, sample locations, extent of excavation, and any other pertinent information.

Site Maps 1 and 2
Photographs 1, 2, and 3

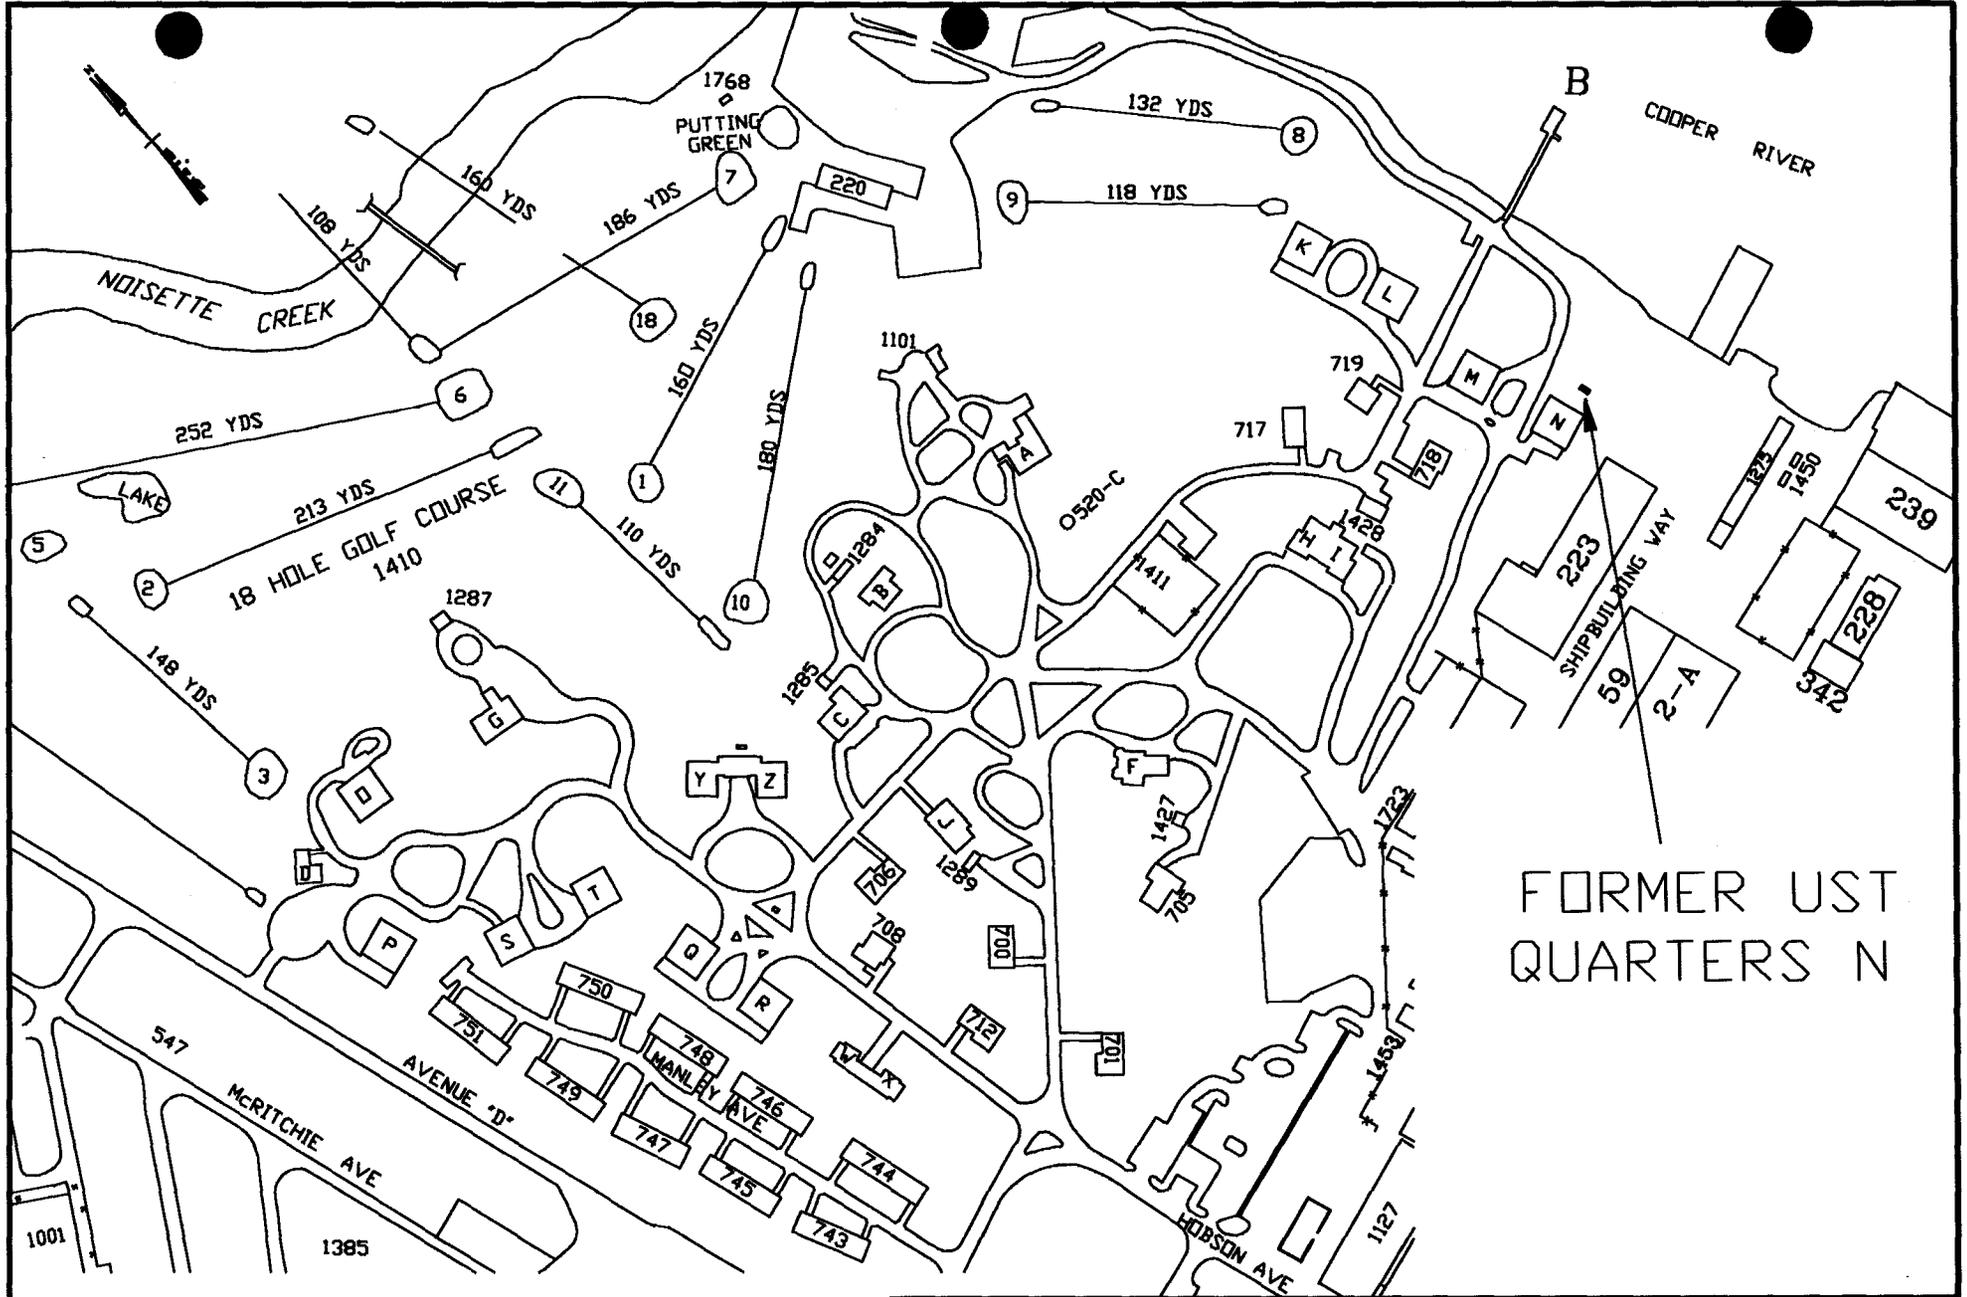

GRAPHIC SCALE

SPORTENVDETHASN
 1899 North Hobson Ave.
 North Charleston, SC
 29405-2108
 Ph. (803) 743-6777

Site Map 1
 UST Quarters N
 Charleston Naval Base
 Charleston, SC

DWG DATE: 6 MAY 98

DWG NAME: QT-N_1

(150' @ COOPER RIVER)

GRASSY
(AREA)

S.S. SPORT 0671-3,
SANDY TAN SOIL,
NO ODOR (PID = 0.9 ppm)

S.S. SPORT 0671-2,
SANDY TAN SOIL,
NO ODOR (PID = 1.3 ppm)

WATER CUT-OFF VALVE

FILL CONN.

FORMER UST QUARTERS "M"

TELEPHONE LINE

EXCAVATION,
9' x 7' x 6-1/2' DEEP

EVERGLADES DR.

WATER SPIGOT

2" STEEL VENT PIPE

SIDEWALK

WATER-LINE

S.S. SPORT 0672-3,
SANDY TAN SOIL,
NO ODOR (PID = 3.1 ppm)

WATER SPIGOT

STORM DRAIN

S.S. SPORT 0672-2,
SANDY TAN SOIL,
NO ODOR (PID = 2.9 ppm)

QUARTERS "N"
(161 EVERGLADES)

PLUGGED SUPPLY &
RETURN 1/2" FUEL
OIL COPPER LINES

SIDEWALK

DRIVEWAY

CIA FENCE

LEGEND

S.S. - SOIL SAMPLE



GRAPHIC SCALE

SPORTENVDETHASN
1899 North Hobson Ave.
North Charleston, SC 29405-2106
Ph. (803) 743-8777

Site Map 2
UST QUARTERS' "N"
Charleston Naval Base
Charleston, SC

DWG DATE: 12 MAY 98

DWG NAME: QTRS "N"_2

UST Quarters N

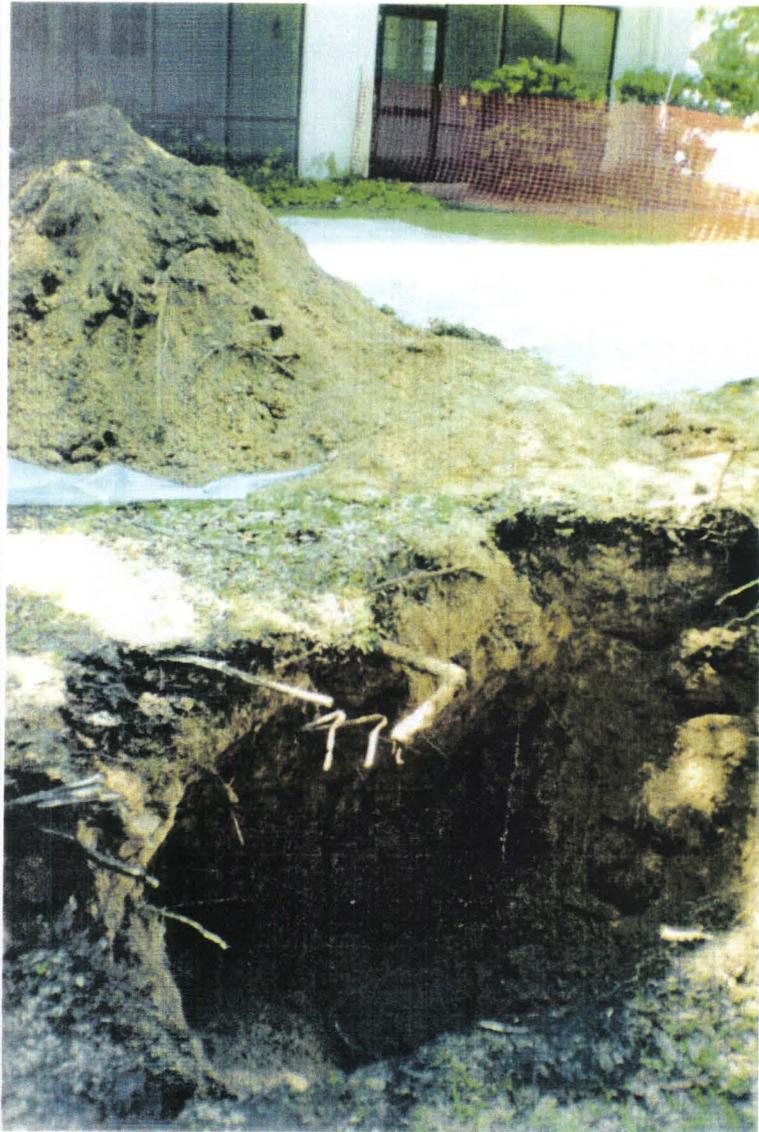


Photo 1: UST Quarters N excavation. The steel ventilation and copper supply and return piping are in the center of the photo. This photo was taken before the piping was removed

UST Quarters N



Photo 2: UST Quarters N being readied for transport to the cutting and cleaning pad.



Photo 3: UST Quarters N after cleaning and cutting.

Attachment II
ANALYTICAL RESULTS

You must submit the laboratory report and chain-of-custody form for the samples. These samples must be analyzed by a South Carolina certified laboratory.

Certified Analytical Results
Chain-of-Custody



GENERAL ENGINEERING LABORATORIES

Meeting today's needs with a vision for tomorrow.

Laboratory Certifications

STATE	GEL	EPI
FL	E87156/87294	E87472/87458
NC	233	
SC	10120	10582
TN	02934	02934

Client: Supervisor of Ship Building & Conversion
 SUPSHIP-Portsmouth Detachment-Env.
 1899 North Hobson Ave.
 North Charleston, South Carolina 29405-2106

Contact: Mr. Bill Hiers

Project Description: SUPSHIP-Portsmouth Detachment

cc: NPWC00197

Report Date: May 08, 1998

Page 1 of 2

Sample ID : SPORT0671-2
 Lab ID : 9804678-02
 Matrix : Soil
 Date Collected : 04/21/98
 Date Received : 04/24/98
 Priority : Routine
 Collector : Client

Parameter	Qualifier	Result	DL	RL	Units	DF	Analyst	Date	Time	Batch	M
Volatile Organics											
<i>BTEX - 4 items</i>											
Benzene	U	0.00	1.00	2.00	ug/kg	1.0	TCL	04/29/98	1511	121040	1
Ethylbenzene	U	0.705	1.00	2.00	ug/kg	1.0					
Toluene	U	0.00	1.00	2.00	ug/kg	1.0					
Xylenes (TOTAL)		4.38	1.00	4.00	ug/kg	1.0					
Naphthalene	U	0.00	1.00	2.00	ug/kg	1.0					
Extractable Organics											
<i>Polynuclear Aromatic Hydrocarbons - 16 items</i>											
Acenaphthene	U	0.00	165	330	ug/kg	1.0	RLC	05/05/98	1223	120940	2
Acenaphthylene	U	0.00	165	330	ug/kg	1.0					
Anthracene	U	0.00	165	330	ug/kg	1.0					
Benzo(a)anthracene	U	0.00	165	330	ug/kg	1.0					
Benzo(a)pyrene	U	0.00	165	330	ug/kg	1.0					
Benzo(b)fluoranthene	U	0.00	165	330	ug/kg	1.0					
Benzo(ghi)perylene	U	0.00	165	330	ug/kg	1.0					
Benzo(k)fluoranthene	U	0.00	165	330	ug/kg	1.0					
Chrysene	U	0.00	165	330	ug/kg	1.0					
Dibenzo(a,h)anthracene	U	0.00	165	330	ug/kg	1.0					
Fluoranthene	J	175	165	330	ug/kg	1.0					
Fluorene	U	0.00	165	330	ug/kg	1.0					
Indeno(1,2,3-c,d)pyrene	U	0.00	165	330	ug/kg	1.0					
Naphthalene	U	0.00	165	330	ug/kg	1.0					
Phenanthrene	J	186	165	330	ug/kg	1.0					
Pyrene	U	0.00	165	330	ug/kg	1.0					

The following prep procedures were performed:
 GC/MS Base/Neutral Compounds

RDH 04/28/98 1510 120940 3

P O Box 30712 • Charleston, SC 29417 • 2040 Savage Road • 29414


(803) 556-8171 • Fax (803) 766-1178

9804678-02



Printed on recycled paper.





GENERAL ENGINEERING LABORATORIES

Meeting today's needs with a vision for tomorrow.

Laboratory Certifications

STATE	GEL	EPI
FL	E87156/87294	E87472/87458
NC	233	
SC	10120	10582
TN	02934	02934

Client: Supervisor of Ship Building & Conversion
 SUPSHIP-Portsmouth Detachment-Env.
 1899 North Hobson Ave.
 North Charleston, South Carolina 29405-2106

Contact: Mr. Bill Hiers

Project Description: SUPSHIP-Portsmouth Detachment

cc: NPWC00197

Report Date: May 08, 1998

Page 2 of 2

Sample ID : SPORT0671-2

Surrogate Recovery	Test	Percent%	Acceptable Limits
2-Fluorobiphenyl	M610	88.6	(30.0 - 115.)
Nitrobenzene-d5	M610	113.	(23.0 - 120.)
p-Terphenyl-d14	M610	84.3	(37.3 - 128.)
Bromofluorobenzene	BTEX-8260	90.4	(53.5 - 154.)
Dibromofluoromethane	BTEX-8260	90.0	(63.4 - 136.)
Toluene-d8	BTEX-8260	87.2	(72.1 - 137.)
Bromofluorobenzene	NAP-8260	90.4	(53.5 - 154.)
Dibromofluoromethane	NAP-8260	90.0	(63.4 - 136.)
Toluene-d8	NAP-8260	87.2	(72.1 - 137.)

M = Method

Method-Description

M 1	EPA 8260
M 2	EPA 8270
M 3	EPA 3550

Notes:

The qualifiers in this report are defined as follows:

ND indicates that the analyte was not detected at a concentration greater than the detection limit.

J indicates presence of analyte at a concentration less than the reporting limit (RL) and greater than the detection limit (DL).

U indicates that the analyte was not detected at a concentration greater than the detection limit.


* indicates that a quality control analyte recovery is outside of specified acceptance criteria.

This data report has been prepared and reviewed in accordance with General Engineering Laboratories standard operating procedures. Please direct any questions to your Project Manager, Karen Blakeney at (803) 769-7386.



Reviewed By





GENERAL ENGINEERING LABORATORIES

Meeting today's needs with a vision for tomorrow.

Laboratory Certifications

STATE	GEL	EPI
FL	E87156/87294	E87472/87458
NC	233	
SC	10120	10582
TN	02934	02934

Client: Supervisor of Ship Building & Conversion
 SUPSHIP-Portsmouth Detachment-Env.
 1899 North Hobson Ave.
 North Charleston, South Carolina 29405-2106

Contact: Mr. Bill Hiers

Project Description: SUPSHIP-Portsmouth Detachment

cc: NPWC00197

Report Date: May 08, 1998

Page 1 of 2

Sample ID : SPORT0671-3
 Lab ID : 9804678-03
 Matrix : Soil
 Date Collected : 04/21/98
 Date Received : 04/24/98
 Priority : Routine
 Collector : Client

Parameter	Qualifier	Result	DL	RL	Units	DF	Analyst	Date	Time	Batch	M
Volatile Organics											
<i>BTEX - 4 items</i>											
Benzene	U	0.00	1.00	2.00	ug/kg	1.0	TCL	04/30/98	1543	121040	1
Ethylbenzene	U	0.590	1.00	2.00	ug/kg	1.0					
Toluene	U	0.00	1.00	2.00	ug/kg	1.0					
Xylenes (TOTAL)	J	3.92	1.00	4.00	ug/kg	1.0					
Naphthalene	U	0.00	1.00	2.00	ug/kg	1.0					
Extractable Organics											
<i>Polynuclear Aromatic Hydrocarbons - 16 items</i>											
Acenaphthene	U	0.00	167	333	ug/kg	1.0	RLC	05/05/98	1251	120940	2
Acenaphthylene	U	0.00	167	333	ug/kg	1.0					
Anthracene	U	0.00	167	333	ug/kg	1.0					
Benzo(a)anthracene	U	0.00	167	333	ug/kg	1.0					
Benzo(a)pyrene	U	0.00	167	333	ug/kg	1.0					
Benzo(b)fluoranthene	U	0.00	167	333	ug/kg	1.0					
Benzo(ghi)perylene	U	0.00	167	333	ug/kg	1.0					
Benzo(k)fluoranthene	U	0.00	167	333	ug/kg	1.0					
Chrysene	U	0.00	167	333	ug/kg	1.0					
Dibenzo(a,h)anthracene	U	0.00	167	333	ug/kg	1.0					
Fluoranthene	U	0.00	167	333	ug/kg	1.0					
Fluorene	U	0.00	167	333	ug/kg	1.0					
Indeno(1,2,3-c.d)pyrene	U	0.00	167	333	ug/kg	1.0					
Naphthalene	U	0.00	167	333	ug/kg	1.0					
Phenanthrene	U	0.00	167	333	ug/kg	1.0					
Pyrene	U	0.00	167	333	ug/kg	1.0					

The following prep procedures were performed:
 GC/MS Base/Neutral Compounds

RDH 04/28/98 1510 120940 3

P O Box 30712 • Charleston, SC 29417 • 2040 Savage Road • 29414

(803) 556-8171 • Fax (803) 766-1178



9804678-03



Printed on recycled paper.



GENERAL ENGINEERING LABORATORIES

Meeting today's needs with a vision for tomorrow.

Laboratory Certifications

STATE	GEL	EPI
FL	E87156/87294	E87472/87458
NC	233	
SC	10120	10582
TN	02934	02934

Client: Supervisor of Ship Building & Conversion
 SUPSHIP-Portsmouth Detachment-Env.
 1899 North Hobson Ave.
 North Charleston, South Carolina 29405-2106

Contact: Mr. Bill Hiers

Project Description: SUPSHIP-Portsmouth Detachment

cc: NPWC00197

Report Date: May 08, 1998

Page 2 of 2

Sample ID : SPORT0671-3

Surrogate Recovery	Test	Percent%	Acceptable Limits
2-Fluorobiphenyl	M610	88.9	(30.0 - 115.)
Nitrobenzene-d5	M610	115.	(23.0 - 120.)
p-Terphenyl-d14	M610	82.6	(37.3 - 128.)
Bromofluorobenzene	BTEX-8260	90.8	(53.5 - 154.)
Dibromofluoromethane	BTEX-8260	90.0	(63.4 - 136.)
Toluene-d8	BTEX-8260	85.6	(72.1 - 137.)
Bromofluorobenzene	NAP-8260	90.8	(53.5 - 154.)
Dibromofluoromethane	NAP-8260	90.0	(63.4 - 136.)
Toluene-d8	NAP-8260	85.6	(72.1 - 137.)

M = Method	Method-Description
M 1	EPA 8260
M 2	EPA 8270
M 3	EPA 3550

Notes:

The qualifiers in this report are defined as follows:

ND indicates that the analyte was not detected at a concentration greater than the detection limit.

J indicates presence of analyte at a concentration less than the reporting limit (RL) and greater than the detection limit (DL).

U indicates that the analyte was not detected at a concentration greater than the detection limit.

* indicates that a quality control analyte recovery is outside of specified acceptance criteria.

This data report has been prepared and reviewed in accordance with General Engineering Laboratories standard operating procedures. Please direct any questions to your Project Manager, Karen Blakeney at (803) 769-7386.

Karen Blakeney
 Reviewed By


CHAIN OF CUSTODY RECORD

Page 1 of 1

9804678

Client Name/Facility Name		SAMPLE ANALYSIS REQUIRED (x) - use remarks area to specify specific compounds or methods												Use F or P in the boxes to indicate whether sample was filtered and/or preserved							
SPORT ENV DET CHASN		# OF CONTAINERS	pH, conductivity	TOC/DOC	TOX	Chloride, Fluoride, Sulfide	Nitrite/Nitrate	VOC - Specify Method required	METALS - specify	Pesticide	Herbicide	Total Phenol	Acid Extractables	B/N Extractables	PCB's	Cyanide	Coliform - specify type	BTEX/NAF	PAH	Remarks	
Collected by/Company																				WELL	SOIL
SAMPLE ID	DATE	TIME																			
-01	SPORT0671-1	4/21/98	1410	X	X													X		Soil Trip Blank	.2
-02	SPORT0671-2	4/21/98	1500	X	X													X	X	QTR'S N North	.1
-03	SPORT0671-3	4/21/98	1520	X	X													X	X	QTR'S N South	.1
-04	SPORT0671-4	4/21/98	0955	X	X													X	X	QTR'S m North	.1
-05	SPORT0671-5	4/22/98	1010	X	X													X	X	QTR'S m South	.1
-06	SPORT0671-6	4/22/98	1130	X	X													X	X	QTR'S L North	.1
-07	SPORT0671-7	4/22/98	1140	X	X													X	X	QTR'S L South	.1
-08	SPORT0671-8	4/23/98	1000	X	X													X	X	QTR'S K East	.1
-09	SPORT0671-9	4/23/98	1010	X	X													X	X	QTR'S K West	.1
-10	SPORT0671-10	4/23/98	1410	X	X													X	X	QTR'S Y-2 North	.1
-11	SPORT0671-11	4/23/98	1420	X	X													X	X	QTR'S Y-2 South	.1
-12	SPORT0671-12	4/23/98	1440	X	X													X	X	QTR'S Y-2 1 PPG	.1
Relinquished by:		Date:	Time:	Received by:		Relinquished by:		Date:	Time:	Received by:											
K. N. Poff		4/23/98	1615	Fred B. M. G.		Fred B. M. G.		4/24/98	1500	K. N. Poff											
Relinquished by:		Date:	Time:	Received by lab by:		Date:	Time:	Remarks:													
K. N. Poff		4/24/98	1610	Karen Brakeney		4-24-98	1610														

White = sample collector Yellow = file Pink = with report



GENERAL ENGINEERING LABORATORIES

Meeting today's needs with a vision for tomorrow.

Laboratory Certifications

STATE	GEL	EPI
FL	E87156/87294	E87472/87458
NC	233	
SC	10120	10582
TN	02934	02934

Client: Supervisor of Ship Building & Conversion
 SUPSHIP-Portsmouth Detachment-Env.
 1899 North Hobson Ave.
 North Charleston, South Carolina 29405-2106

Contact: Mr. Bill Hiers

Project Description: SUPSHIP-Portsmouth Detachment

cc: NPWC00197

Report Date: May 08, 1998

Page 1 of 2

Sample ID : SPORT0672-2
 Lab ID : 9804735-02
 Matrix : Soil
 Date Collected : 04/27/98
 Date Received : 04/28/98
 Priority : Routine
 Collector : Client

Parameter	Qualifier	Result	DL	RL	Units	DF	Analyst	Date	Time	Batch	M
Volatile Organics											
<i>BTEX - 4 items</i>											
Benzene	U	0.00	1.00	2.00	ug/kg	1.0	TCL	05/05/98	1541	121492	1
Ethylbenzene	U	0.00	1.00	2.00	ug/kg	1.0					
Toluene	U	0.00	1.00	2.00	ug/kg	1.0					
Xylenes (TOTAL)	U	0.00	1.00	4.00	ug/kg	1.0					
Naphthalene	U	0.00	1.00	2.00	ug/kg	1.0					
Extractable Organics											
<i>Polynuclear Aromatic Hydrocarbons - 16 items</i>											
Acenaphthene	U	0.00	167	333	ug/kg	1.0	GWL	05/01/98	1726	121135	2
Acenaphthylene	U	0.00	167	333	ug/kg	1.0					
Anthracene	U	0.00	167	333	ug/kg	1.0					
Benzo(a)anthracene	U	0.00	167	333	ug/kg	1.0					
Benzo(a)pyrene	U	0.00	167	333	ug/kg	1.0					
Benzo(b)fluoranthene	U	0.00	167	333	ug/kg	1.0					
Benzo(ghi)perylene	U	0.00	167	333	ug/kg	1.0					
Benzo(k)fluoranthene	U	0.00	167	333	ug/kg	1.0					
Chrysene	U	0.00	167	333	ug/kg	1.0					
Dibenzo(a,h)anthracene	U	0.00	167	333	ug/kg	1.0					
Fluoranthene	U	0.00	167	333	ug/kg	1.0					
Fluorene	U	0.00	167	333	ug/kg	1.0					
Indeno(1,2,3-c,d)pyrene	U	0.00	167	333	ug/kg	1.0					
Naphthalene	U	0.00	167	333	ug/kg	1.0					
Phenanthrene	U	0.00	167	333	ug/kg	1.0					
Pyrene	U	0.00	167	333	ug/kg	1.0					

The following prep procedures were performed:
 GC/MS Base/Neutral Compounds

CPU 04/30/98 1705 121135 3

P O Box 30712 • Charleston, SC 29417 • 2040 Savage Road • 29414


(803) 556-8171 • Fax (803) 766-1178



Printed on recycled paper.



9804735-02



GENERAL ENGINEERING LABORATORIES

Meeting today's needs with a vision for tomorrow.

Laboratory Certifications

STATE	GEL	EPI
FL	E87156/87294	E87472/87458
NC	233	
SC	10120	10582
TN	02934	02934

Client: Supervisor of Ship Building & Conversion
SUPSHIP-Portsmouth Detachment-Env.
1899 North Hobson Ave.
North Charleston, South Carolina 29405-2106

Contact: Mr. Bill Hiers

Project Description: SUPSHIP-Portsmouth Detachment

cc: NPWC00197

Report Date: May 08, 1998

Page 2 of 2

Sample ID : SPORT0672-2

Surrogate Recovery	Test	Percent%	Acceptable Limits
2-Fluorobiphenyl	M610	76.8	(30.0 - 115.)
Nitrobenzene-d5	M610	72.3	(23.0 - 120.)
p-Terphenyl-d14	M610	89.5	(37.3 - 128.)
Bromofluorobenzene	BTEX-8260	96.0	(53.5 - 154.)
Dibromofluoromethane	BTEX-8260	88.2	(63.4 - 136.)
Toluene-d8	BTEX-8260	87.2	(72.1 - 137.)
Bromofluorobenzene	NAP-8260	96.0	(53.5 - 154.)
Dibromofluoromethane	NAP-8260	88.2	(63.4 - 136.)
Toluene-d8	NAP-8260	87.2	(72.1 - 137.)

M = Method

Method-Description

M 1	EPA 8260
M 2	EPA 8270
M 3	EPA 3550

Notes:

The qualifiers in this report are defined as follows:

ND indicates that the analyte was not detected at a concentration greater than the detection limit.

J indicates presence of analyte at a concentration less than the reporting limit (RL) and greater than the detection limit (DL).


U indicates that the analyte was not detected at a concentration greater than the detection limit.

* indicates that a quality control analyte recovery is outside of specified acceptance criteria.

This data report has been prepared and reviewed in accordance with General Engineering Laboratories standard operating procedures. Please direct any questions to your Project Manager, Karen Blakeney at (803) 769-7386.

Karen Blakeney
Reviewed By





GENERAL ENGINEERING LABORATORIES

Meeting today's needs with a vision for tomorrow.

Laboratory Certifications

STATE	GEL	EPI
FL	E87156/87294	E87472/87458
NC	233	
SC	10120	10582
TN	02934	02934

Client: Supervisor of Ship Building & Conversion
 SUPSHIP-Portsmouth Detachment-Env.
 1899 North Hobson Ave.
 North Charleston, South Carolina 29405-2106

Contact: Mr. Bill Hiers

Project Description: SUPSHIP-Portsmouth Detachment

cc: NPWC00197

Report Date: May 08, 1998

Page 1 of 2

Sample ID : SPORT0672-3
 Lab ID : 9804735-03
 Matrix : Soil
 Date Collected : 04/27/98
 Date Received : 04/28/98
 Priority : Routine
 Collector : Client

Parameter	Qualifier	Result	DL	RL	Units	DF	Analyst	Date	Time	Batch	M
Volatile Organics											
<i>BTEX - 4 items</i>											
Benzene	U	0.00	1.00	2.00	ug/kg	1.0	TCL	05/05/98	1613	121492	1
Ethylbenzene	U	0.00	1.00	2.00	ug/kg	1.0					
Toluene	U	0.00	1.00	2.00	ug/kg	1.0					
Xylenes (TOTAL)	U	0.00	1.00	4.00	ug/kg	1.0					
Naphthalene	U	0.00	1.00	2.00	ug/kg	1.0					
Extractable Organics											
<i>Polynuclear Aromatic Hydrocarbons - 16 items</i>											
Acenaphthene	U	0.00	666	1330	ug/kg	4.0	GWL	05/01/98	1758	121135	2
Acenaphthylene	U	0.00	666	1330	ug/kg	4.0					
Anthracene	U	0.00	666	1330	ug/kg	4.0					
Benzo(a)anthracene	U	0.00	666	1330	ug/kg	4.0					
Benzo(a)pyrene	U	0.00	666	1330	ug/kg	4.0					
Benzo(b)fluoranthene	U	0.00	666	1330	ug/kg	4.0					
Benzo(ghi)perylene	U	0.00	666	1330	ug/kg	4.0					
Benzo(k)fluoranthene	U	0.00	666	1330	ug/kg	4.0					
Chrysene	U	0.00	666	1330	ug/kg	4.0					
Dibenzo(a,h)anthracene	U	0.00	666	1330	ug/kg	4.0					
Fluoranthene	U	0.00	666	1330	ug/kg	4.0					
Fluorene	U	0.00	666	1330	ug/kg	4.0					
Indeno(1,2,3-c,d)pyrene	U	0.00	666	1330	ug/kg	4.0					
Naphthalene	U	0.00	666	1330	ug/kg	4.0					
Phenanthrene	U	0.00	666	1330	ug/kg	4.0					
Pyrene	U	0.00	666	1330	ug/kg	4.0					

The following prep procedures were performed:

GC/MS Base/Neutral Compounds

CPU 04/30/98 1705 121135 3

P O Box 30712 • Charleston, SC 29417 • 2040 Savage Road • 29414


(803) 556-8171 • Fax (803) 766-1178

9804735-03



Printed on recycled paper.





GENERAL ENGINEERING LABORATORIES

Meeting today's needs with a vision for tomorrow.

Laboratory Certifications

STATE	GEL	EPI
FL	E87156/87294	E87472/87458
NC	233	
SC	10120	10582
TN	02934	02934

Client: Supervisor of Ship Building & Conversion
 SUPSHIP-Portsmouth Detachment-Env.
 1899 North Hobson Ave.
 North Charleston, South Carolina 29405-2106

Contact: Mr. Bill Hiers

Project Description: SUPSHIP-Portsmouth Detachment

cc: NPWC00197

Report Date: May 08, 1998

Page 2 of 2

Sample ID : SPORT0672-3

Surrogate Recovery	Test	Percent%	Acceptable Limits
2-Fluorobiphenyl	M610	78.6	(30.0 - 115.)
Nitrobenzene-d5	M610	63.7	(23.0 - 120.)
p-Terphenyl-d14	M610	88.2	(37.3 - 128.)
Bromofluorobenzene	BTEX-8260	103.	(53.5 - 154.)
Dibromofluoromethane	BTEX-8260	85.0	(63.4 - 136.)
Toluene-d8	BTEX-8260	92.0	(72.1 - 137.)
Bromofluorobenzene	NAP-8260	103.	(53.5 - 154.)
Dibromofluoromethane	NAP-8260	85.0	(63.4 - 136.)
Toluene-d8	NAP-8260	92.0	(72.1 - 137.)

M = Method	Method-Description
M 1	EPA 8260
M 2	EPA 8270
M 3	EPA 3550

Notes:

The qualifiers in this report are defined as follows:

ND indicates that the analyte was not detected at a concentration greater than the detection limit.

J indicates presence of analyte at a concentration less than the reporting limit (RL) and greater than the detection limit (DL).

U indicates that the analyte was not detected at a concentration greater than the detection limit.

* indicates that a quality control analyte recovery is outside of specified acceptance criteria.

This data report has been prepared and reviewed in accordance with General Engineering Laboratories standard operating procedures. Please direct any questions to your Project Manager, Karen Blakeney at (803) 769-7386.

Karen Blakeney
Reviewed By

NPWC 00197

General Engineering Laboratories, Inc.
 2040 Savage Road
 Charleston, South Carolina 29407
 P.O. Box 30712
 Charleston, South Carolina 29417
 (803) 556-8171

CHAIN OF CUSTODY RECORD

Page 1 of 1

9804735

Client Name/Facility Name				SAMPLE ANALYSIS REQUIRED (x) - use remarks area to specify specific compounds or methods																Use F or P in the boxes to indicate whether sample was filtered and/or preserved					
SPORT ENV DET CHASN																				← CCL 32477					
Collected by/Company																				Remarks					
SPORT ENV DET CHASN																									
SAMPLE ID	DATE	TIME	# OF CONTAINERS				pH, conductivity	TOC/DOC	TOX	Chloride, Fluoride, Sulfide	Nitrite/Nitrate	VOC - Specify Method Required	METALS - specify	Pesticide	Herbicide	Total Phenol	Acid Extractables	B/N Extractables	PCB's	Cyanide	Coliform - specify type	BTEX/NAP	PAH	Remarks	
			WELL	SOIL	COMP	GRAB																			
-01	SP0RT 0672-1	4/27/98	0830	X	X	1																X		Soil Trip Blank	.1
-02	SP0RT 0672-2	4/27/98	0931	X	X	2																X	X	QTR'S N PPG-1	.2
-03	SP0RT 0672-3	4/27/98	0948	X	X	2																X	X	QTR'S N PPG-2	.2
-04	SP0RT 0672-4	4/27/98	1005	X	X	2																X	X	QTR'S M Ppg-1	.2
-05	SP0RT 0672-5	4/27/98	1015	X	X	2																X	X	QTR'S M Ppg-2	.2
-06	SP0RT 0672-6	4/27/98	1045	X	X	2																X	X	QTR'S L Ppg-1	.2
-07	SP0RT 0672-7	4/27/98	1120	X	X	2																X	X	QTR'S K Ppg-1	.2
-08	SP0RT 0672-8	4/27/98	1145	X	X	2																X	X	QTR'S A Ppg-1	.2
Relinquished by: <i>RWC</i>				Date: 4/27/98	Time: 1450	Received by: <i>John M. Smith</i>				Relinquished by: <i>John M. Smith</i>				Date: 4/28/98	Time: 1410	Received by: <i>Karen Blakemore</i>									
Relinquished by: <i>Karen Blakemore</i>				Date: 4/28/98	Time: 1510	Received by lab by: <i>Dionne Francis</i>				Date: 4/28/98	Time: 1510	Remarks:													

White = sample collector Yellow = file Pink = with report

Attachment III

Certificate of Disposal (tank)

UST Certificate of Disposal

CONTRACTOR

Supervisor of Shipbuilding Conversion and Repair
Portsmouth, VA
Environmental Detachment Charleston
1899 North Hobson Avenue
North Charleston 29405-2106

Telephone (843) 743-6482

TANK ID & LOCATION

UST Quarters N; Quarters N, 161 Everglades Ave., Charleston SC

DISPOSAL LOCATION

Bldg. 1601 Tank Cleaning
& Disposal Area
Charleston Naval Complex

TYPE OF TANK

Fuel oil

SIZE (GAL)

550 gal


CLEANING/DISPOSAL METHOD

The tank was cut open on both ends, cleaned with a steam cleaner, and disposed of as recyclable scrap metal.

DISPOSAL CERTIFICATION

I certify that the above tank has been properly cleaned and disposed of as recyclable scrap metal.


Sidney C. Ladson


(Date)



15 July 1998

2600 Bull Street
Columbia, SC 29201-1708

COMMISSIONER:
Douglas E. Bryant

BOARD:
John H. Burriss
Chairman

William M. Hull, Jr., MD
Vice Chairman

Roger Leaks, Jr.
Secretary

Mark B. Kent

Cyndi C. Mosteller

Brian K. Smith

Rodney L. Grandy


Department of the Navy
Southern Division NFEC
P.O. Box 190010
North Charleston, SC 29419-9010
Attn: Mr. Gabriel Magwood


Re: Underground Storage Tank Assessment Report dated 1 June 1998
Quarters "N" Housing (Site Identification # 15405-General File)
Charleston Naval Complex/Charleston Naval Base
Charleston, SC
Charleston County

Dear Mr. Magwood:

The author has completed technical review of the referenced document. As submitted, the report provides a narrative describing closure activities and analytical results of environmental sampling to determine if releases have occurred as a result of operation of the referenced vessel and/or associated piping system. The analytical results provided indicate reportable concentrations of BTEX compounds were detected in soil grab samples obtained from the UST excavation. The reported concentrations are below levels proposed in the SCAP (Soil Corrective Action Plan, amended July 1997). Based on review of the employed closure activities and sampling results it appears that no additional endeavors for remedial actions and/or contaminant characterization is warranted for Quarters "N" Housing at this time. Please be aware this statement pertains only to the portion of the facility addressed in the referenced document and does not apply to other areas of the facility and/or any other potential regulatory violations. The Department retains the authority to request additional assessments and/or remedial endeavors, as appropriate, if future conditions or information warrant and are deemed necessary.

Should you have any questions please contact me at (803) 734-5328.

Sincerely,

Paul L. Bristol, Hydrogeologist
Groundwater Quality Section
Bureau of Water


Tom Knight, Manager
Groundwater Quality Section
Bureau of Water

cc: Trident District EQC



DEPARTMENT OF THE NAVY
SOUTHERN DIVISION
NAVAL FACILITIES ENGINEERING COMMAND
P.O. BOX 190010
2155 EAGLE DRIVE
NORTH CHARLESTON, S.C. 29419-9010

NFA
S

L 6.5.98
L 7.15.98

RECEIVED
0990
Code 1849
1 June 1998
JUN 4 1998
Water Monitoring, Assessment &
Protection Division

Mr. Paul Bristol
South Carolina Department of Health
And Environmental Control
Division of Underground Storage Tank
2600 Bull Street
Columbia, SC 29201


**UST ASSESSMENT REPORTS FOR CHARLESTON NAVAL COMPLEX,
CHARLESTON, SC**

Dear Mr. Bristol:

Enclosed are the Assessment Reports for the closure of Underground Storage
Tanks A, K, L, M, N, Y, 220 and 3909 located at the Charleston Naval Complex,
Charleston, SC.

If you have any questions please contact me at (843) 820-7307.

Sincerely,


GABRIEL L. MAGWOOD
Petroleum/UST

Encl:
(1) Assessment Reports

As to be changed
15405